


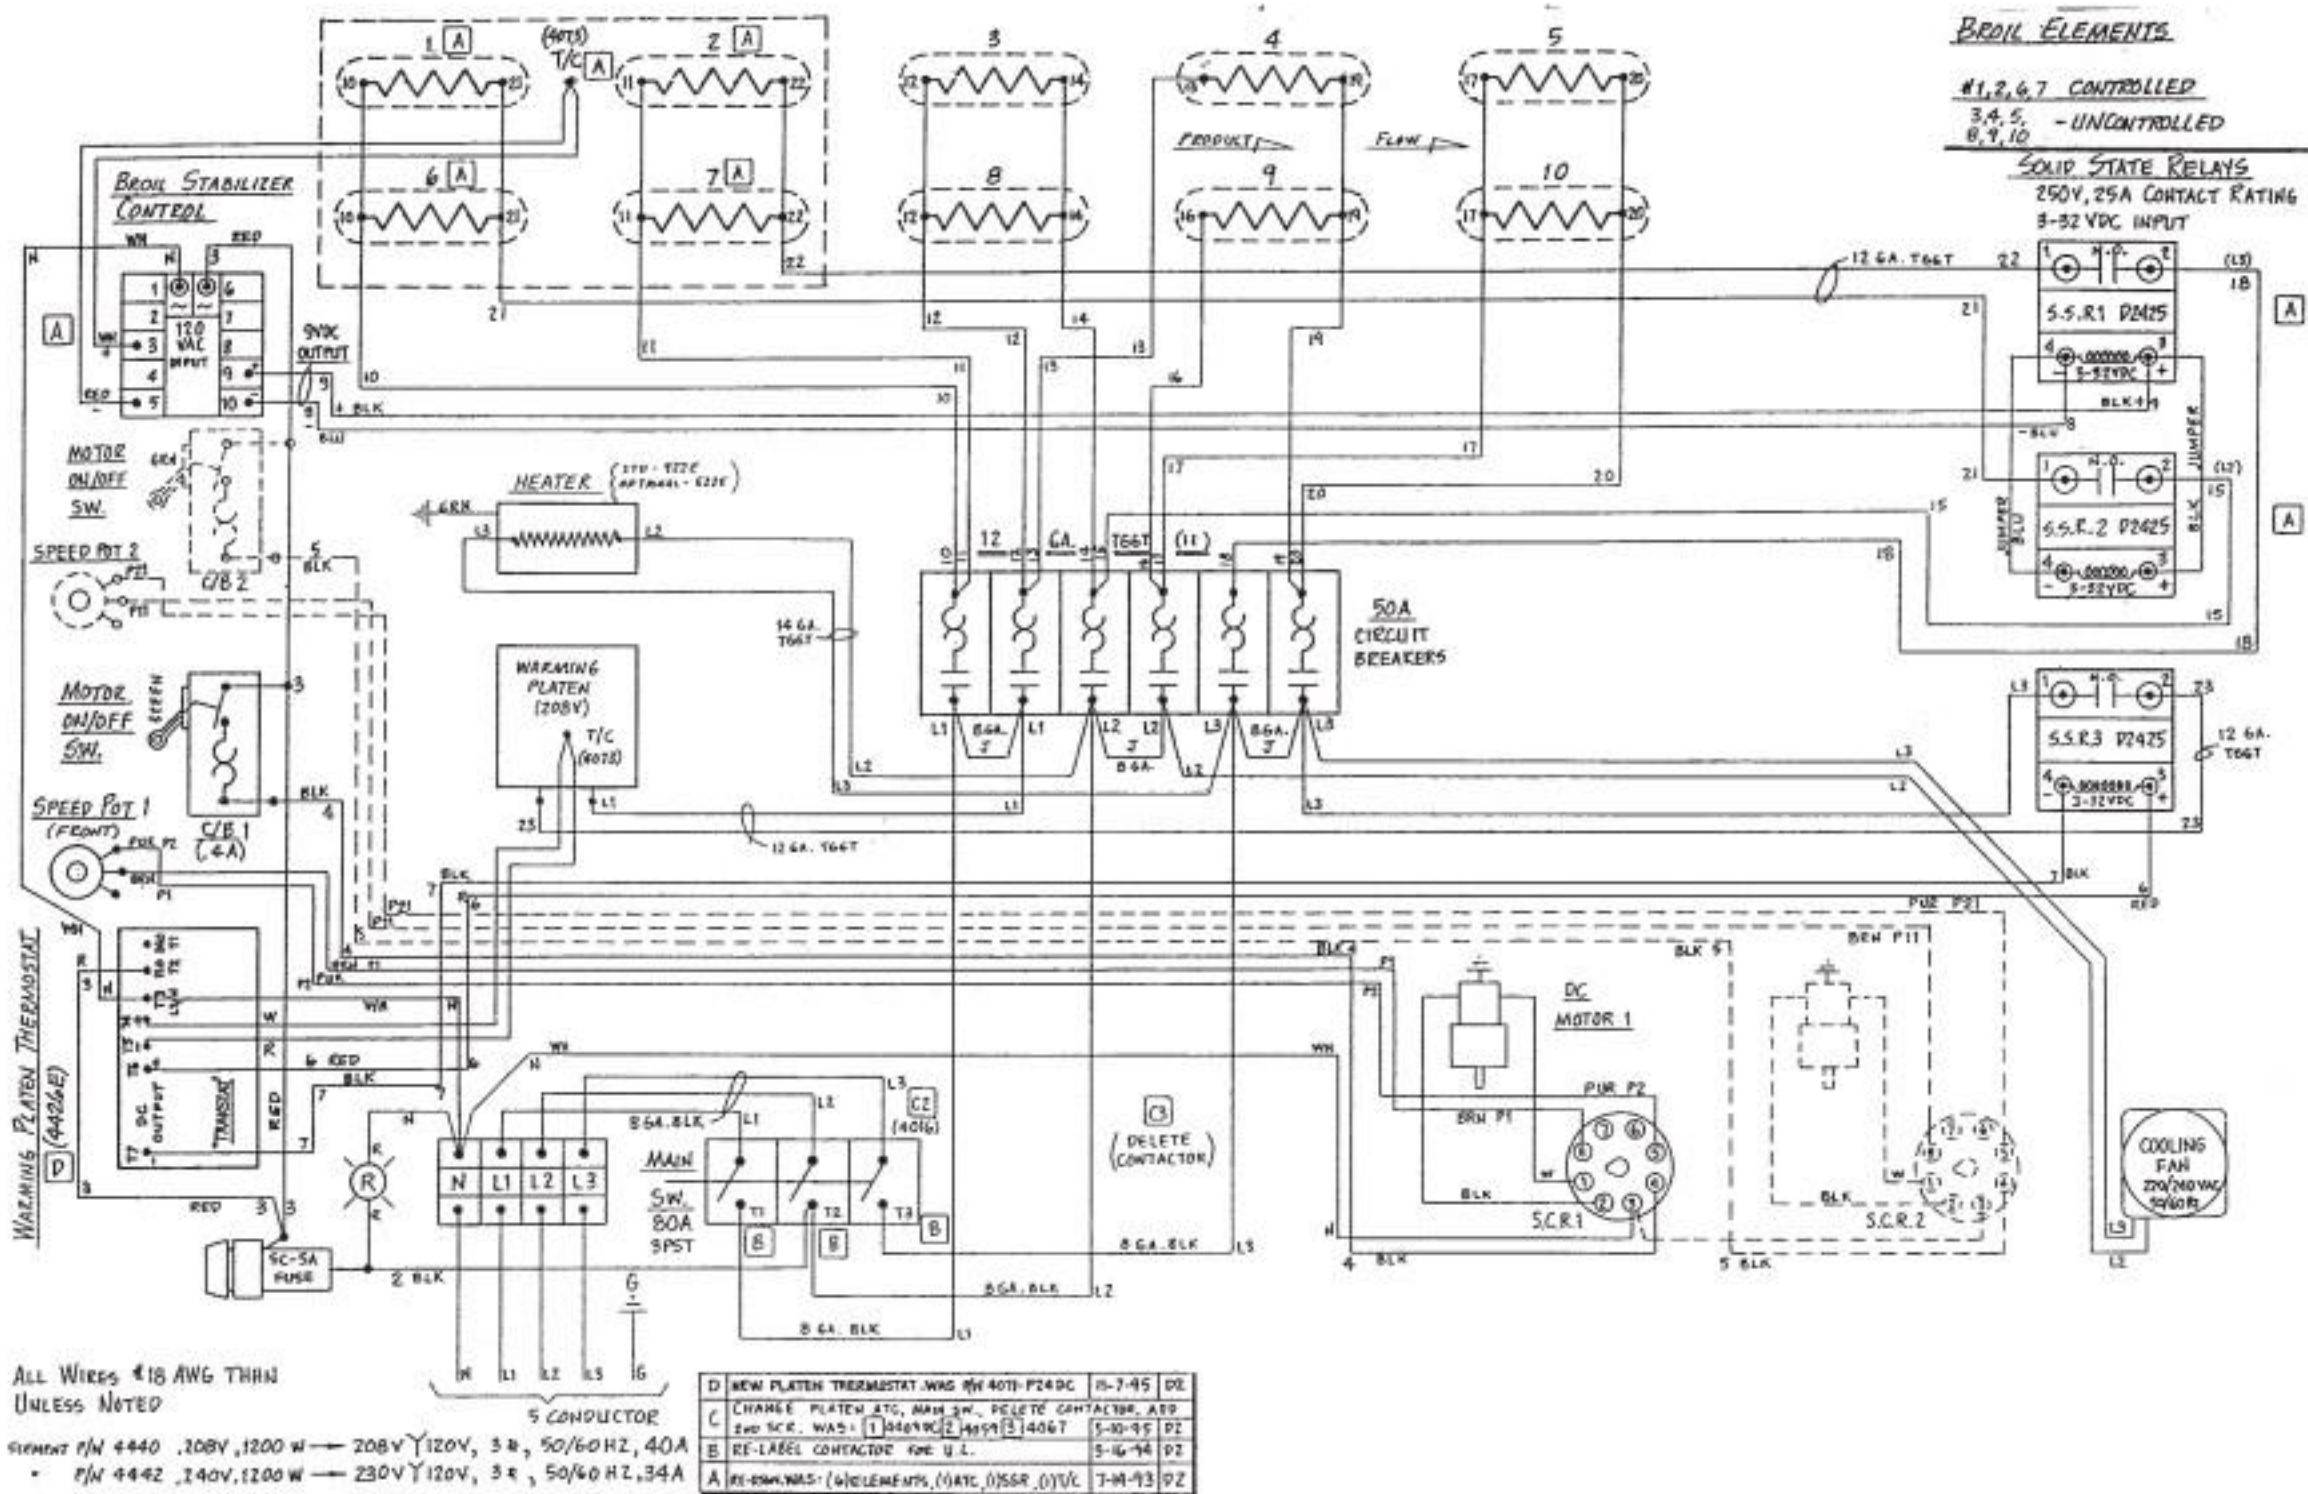


BROIL ELEMENTS

#1,2,4,7 CONTROLLED
3,4,5,8,9,10 - UNCONTROLLED

SOLID STATE RELAYS

250VAC, 25A CONTACT RA
3-32VDC (INPUT)

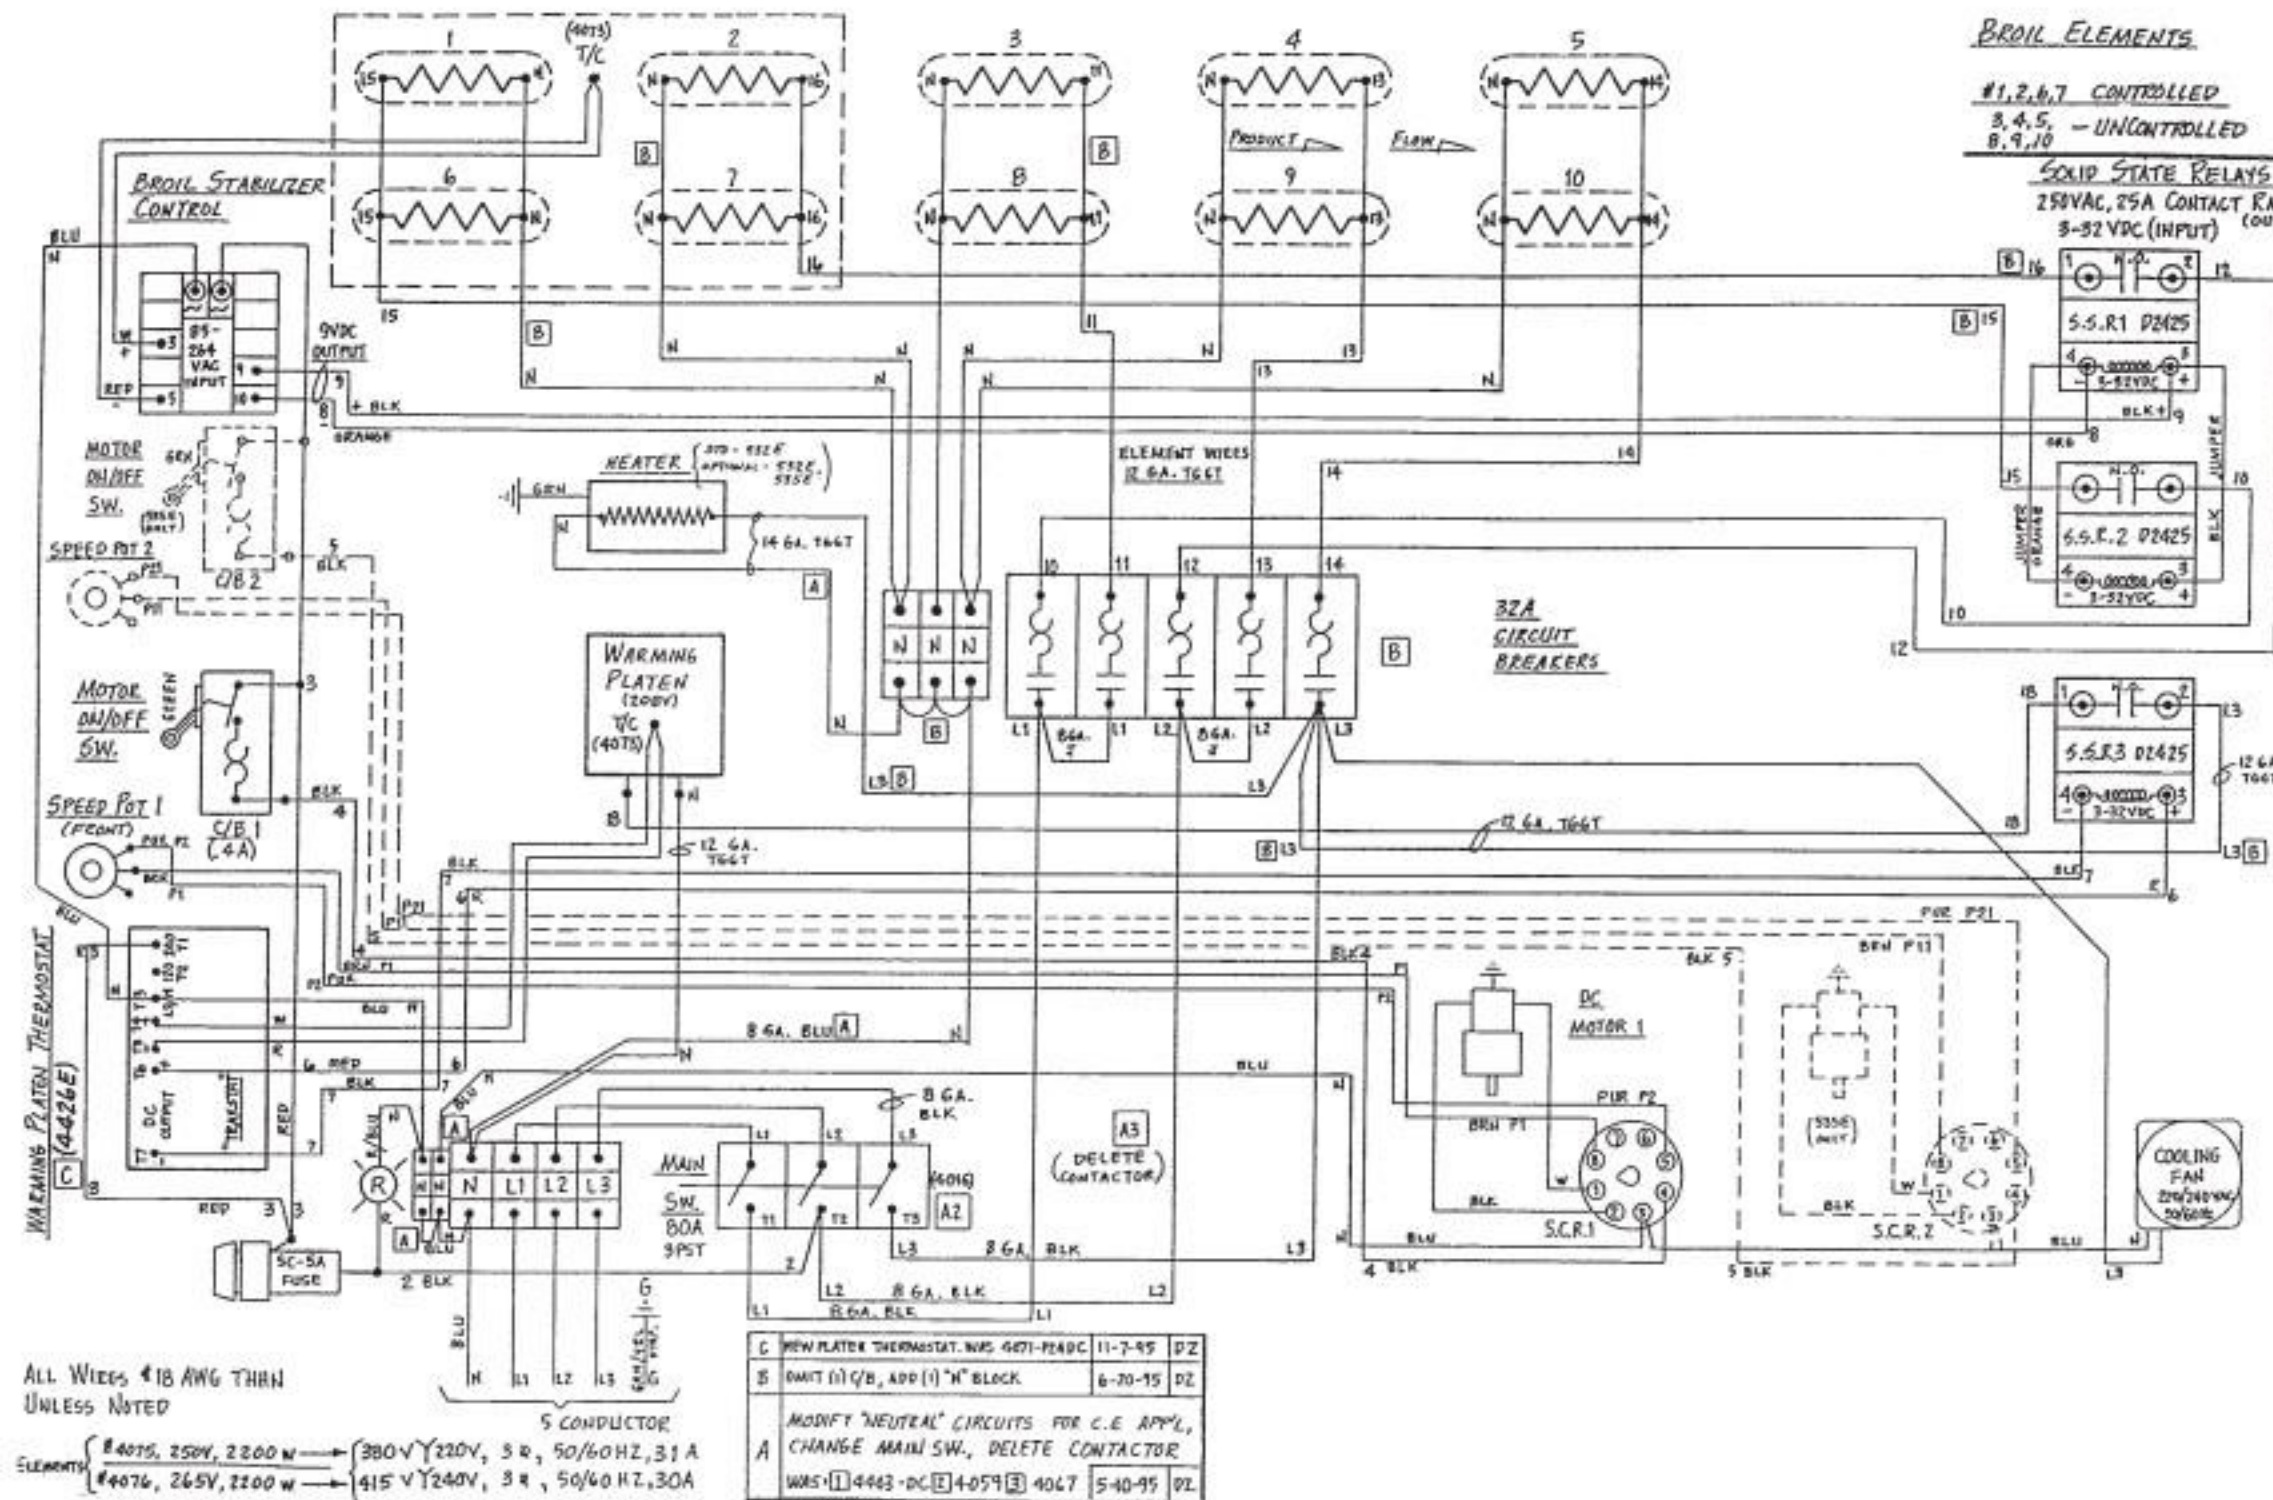


BROIL ELEMENTS

#1,2,6,7 CONTROLLED
3,4,5,8,9,10 - UNCONTROLLED

SOLID STATE RELAYS

250V, 25A CONTACT RATING
3-32VDC INPUT

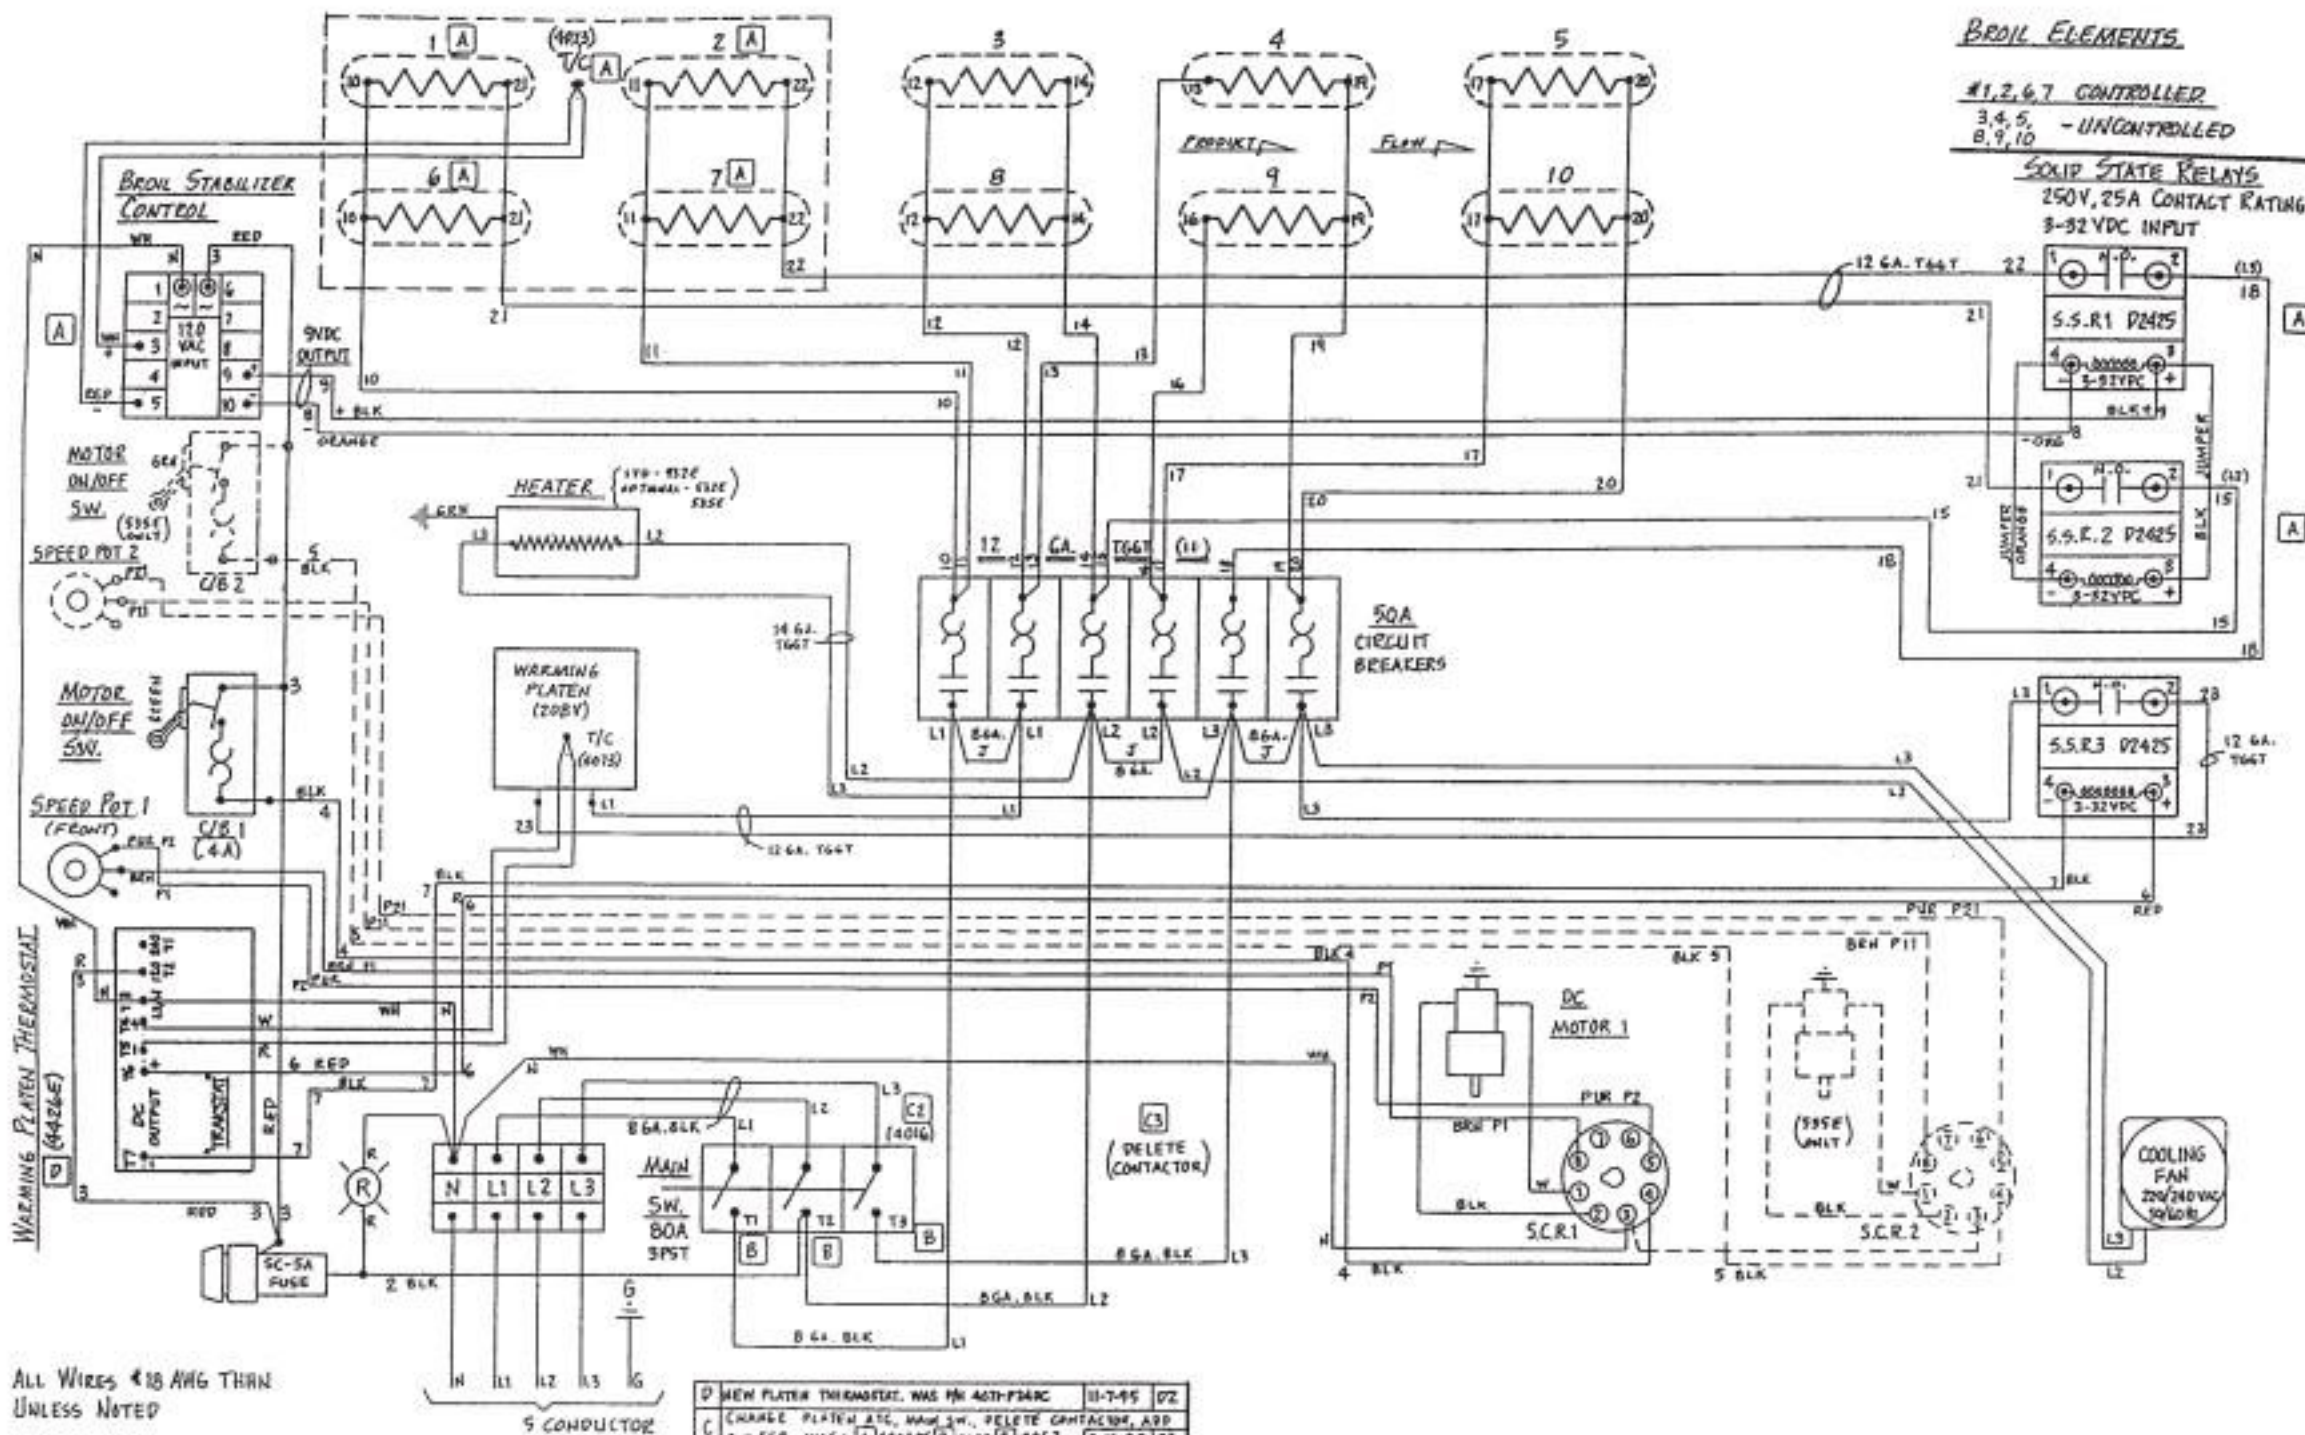


ALL WIRES #18 AWG THIN
UNLESS NOTED

Element 1/4 4081, 240V, 2200 W → 206V, 120V, 3 #, 50/60 HZ, 55A

• 1/4 4075, 250V, 2200 W → 230V, 120V, 3 #, 50/60 HZ, 56A

D	NEW PLATEN THERMOSTAT, WAS PN 40TH-P24RC	11-7-95	DZ
C	CHANGE PLATEN ATC, MAIN SW, DELETE CONTACTOR, ADD 2ND SCR, WAS: 1) 4049K/2) 4054/3) 4067	5-10-95	DZ
B	RE-LABEL CONTACTOR FOR U.L.	3-6-74	DZ
A	RE-CON. WAS: (6) ELEMENTS, (1) ATC, (1) SSR, (1) T/C	7-14-93	DZ



A	NEW FLATEN THERMOSTAT, DELETE C/B JUMPER, INCREASE WIRE SIZE, NO. 6 (1) P/N 4471-P240C (2) 6 GA. (11-7-95) PT
---	--

