

BROIL ELEMENTS


#1,2,7,8 CONTROLLED
 3,4,5,6 - UNCONTROLLED
 9,10,11,12

SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 3-32VDC INPUT

ALL WIRES #18 AWG THIN UNLESS NOTED

ELEMENTS: *4081, 240V, 2200W → 208V Y120V, 3φ, 50/60HZ, 69A
 *4075, 250V, 2200W → 230V Y120V, 3φ, 50/60HZ, 71A

C	REPL. PLATEN THERMOSTAT, DELETE C/B JUMPS, WIRE SIZE	11-7-99	DPZ
B	DELETE RECEPT, PWR. WIRE TO C/B; ADD JUMPS; TRIPLE WIRE COND. WPS: (1) DUAL WIRING (2) BLADE	5-31-96	DPZ
A	REVISE TERMINAL STRIP; ADD 'N' BLK	5-10-95	DPZ

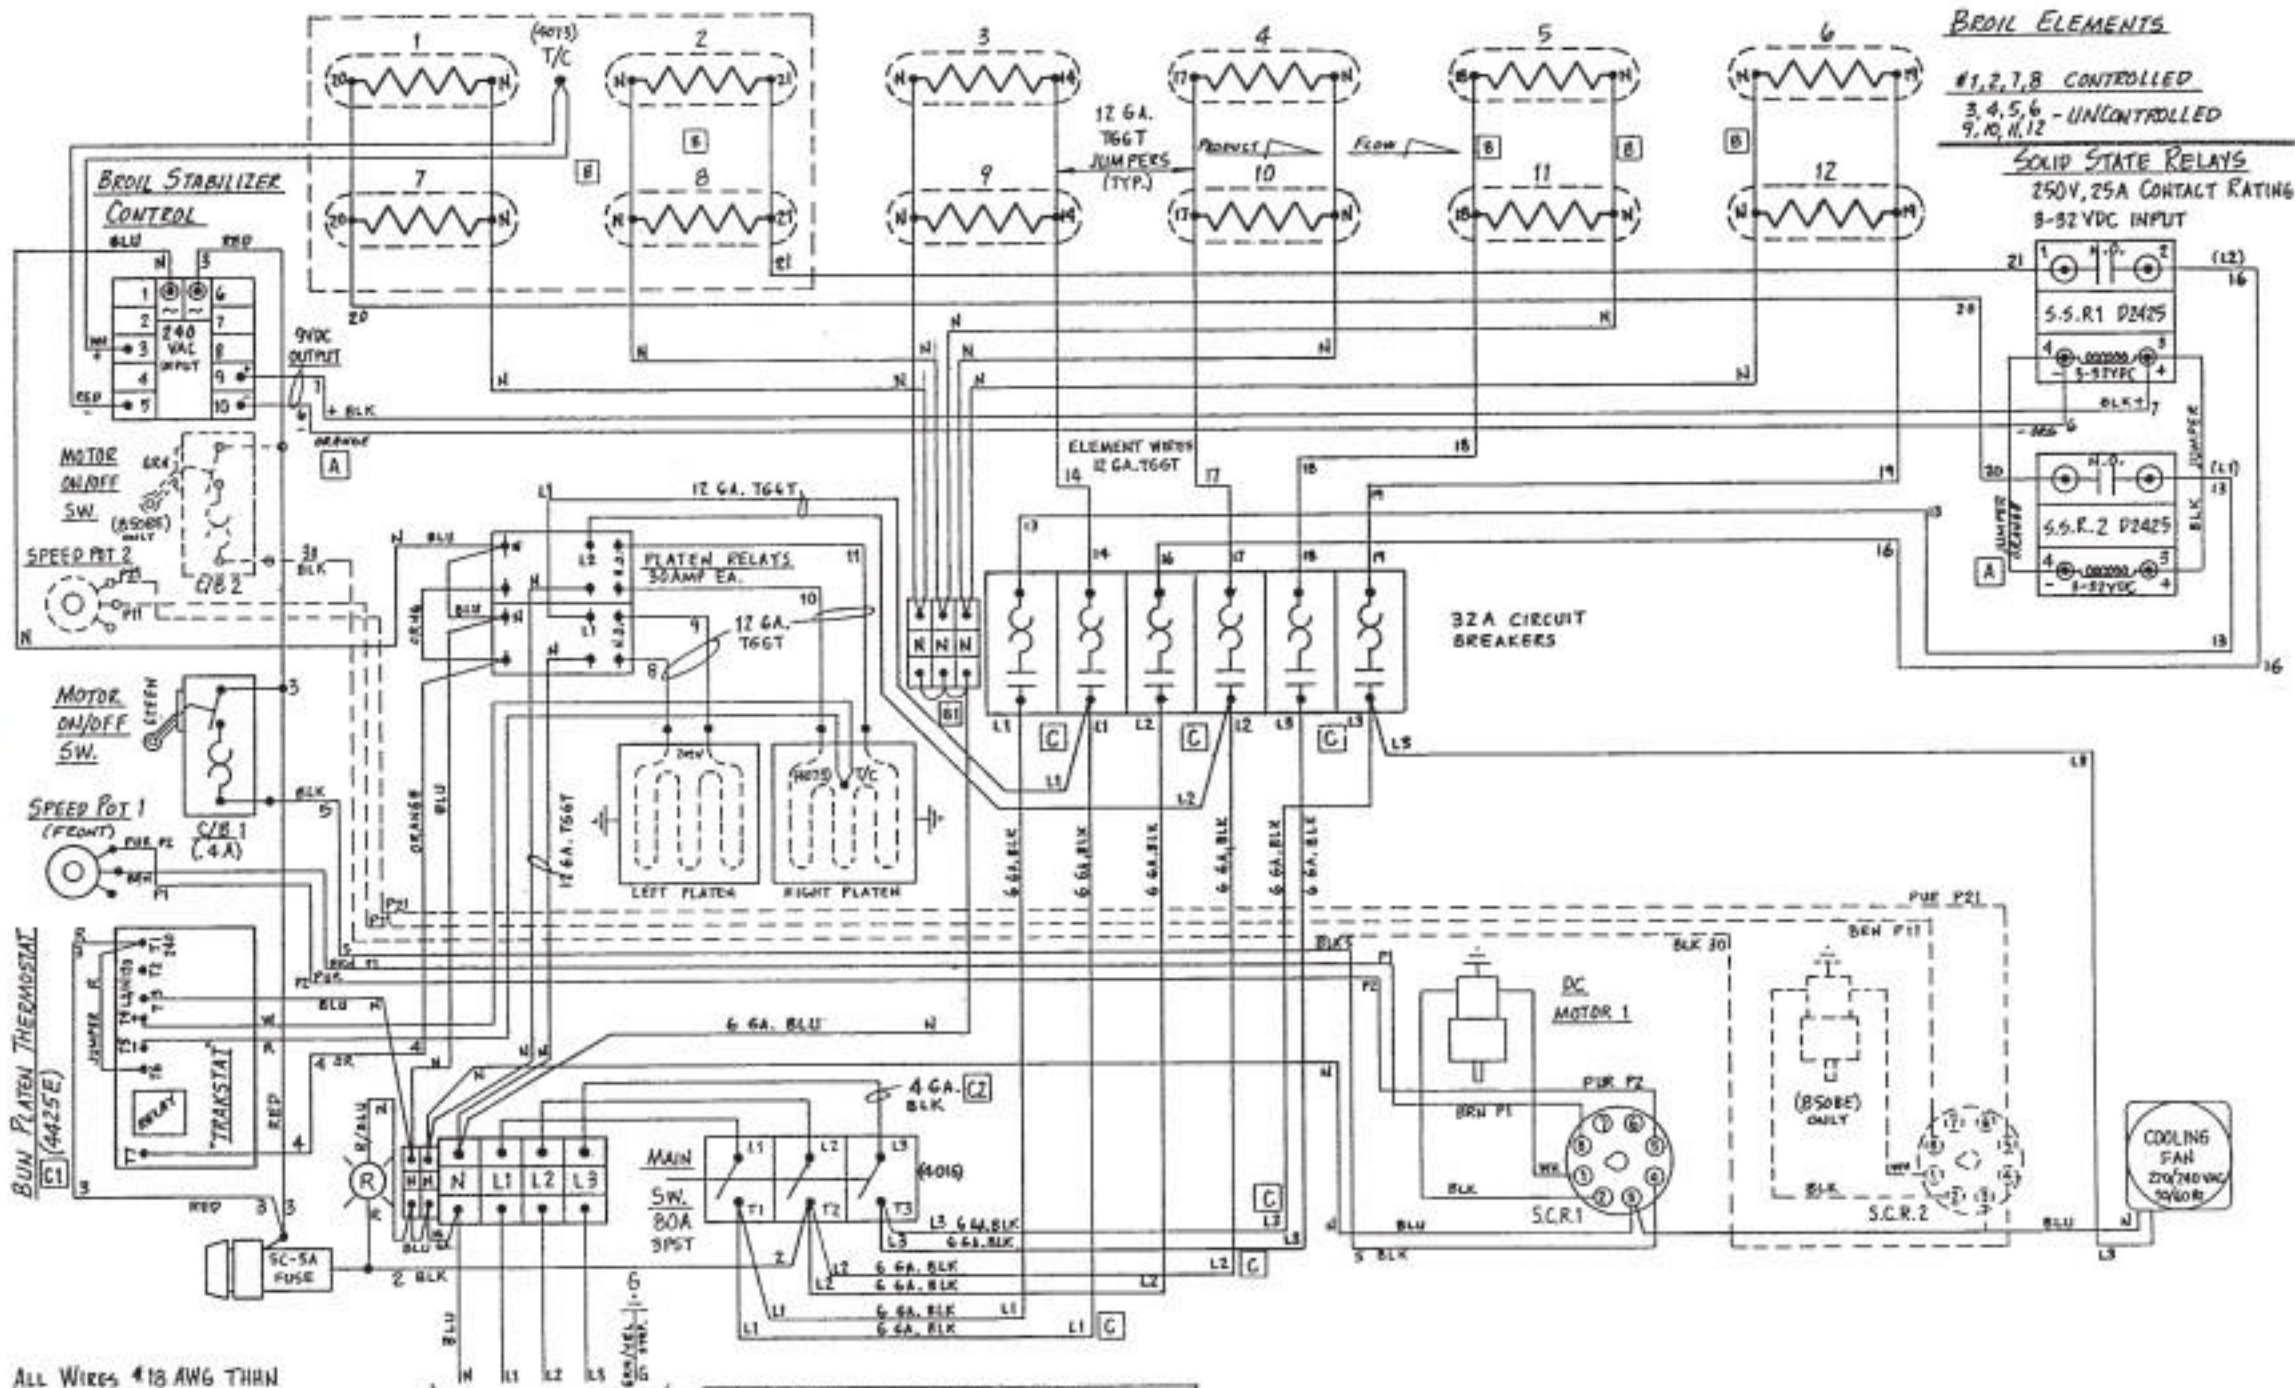

BROIL ELEMENTS


#1,2,7,8 CONTROLLED
 3,4,5,6 - UNCONTROLLED
 9,10,11,12

SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 9-32VDC INPUT

ALL WIRES #18 AWG THIN UNLESS NOTED

ELEMENTS
 #4075, 250V, 2200W → 380V/220V, 3φ, 50/60HZ, 39A
 #4076, 245V, 2200W → 415V/240V, 3φ, 50/60HZ, 39A

C	NEW PLATEN THERMOSTAT, DELETE C/D JUMPERS, INCREASE WIRE SIZE. WAS (1) RN 4071-B (2) 6 GA. 11-7-95 DZ
B	ADD "N" BLOCK, KEY "N" WIRING. WAS: (1) RT10 6-11-92 DZ
A	CHANGE WIRE COLOR #SYMB. CON. WAS BLUE 5-31-91 DZ

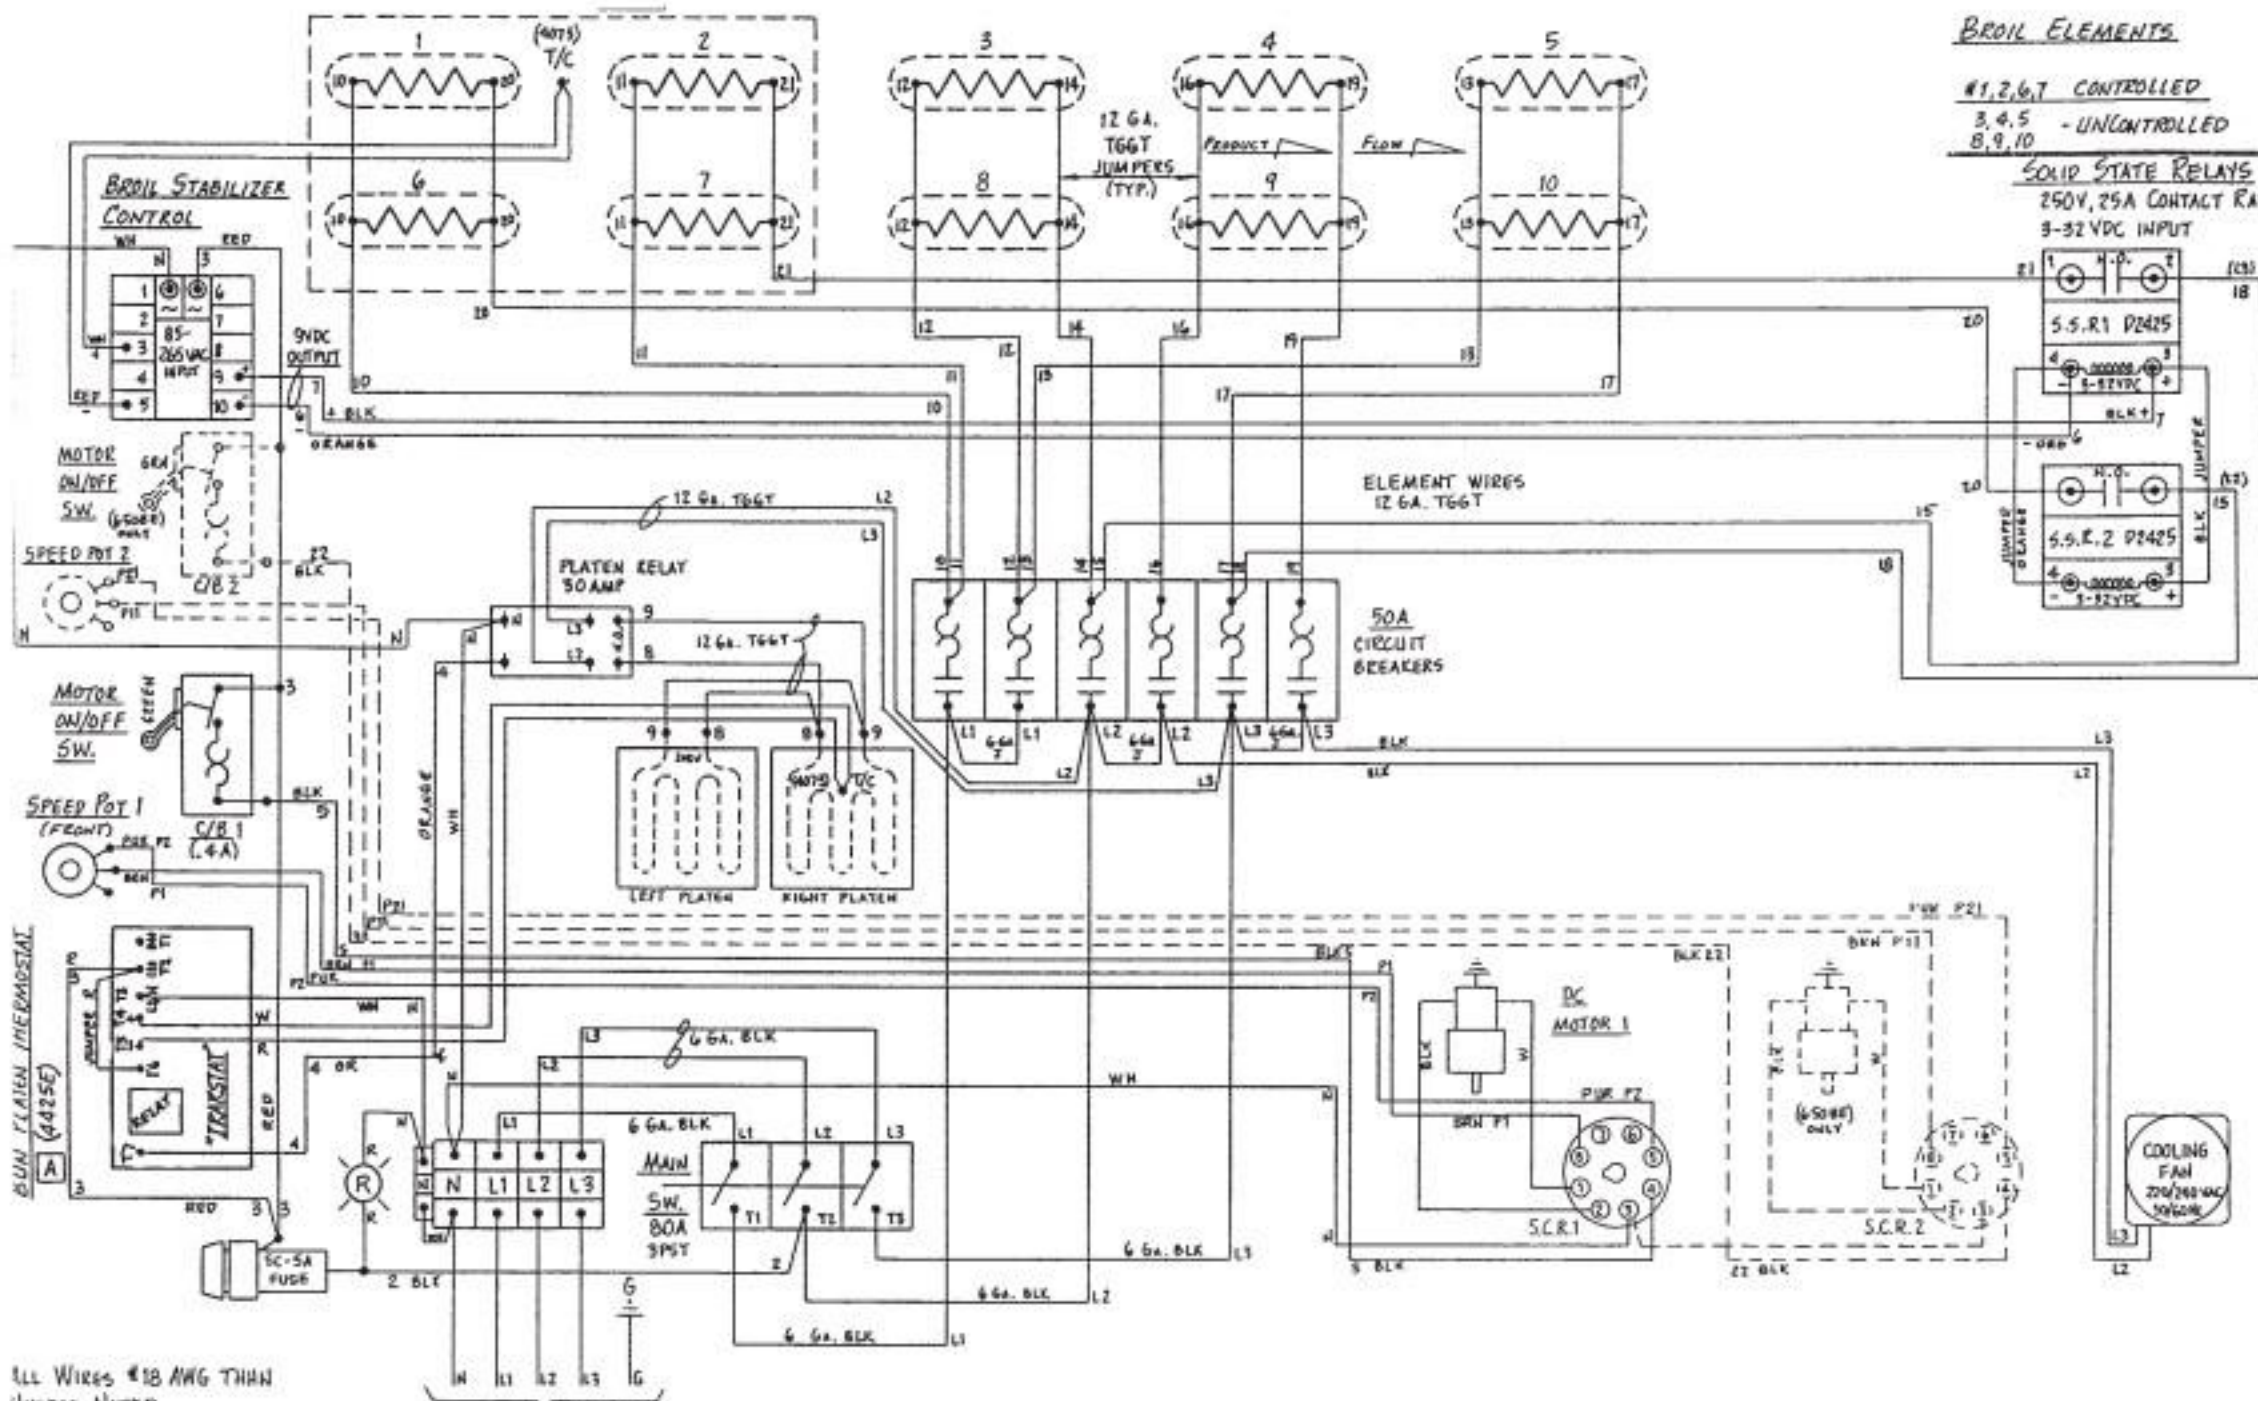

BROIL ELEMENTS
 #1,2,6,7 CONTROLLED
 3,4,5 - UNCONTROLLED
 8,9,10

SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 3-32VDC INPUT

ALL WIRES #18 AWG UNLESS NOTED


LEAKS: #4081, 240V, 2200W → 208V Y120V, 3φ, 50/60HZ, 55A
 #4075, 240V, 2200W → 230V Y120V, 3φ, 50/60HZ, 56A

A NEW PLATEN THERMOSTAT, WAS P/N 4071-P 11-7-95/DZ

BROIL ELEMENTS

#1,2,6,7 CONTROLLED
 3,4,5 - UNCONTROLLED
 8,9,10

SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 9-32VDC INPUT

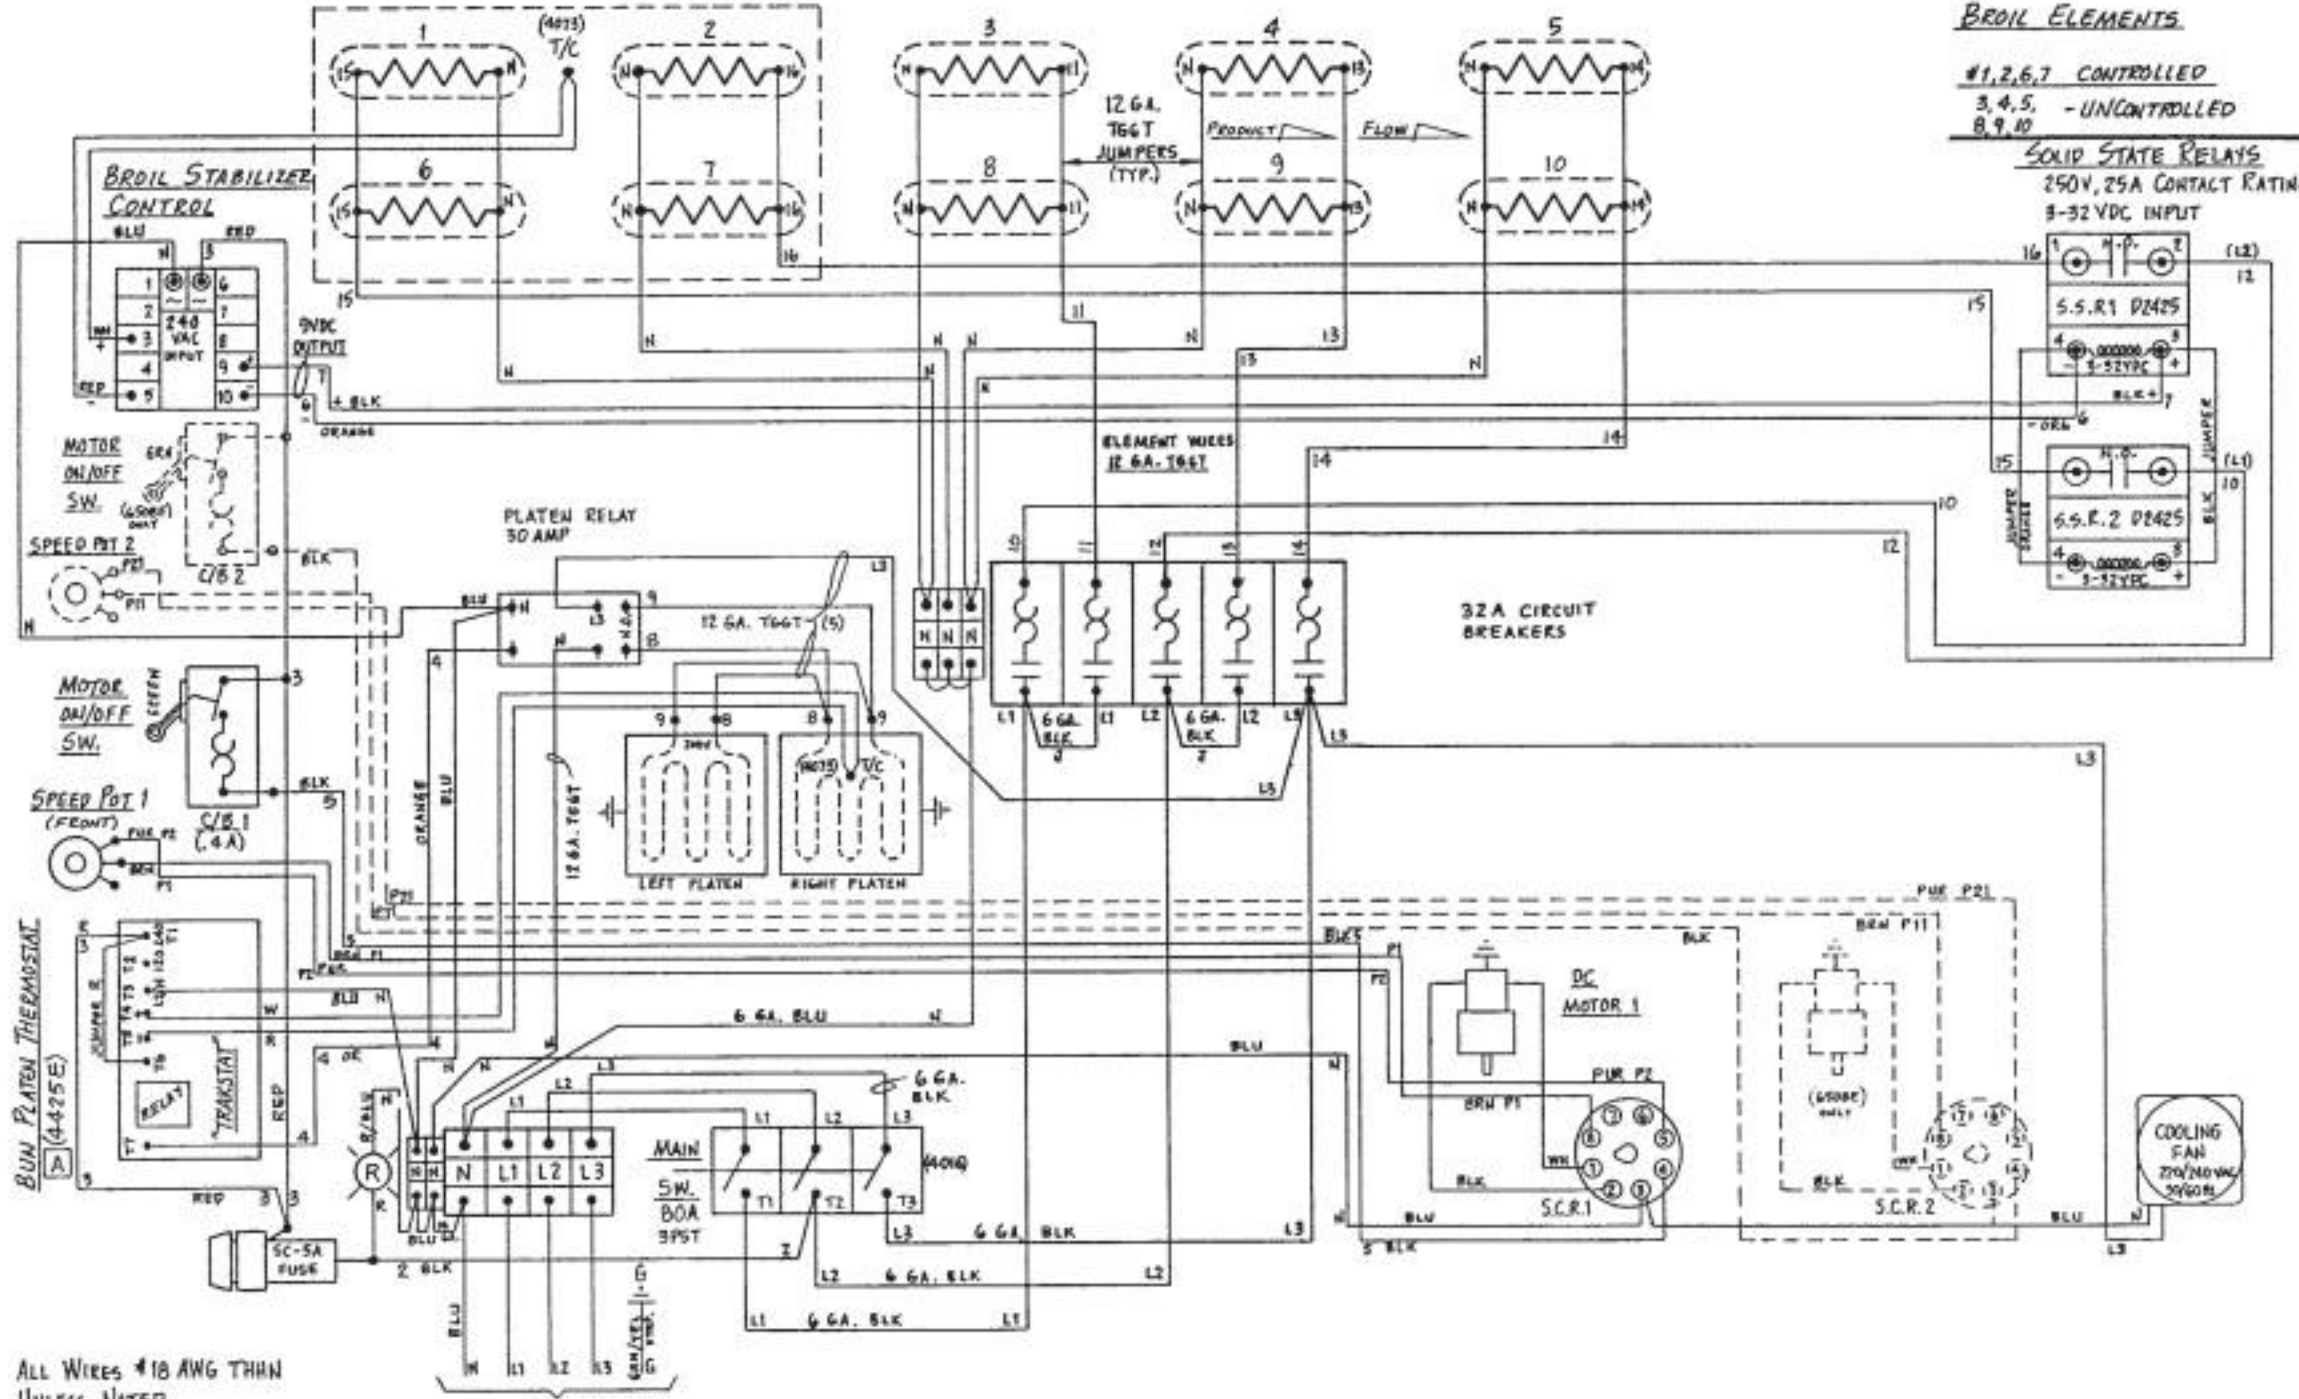

ALL WIRES #18 AWG THIN UNLESS NOTED

Elements { #4075, 250V, 2200W → (380V Y 220V, 3φ, 50/60HZ, 31A)
 #4076, 265V, 2200W → (415V Y 240V, 3φ, 50/60HZ, 30A)

A NEW PLATEN THERMOSTAT WAS P/N 4071-P (11-7-95) [DZ]