


REV	DESCRIPTION	DATE	APPROVED
A	INITIAL RELEASE	9-15-01	FB

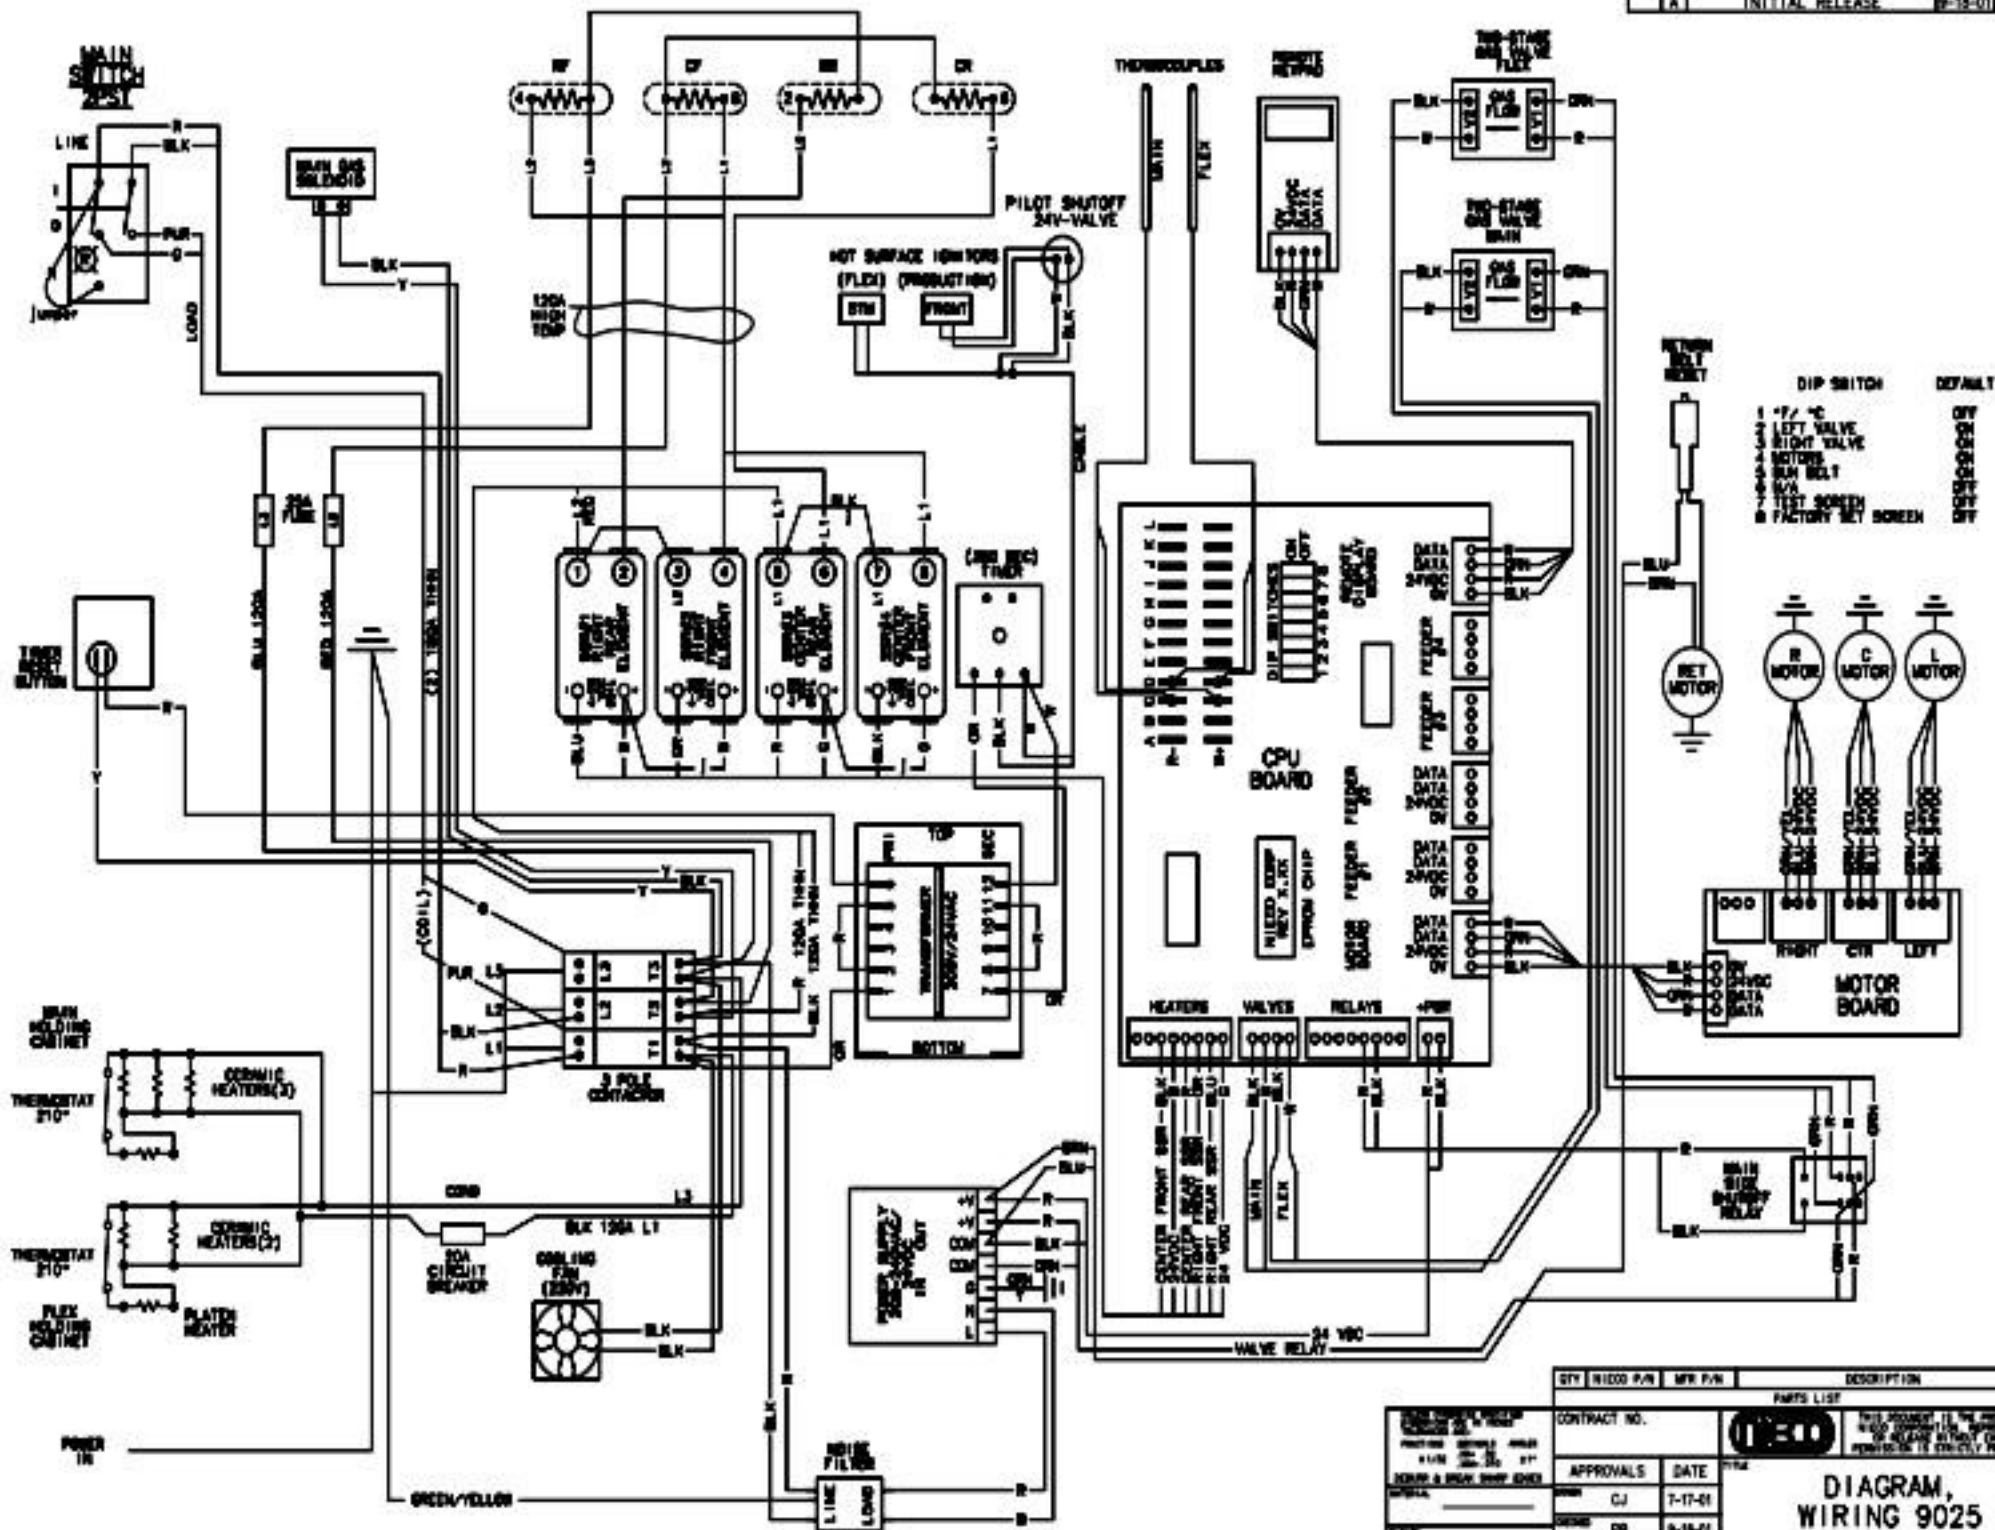

DIP SWITCH	DEFAULT
1 - 7/2 °C	ROOM TEMP
2 - LEFT VALVE	ROOM TEMP
3 - RIGHT VALVE	ROOM TEMP
4 - MOTOR	ROOM TEMP
5 - FAN BELT	ROOM TEMP
6 - TEST SCREEN	ROOM TEMP
7 - FACTORY SET SCREEN	ROOM TEMP

QTY	11000 P/N	MFR P/N	DESCRIPTION	1788
PARTS LIST				
CONTRACT NO.				
APPROVALS				
DATE				
TITLE				
DIAGRAM, WIRING 9025				
12273				
1 OF 1				