


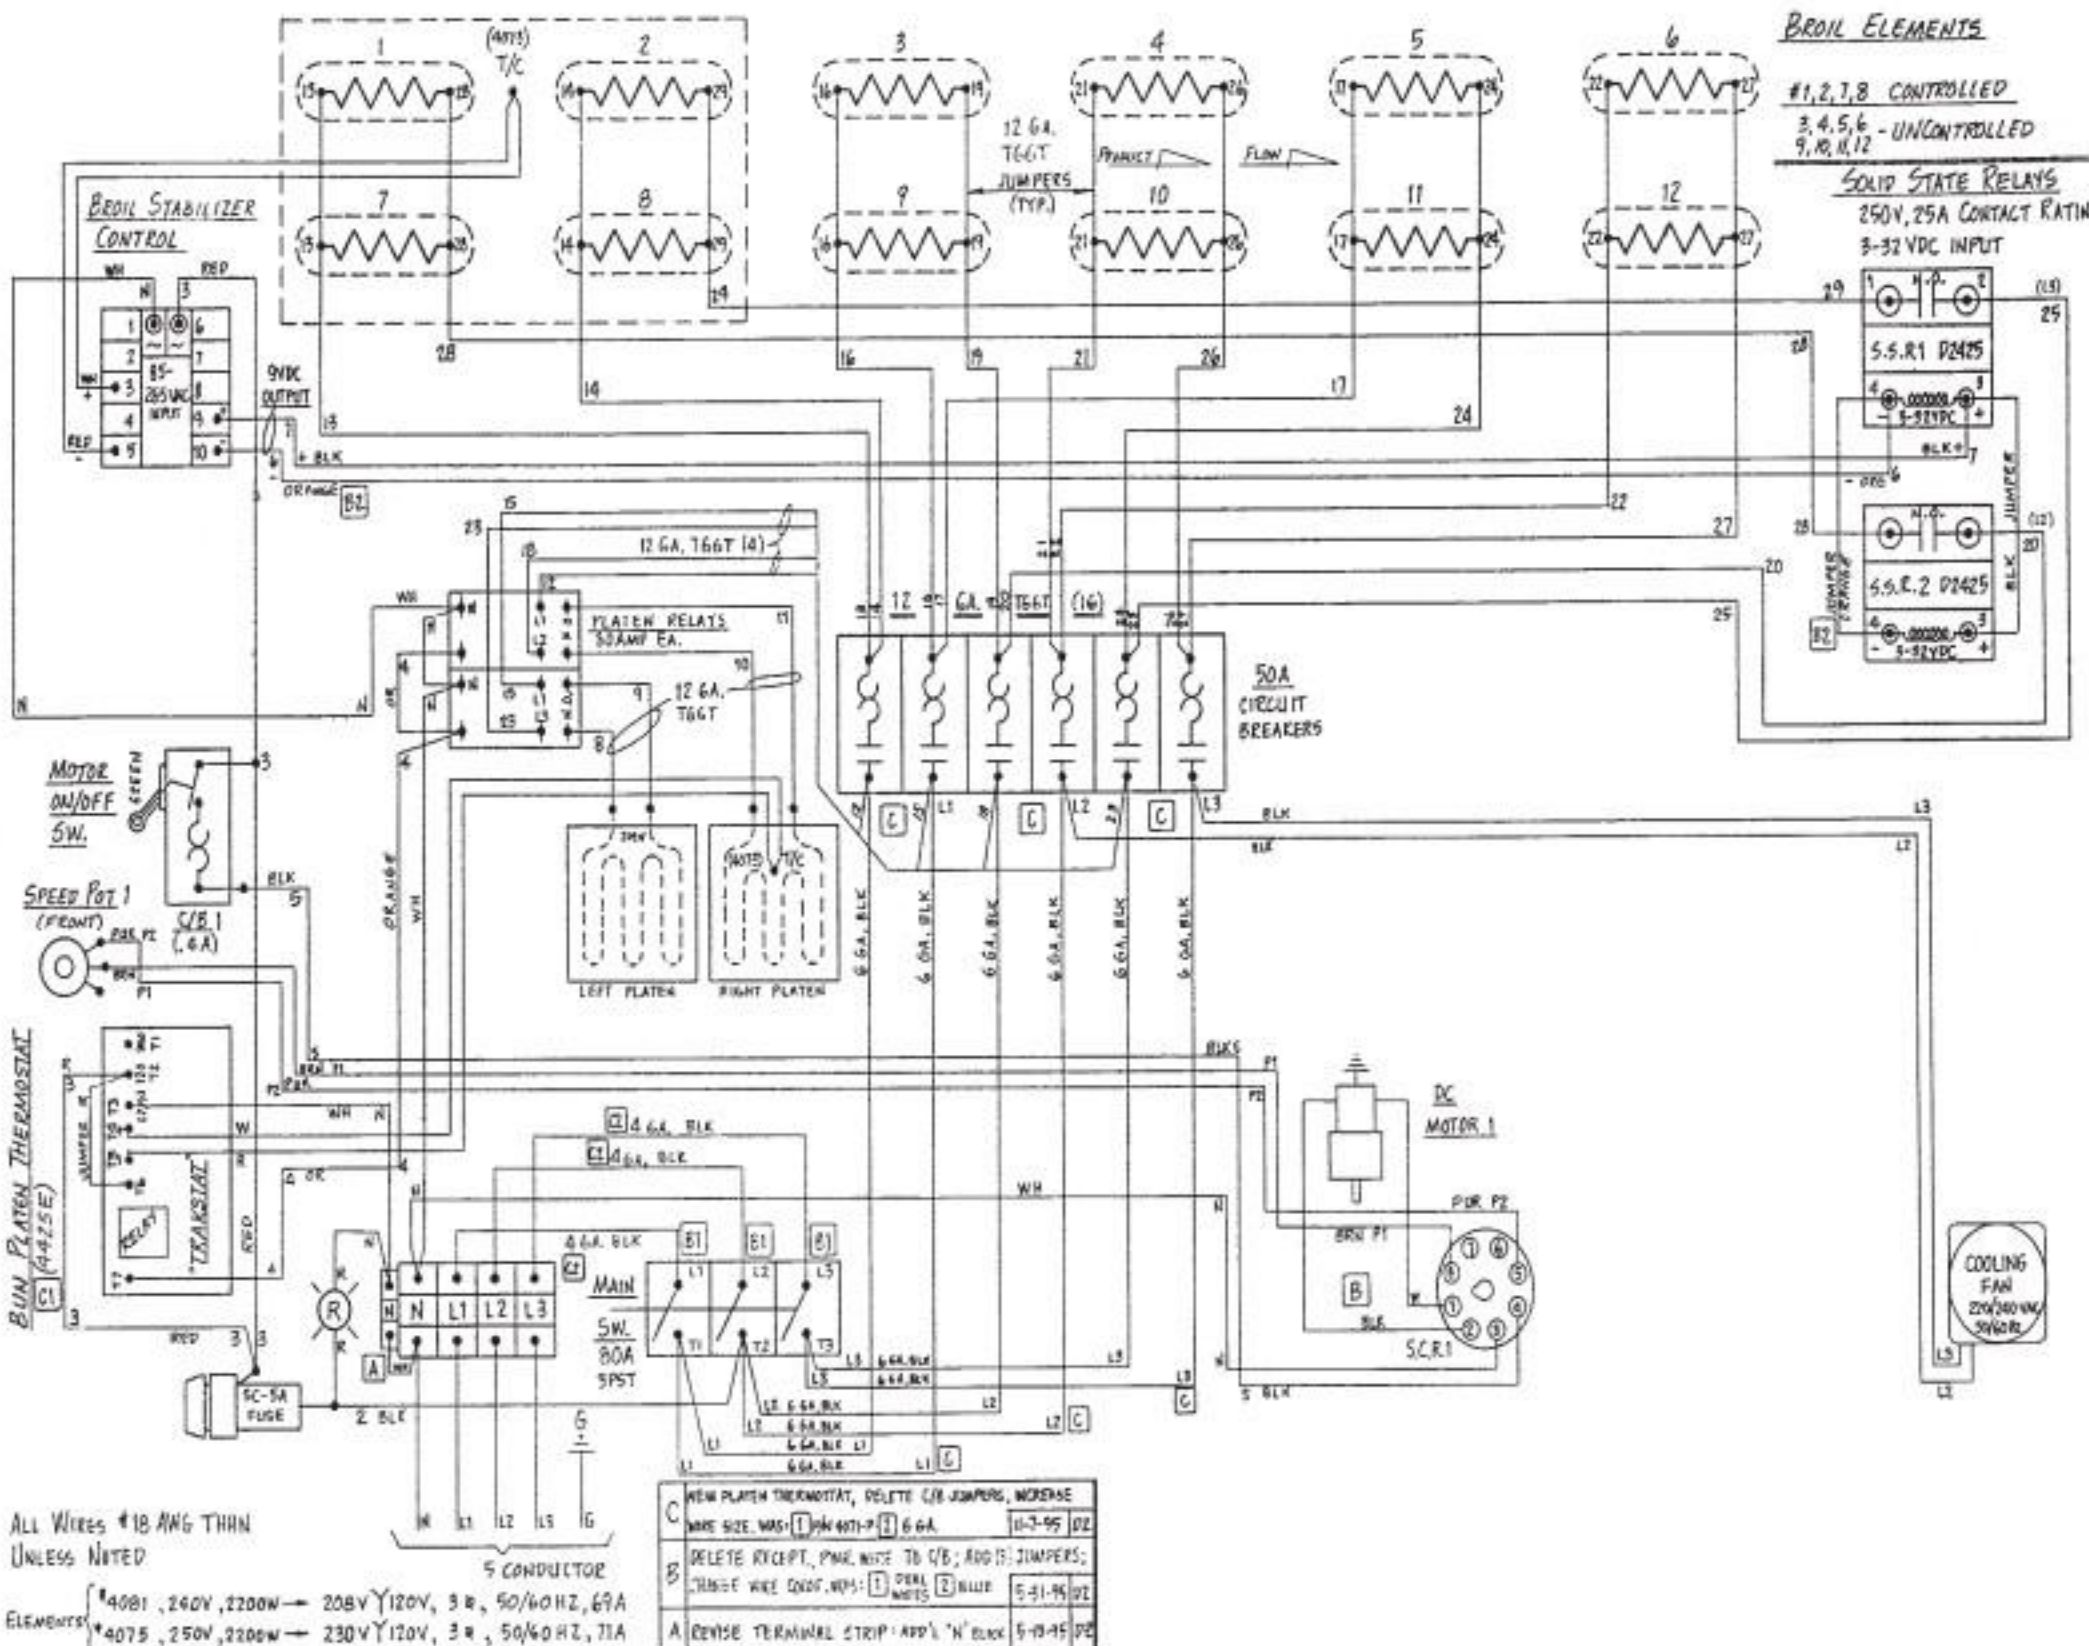

**BROIL ELEMENTS**

#1,2,7,8 CONTROLLED  
 3,4,5,6 - UNCONTROLLED  
 9,10,11,12


**SOLID STATE RELAYS**  
 250V, 25A CONTACT RATING  
 3-32 VDC INPUT

ALL WIRES #18 AWG THHN  
 UNLESS NOTED

5 CONDUCTOR

ELEMENTS  
 \*4081, 240V, 2200W → 208V/120V, 3#, 50/60 HZ, 69A  
 \*4075, 250V, 2200W → 230V/120V, 3#, 50/60 HZ, 71A

|   |                                                                                                |            |
|---|------------------------------------------------------------------------------------------------|------------|
| C | NEW PLATEN THERMOSTAT, DELETE C/R JUMPERS, INCREASE WIRE SIZE WAS: (1) 18 AWG (2) 16 GA.       | 11-3-95 DZ |
| B | DELETE R/CPT, PWR. WIRE TO C/B; ADD (1) JUMPERS; CHANGE WIRE COND. WPS: (1) PERM. WTS (2) BLUR | 5-31-95 DZ |
| A | REVISE TERMINAL STRIP: ADD 'N' BLK                                                             | 5-10-95 DZ |

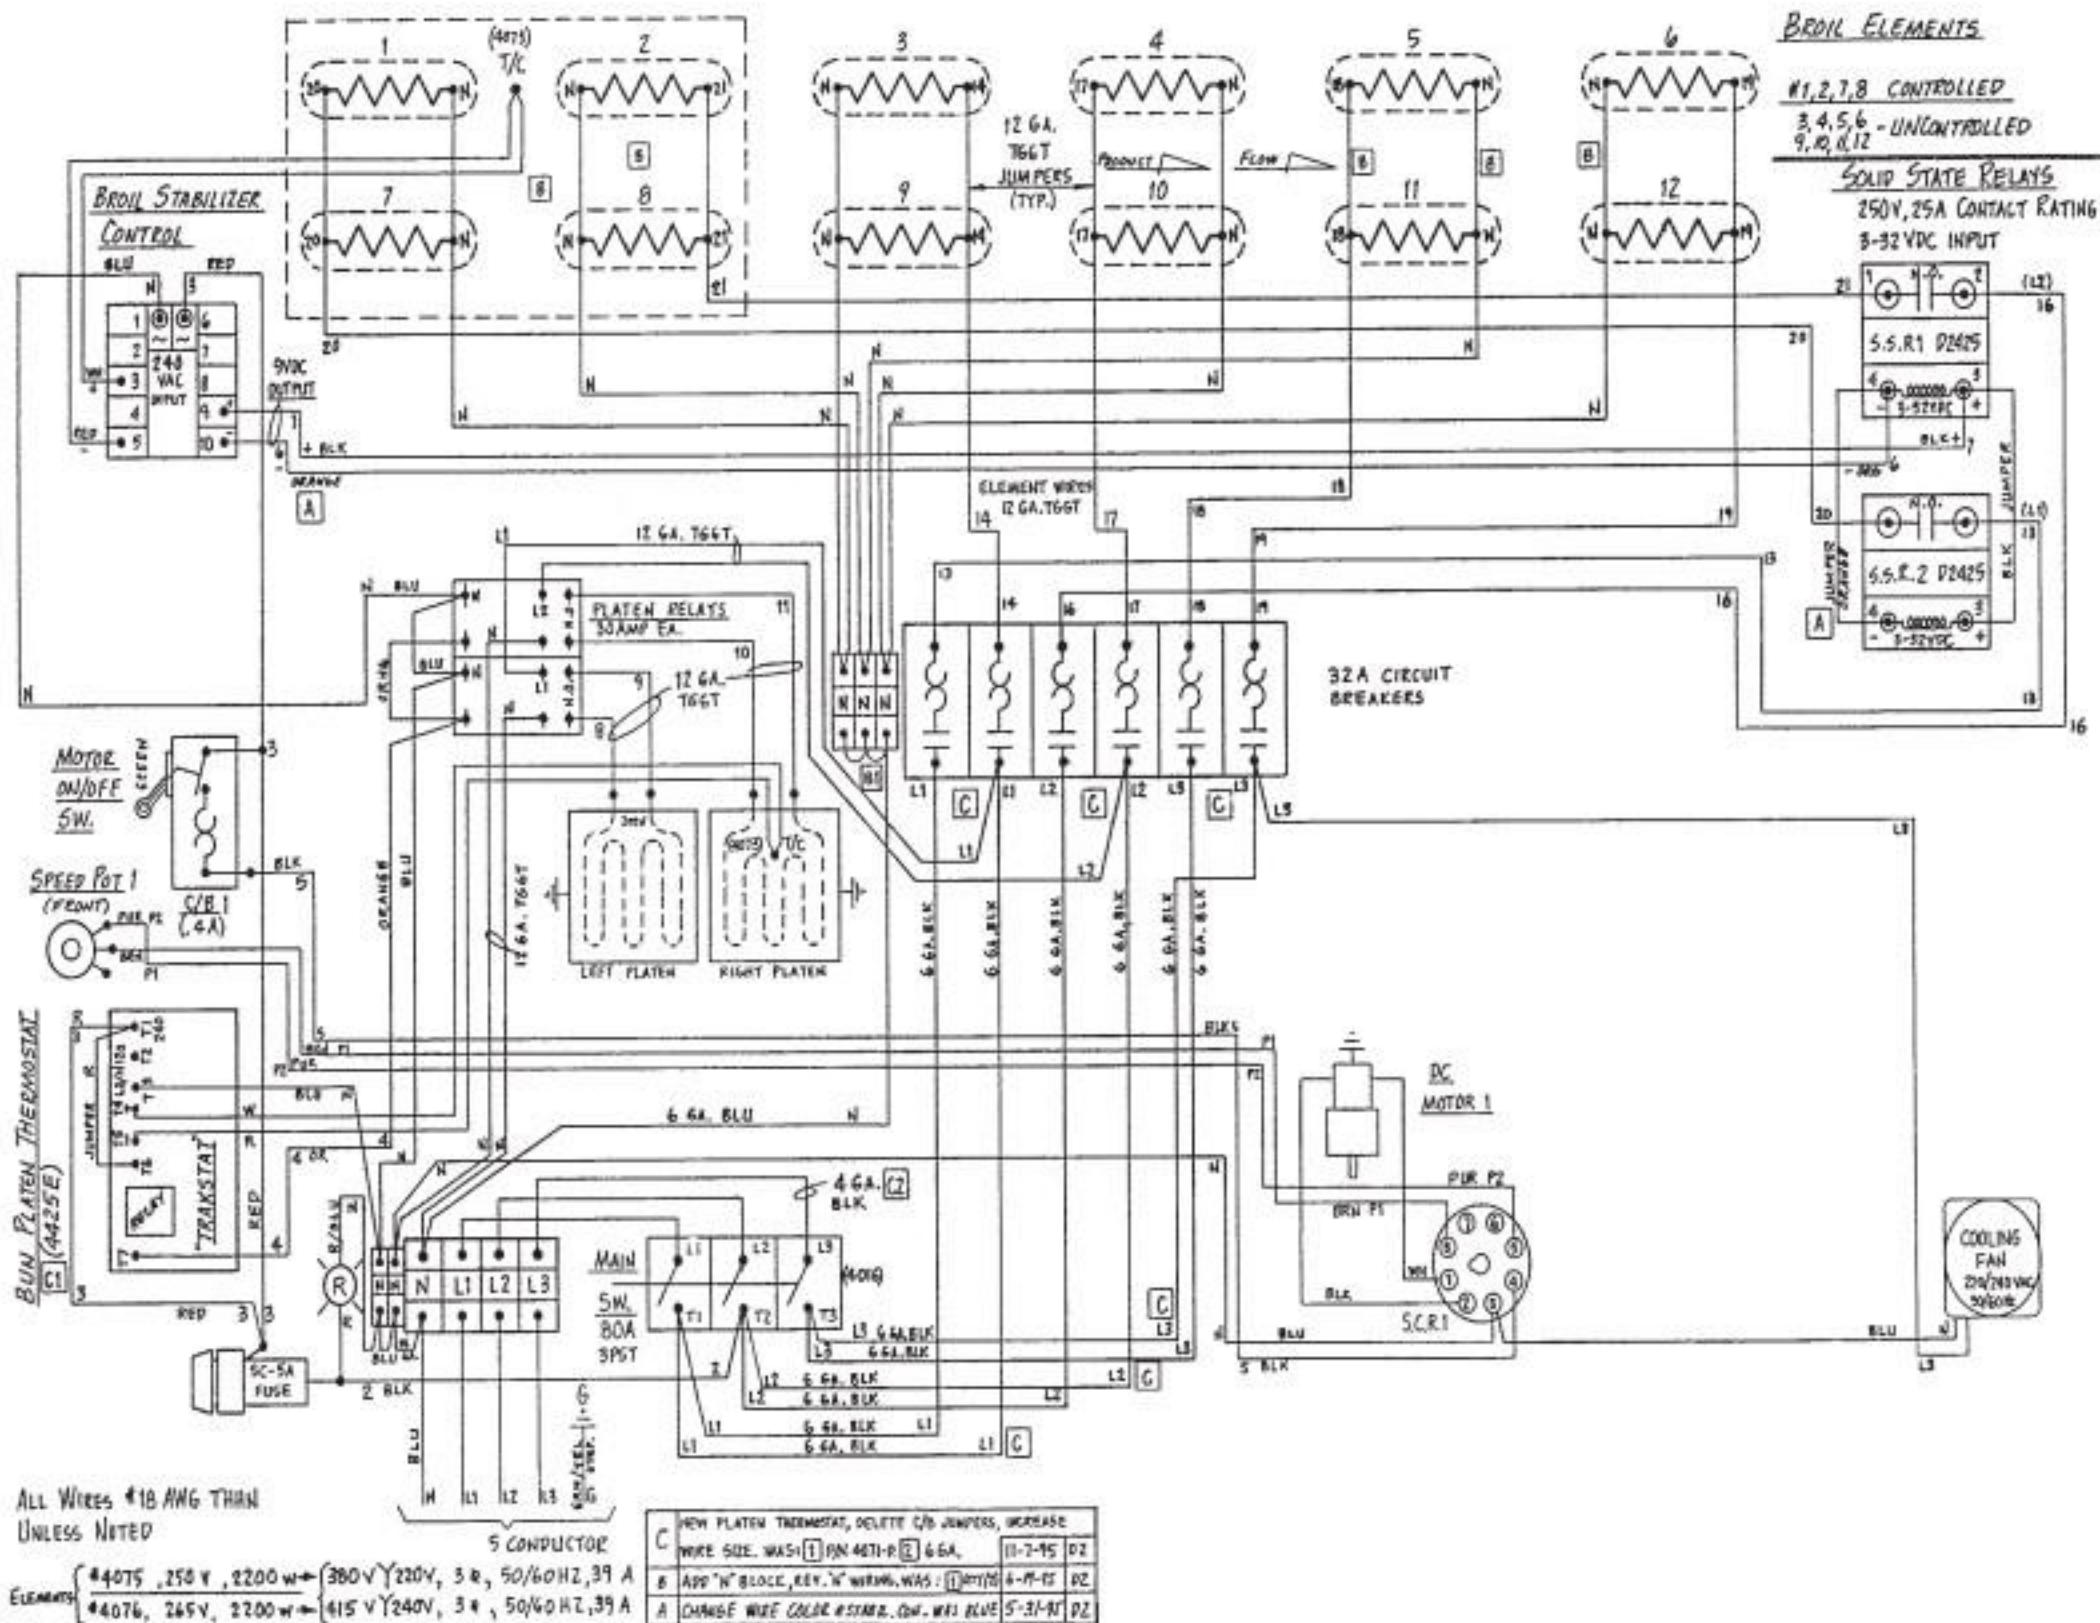



# BROIL ELEMENTS

#1,2,6,7 CONTROLLED


3,4,5 - UNCONTROLLED

8,9,10

SOLID STATE RELAYS

250V, 25A CONTACT RATING


9-32VDC INPUT

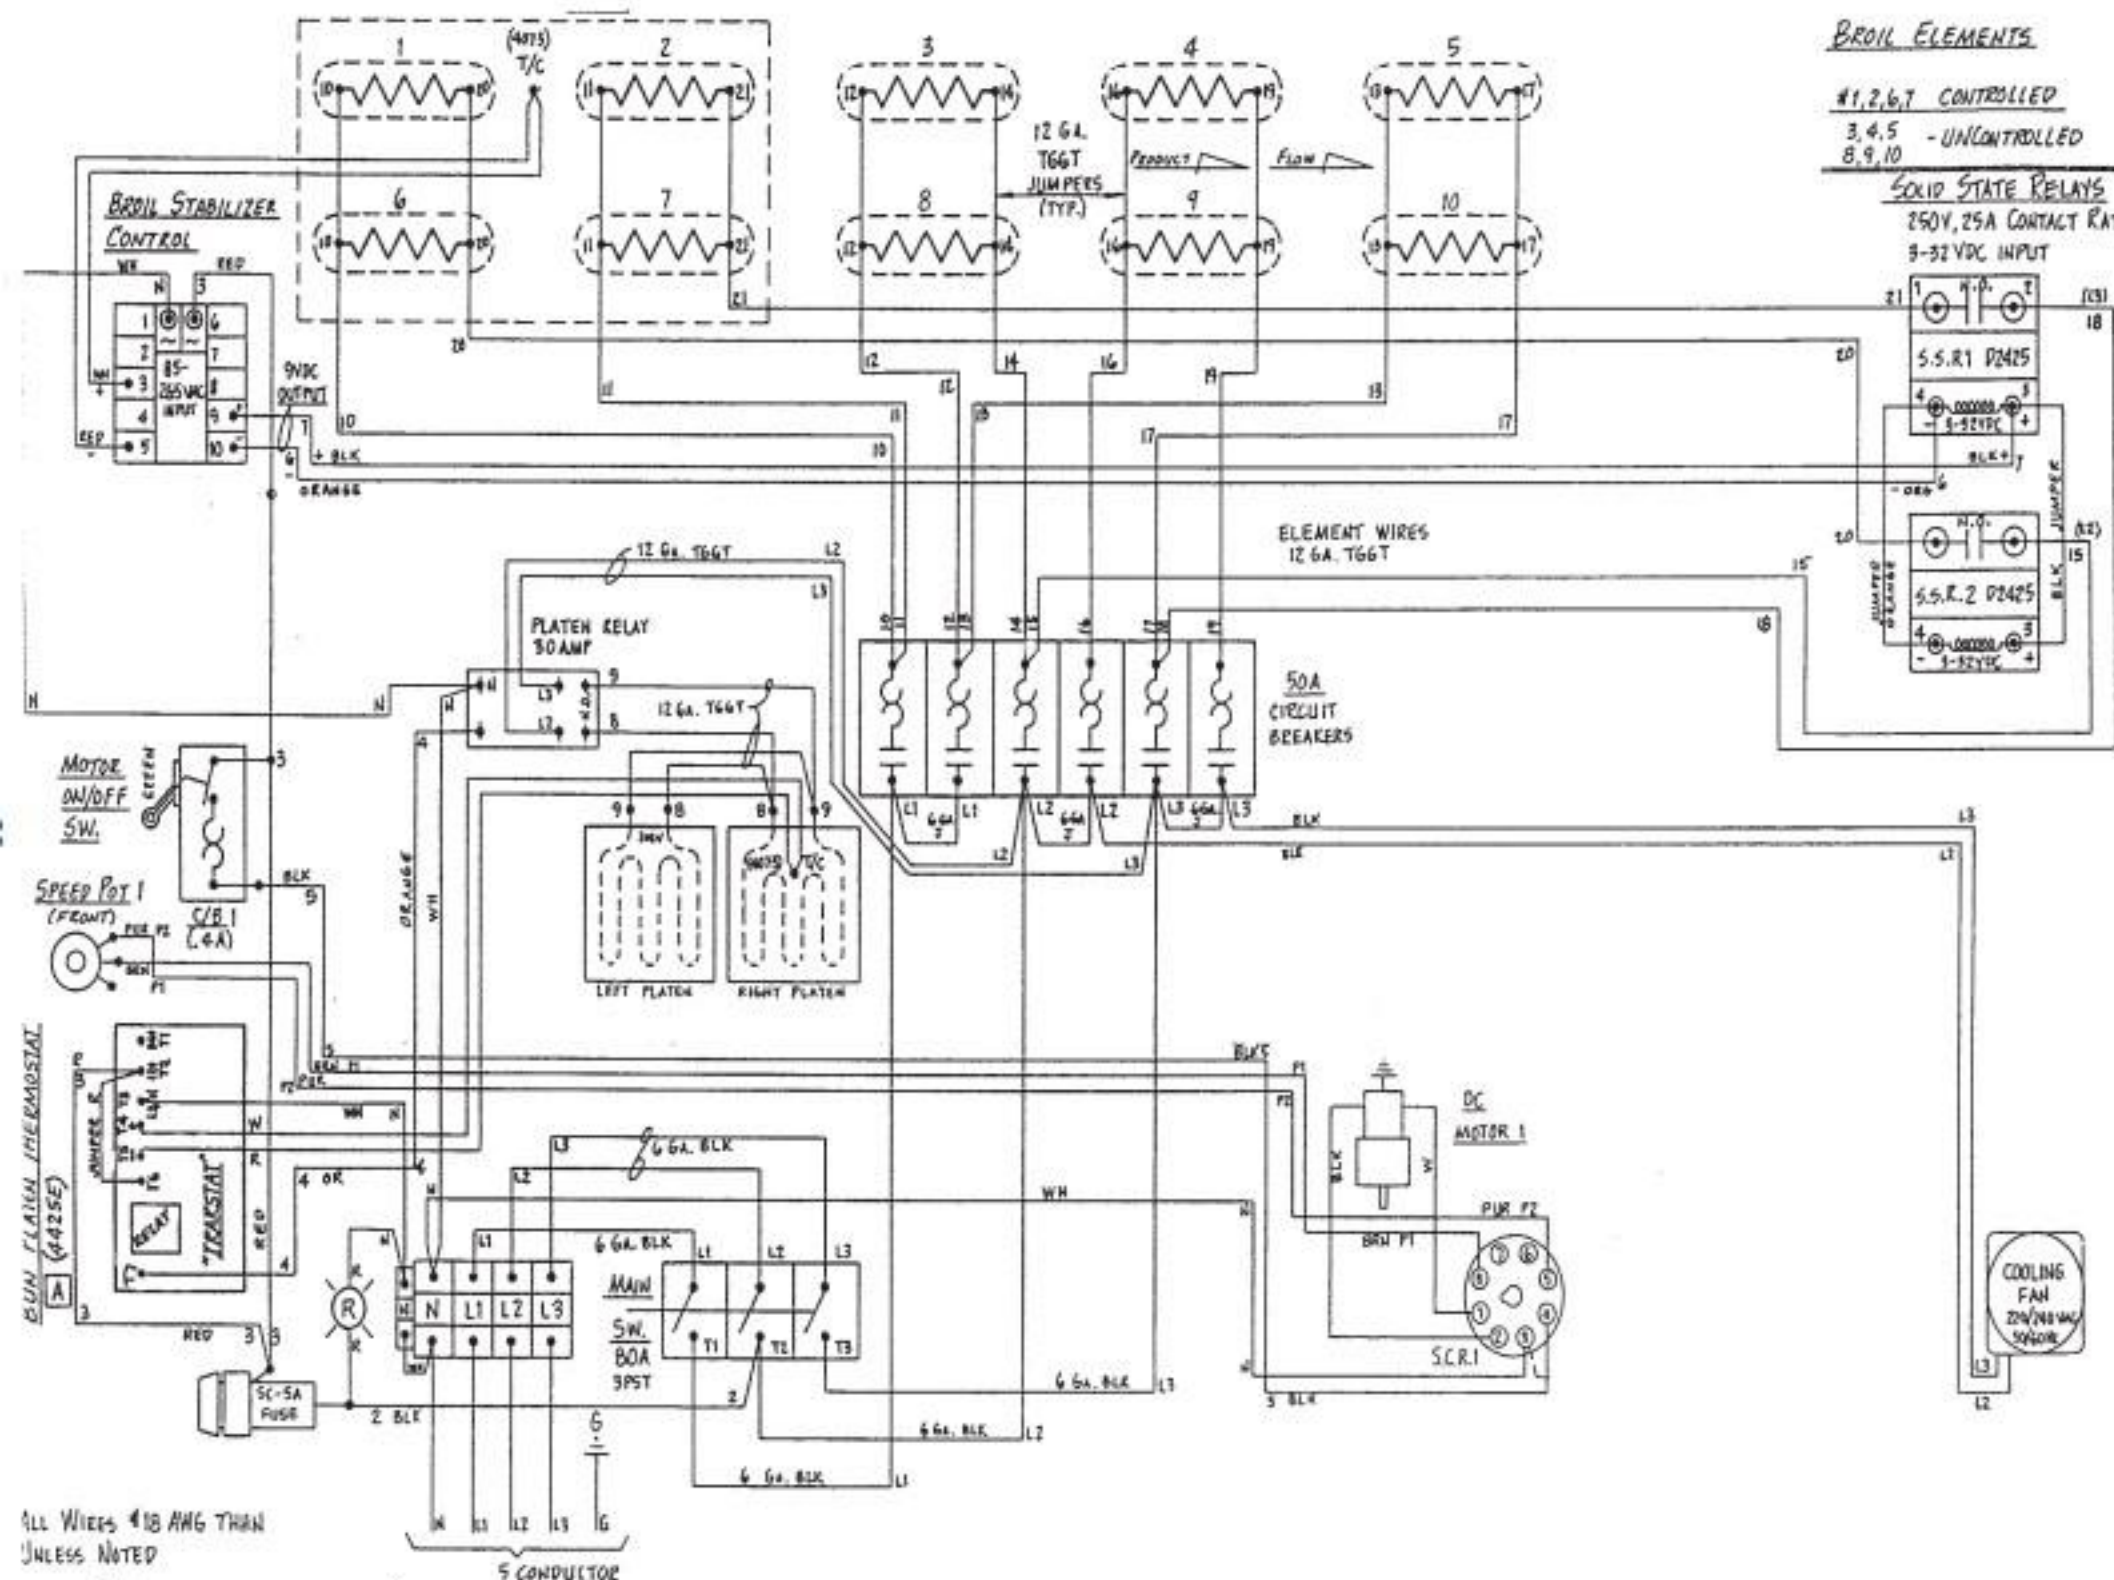

ALL WIRES #18 AWG THAN  
UNLESS NOTED

ELEMENTS  
#4081, 240V, 2200W → 208V 120V, 3 #, 50/60 HZ, 55 A  
#4075, 250V, 2200W → 230V 120V, 3 #, 50/60 HZ, 56 A

A NEW PLATEN THERMOSTAT, WAS P/N 4071-P 11-7-95 102

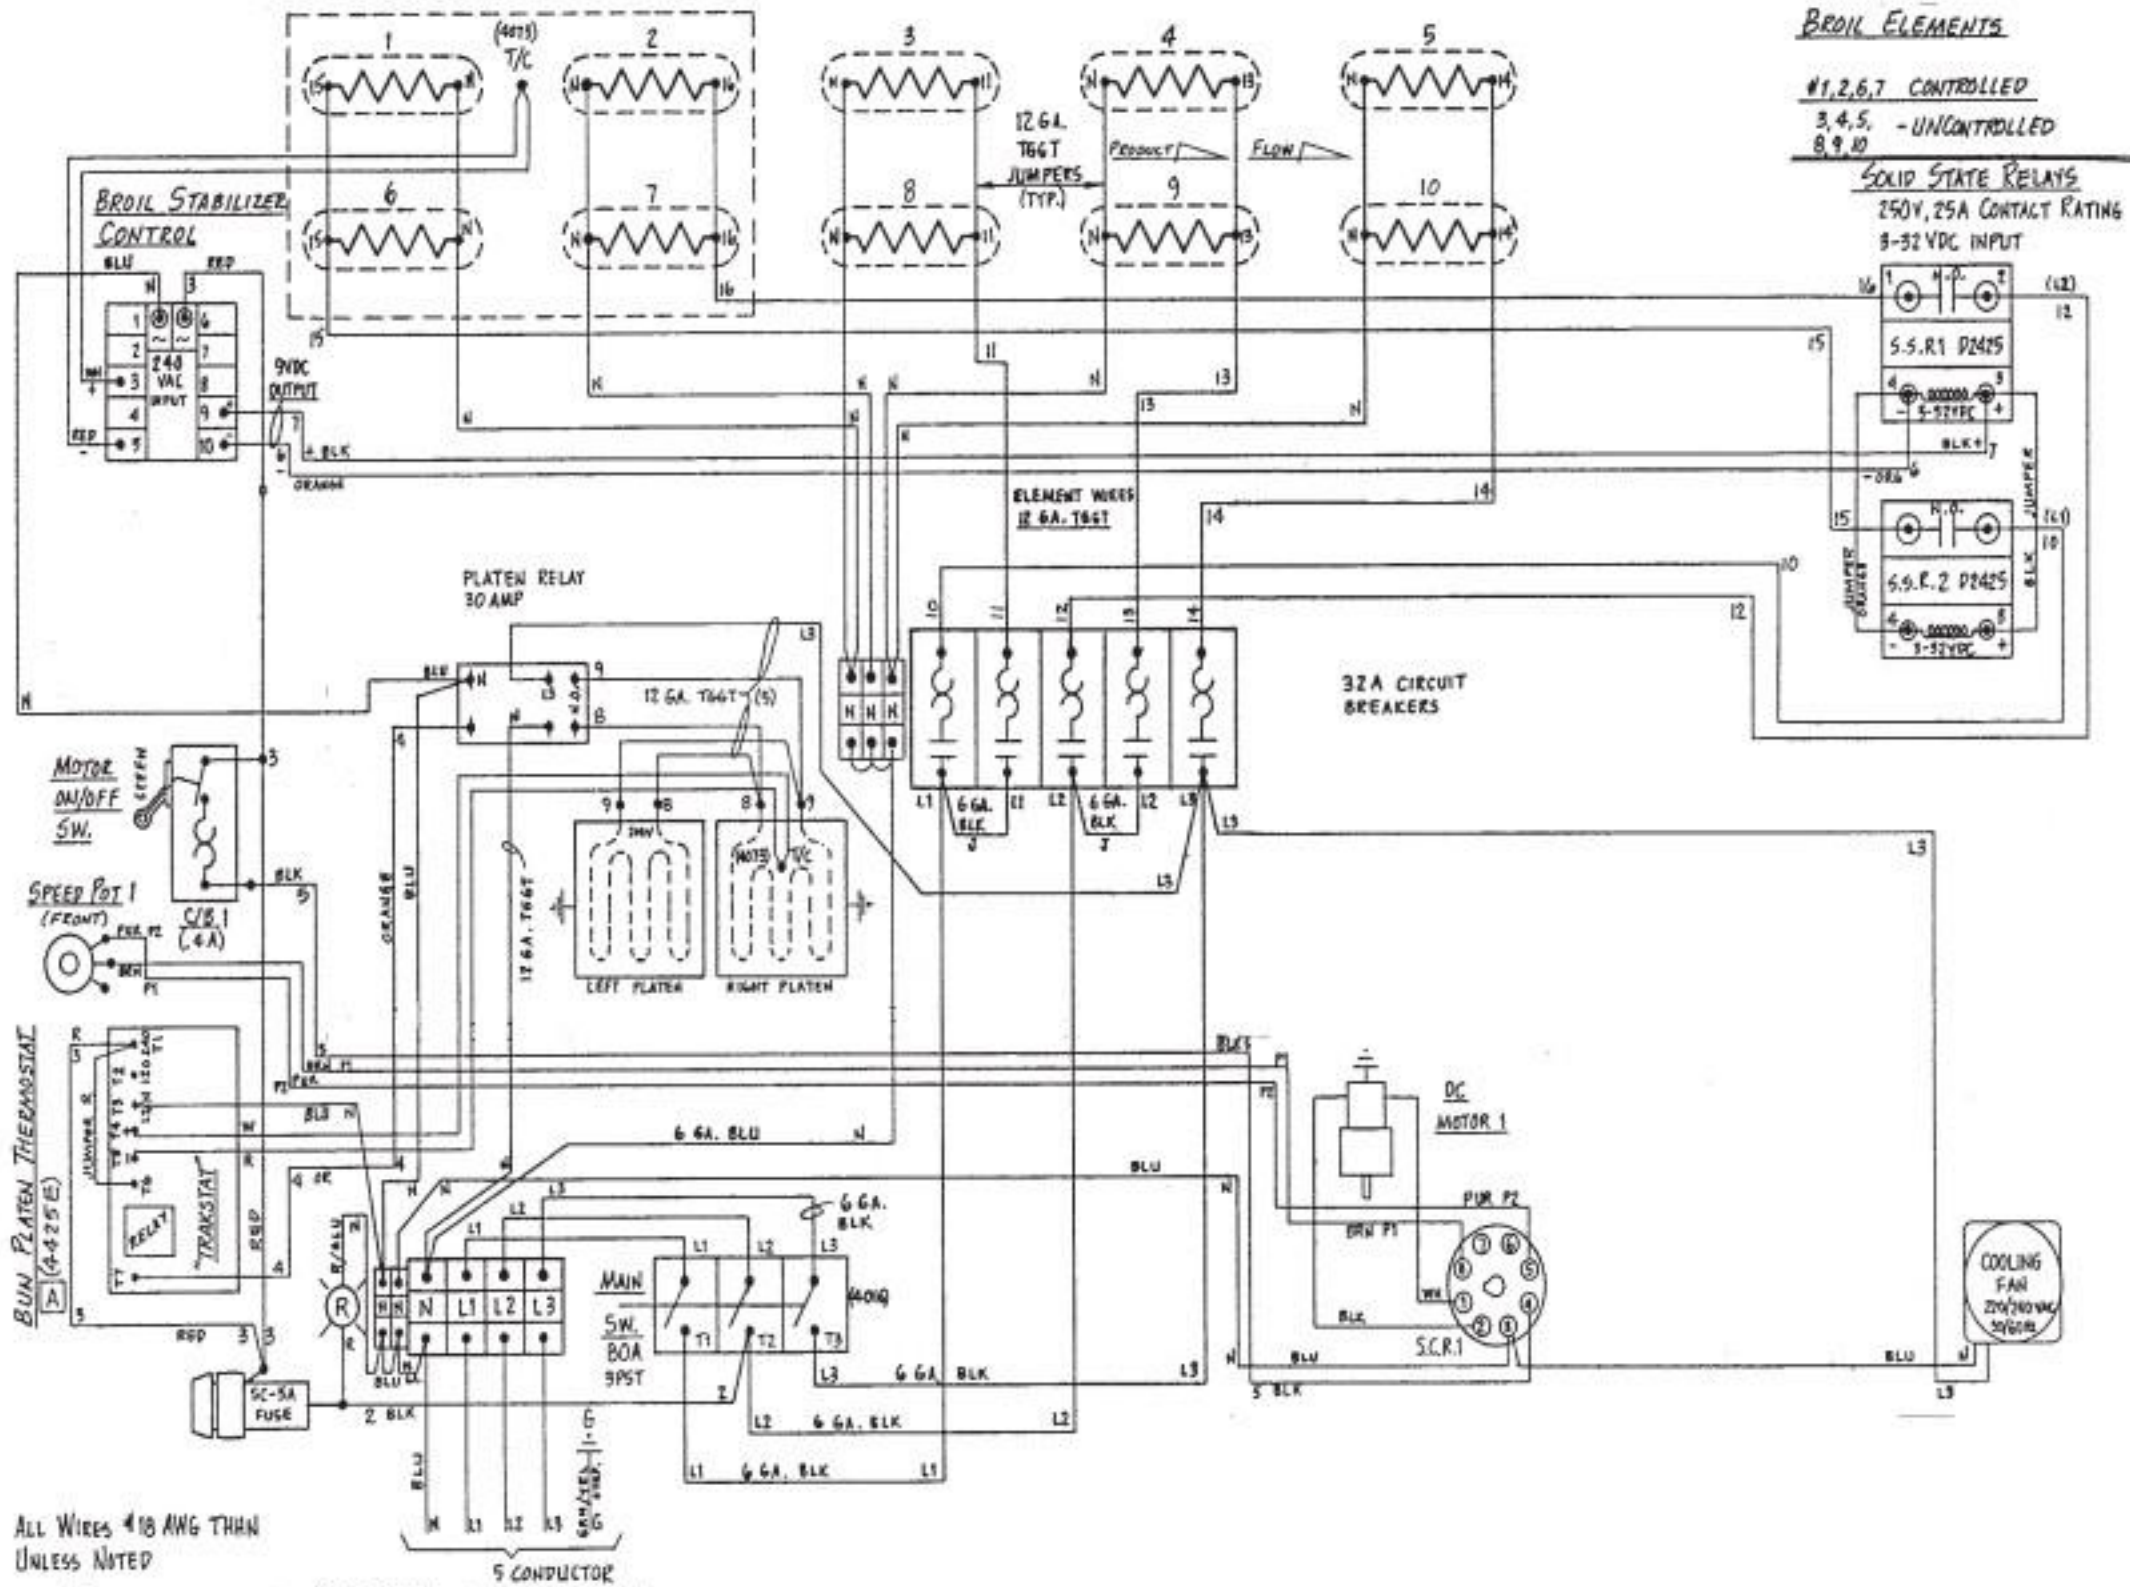

ALL WIRES #18 AWG THIN UNLESS NOTED

5 CONDUCTOR

ELEMENTS  
 44075, 250 V, 2200 W → 380 V/220V, 3 W, 50/60 HZ, 31 A  
 44076, 265 V, 2200 W → 415 V/240V, 3 W, 50/60 HZ, 30 A

A NEW PLATEN THERMOSTAT WAS PIN 4071-P (11-7-95) PZ