


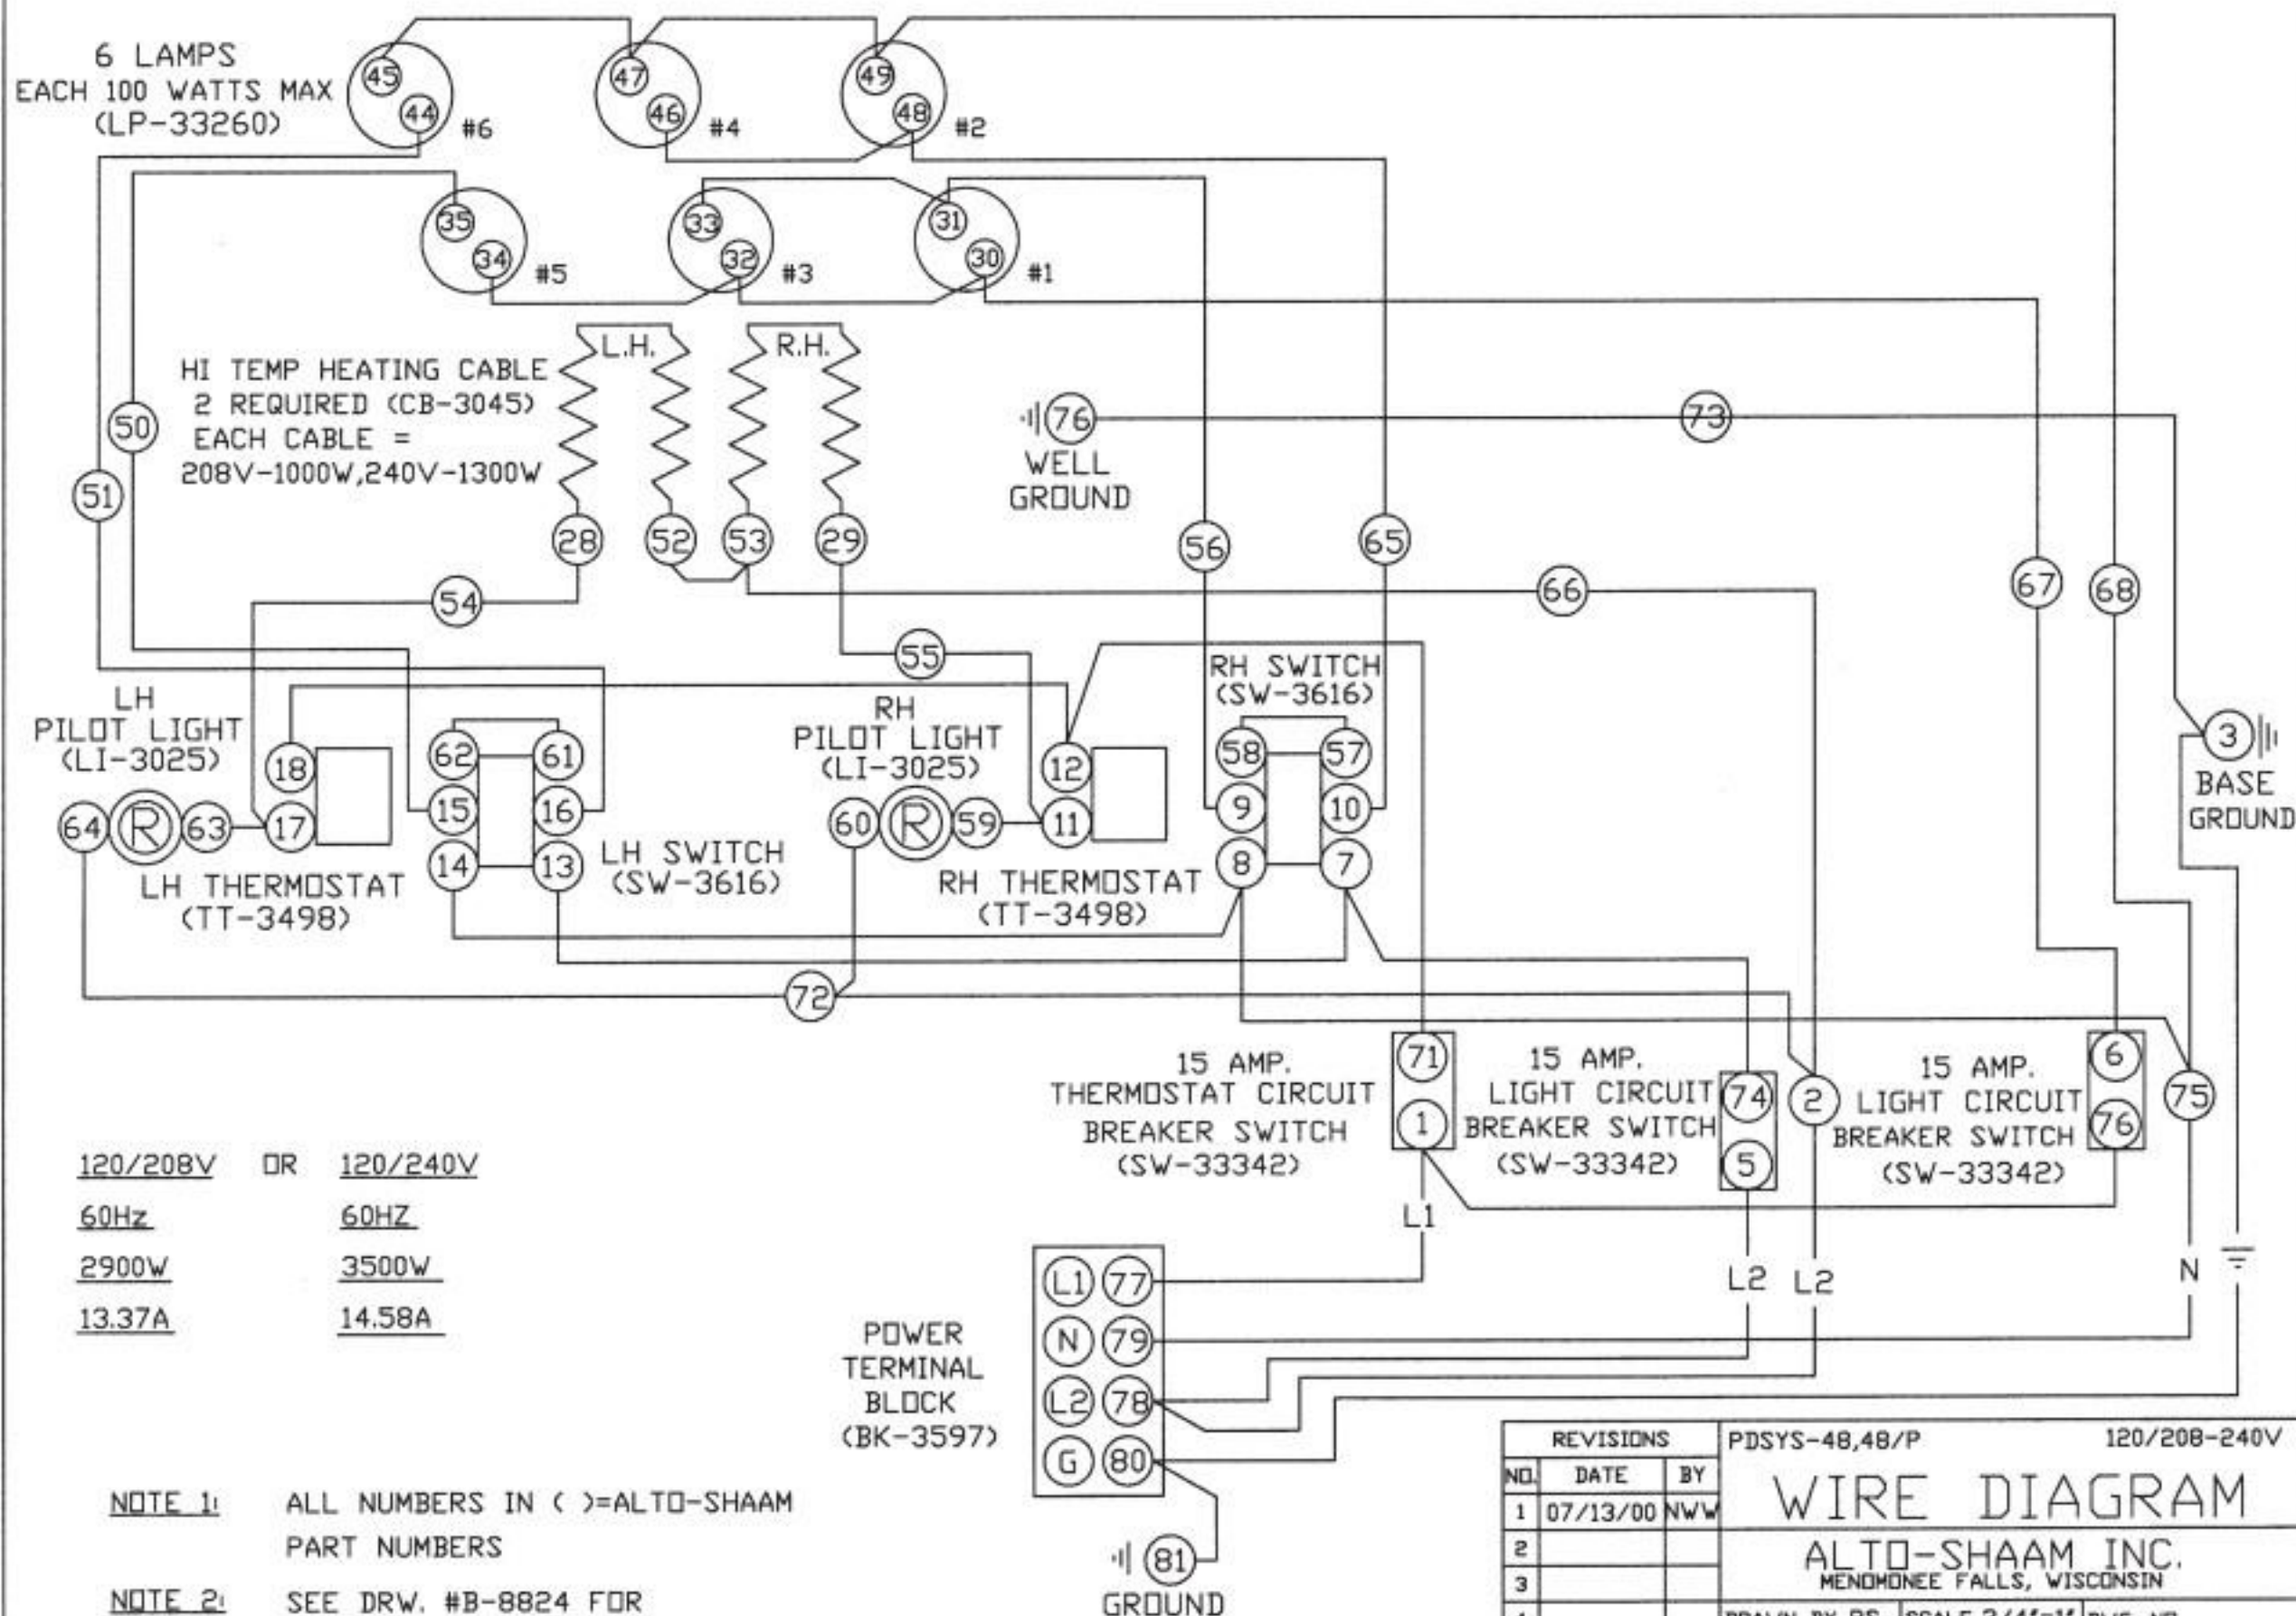


120/208V	OR	120/240V
60Hz		60HZ
2900W		3500W
13.37A		14.58A

REVISIONS			PDSYS-48,48/P		120/208-240V	
NO.	DATE	BY	WIRE DIAGRAM			
1	07/13/00	NWW	ALTO-SHAAM INC. MENDONEE FALLS, WISCONSIN			
2						
3						
4			DRAWN BY RS	SCALE 3/4"=1"	DWG. NO.	
5			APP'D JRM	DATE 11/12/97	A-7469	

10 LAMPS TYP.
EACH 100 WATTS
(LP-33253)

(OPTIONAL) 10 LAMPS
EACH 150 WATTS MAX


HI TEMP HEATING CABLE
3 REQUIRED (CB-3045)
EACH CABLE =
208V-1000W, 240V=1300W

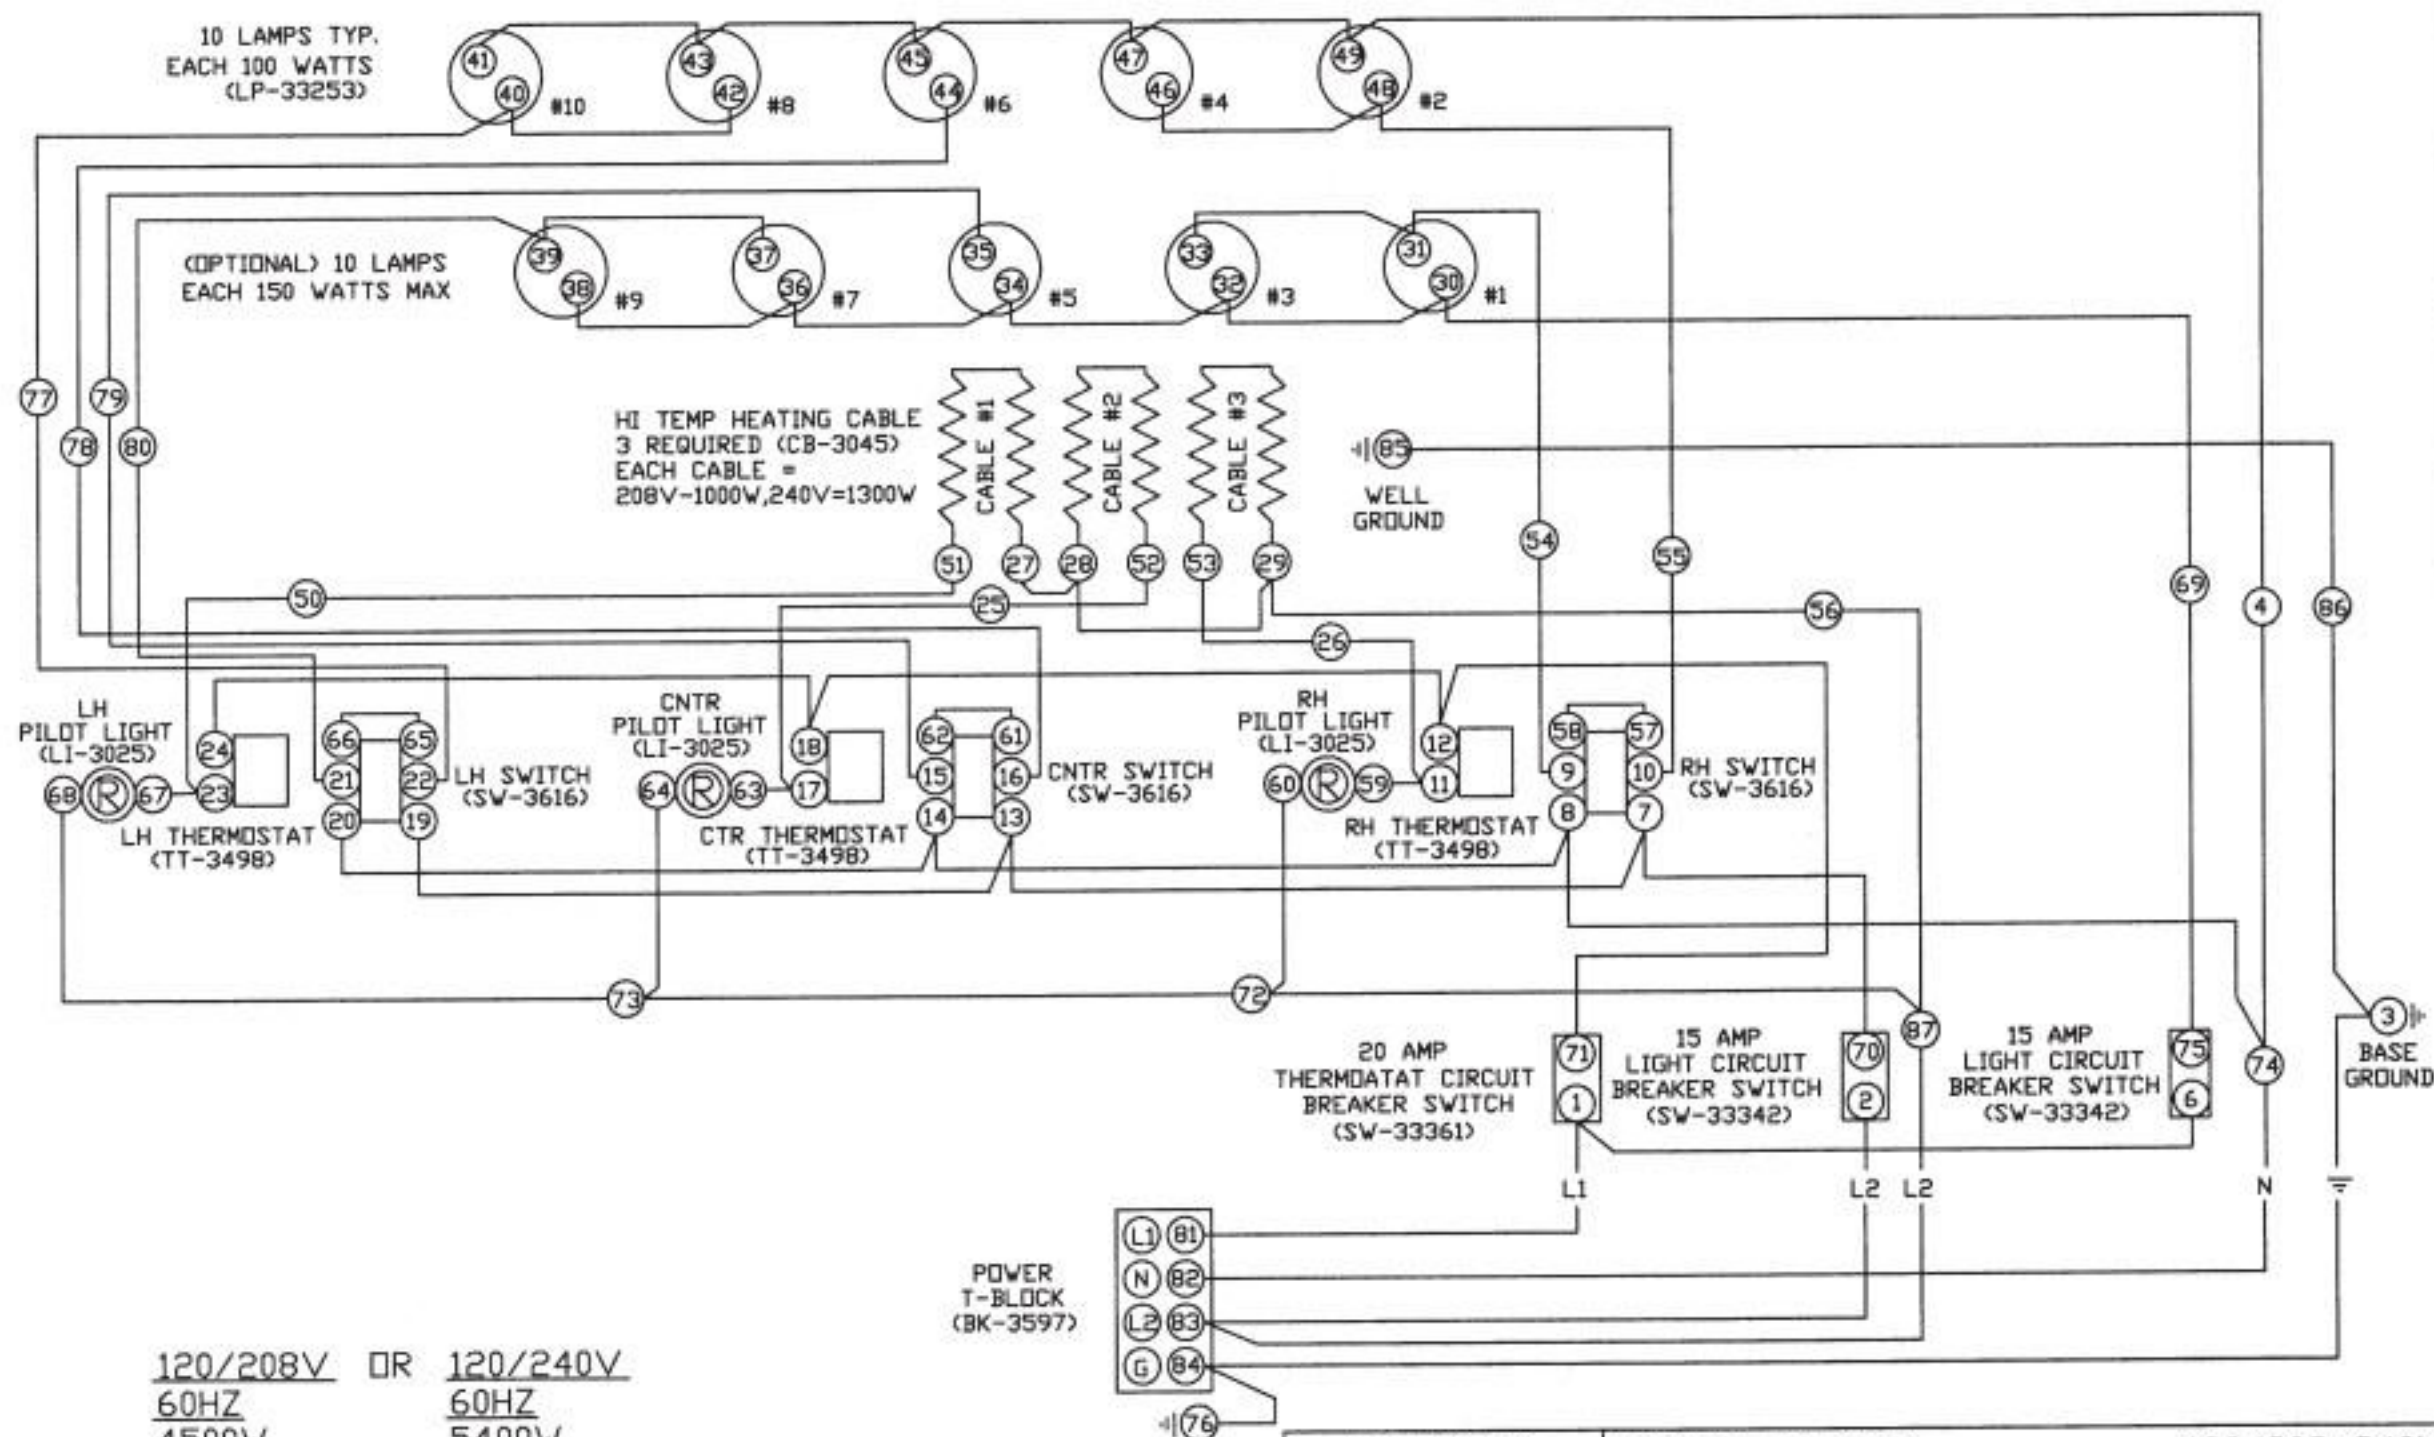

120/208V OR 120/240V
60HZ 60HZ
4500W 5400W
21.0A 22.50A


NOTE #1: ALL NUMBERS IN () = ALTO-SHAAM PART NO'S
NOTE #2: SEE DRW. #B-8825 FOR WIRE ASSEMBLIES

REVISIONS			PDSYS-72,72/P		120/208-240V
NO.	DATE	BY	WIRING DIAGRAM		
1	10/10/02	DDF	ALTO-SHAAM INC. MENDOTA FALLS, WISCONSIN		
2					
3					
4			DRAWN BY RS	SCALE 1/2"=1'	DWG. NO.
5			APP'D AHL	DATE 11/13/97	A-7470

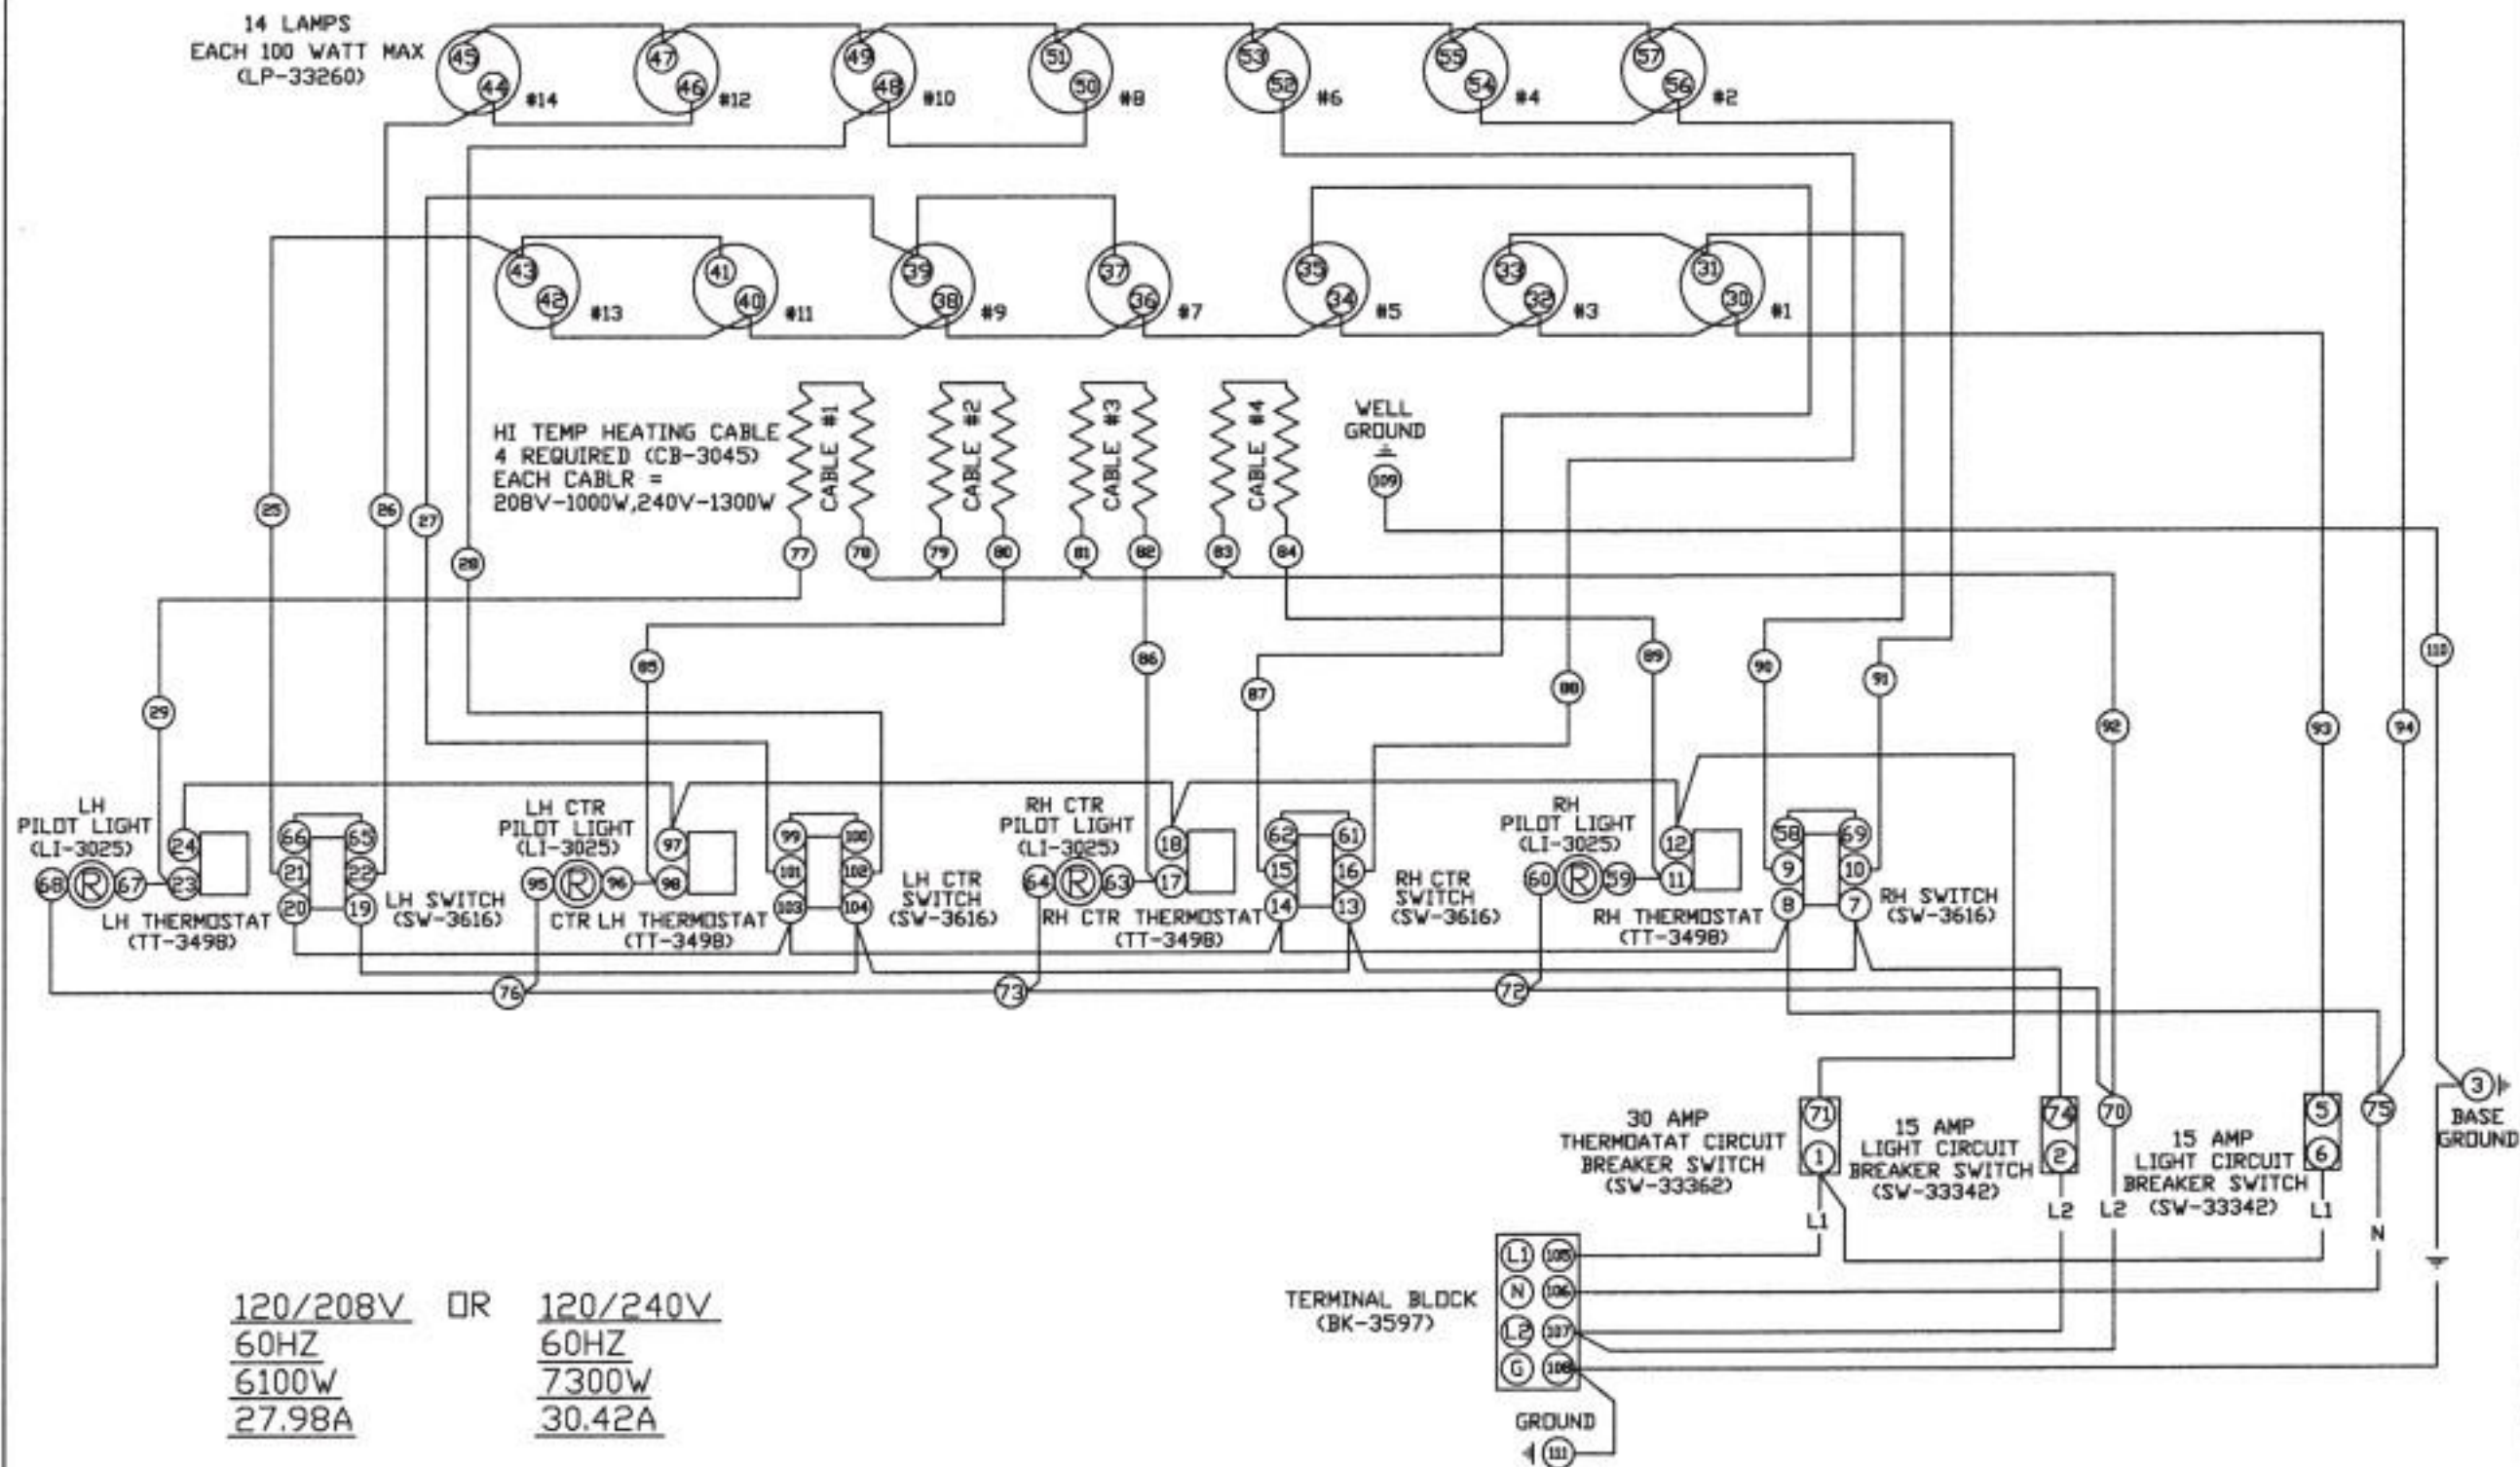

NOTE #1: ALL NUMBERS IN () = ALTO-SHAAM PART NO'S
NOTE #2: SEE DRW. #B-8826 FOR WIRE ASSEMBLIES

REVISIONS			PDSYS-96	120/208-240V	
NO.	DATE	BY	WIRING DIAGRAM		
1			ALTO-SHAAM INC. MENDOMONEE FALLS, WISCONSIN		
2					
3					
4			DRAWN BY RS	SCALE 1/4"=1'	DWG. NO.
5			APP'D AHL	DATE 11/13/97	A-7471

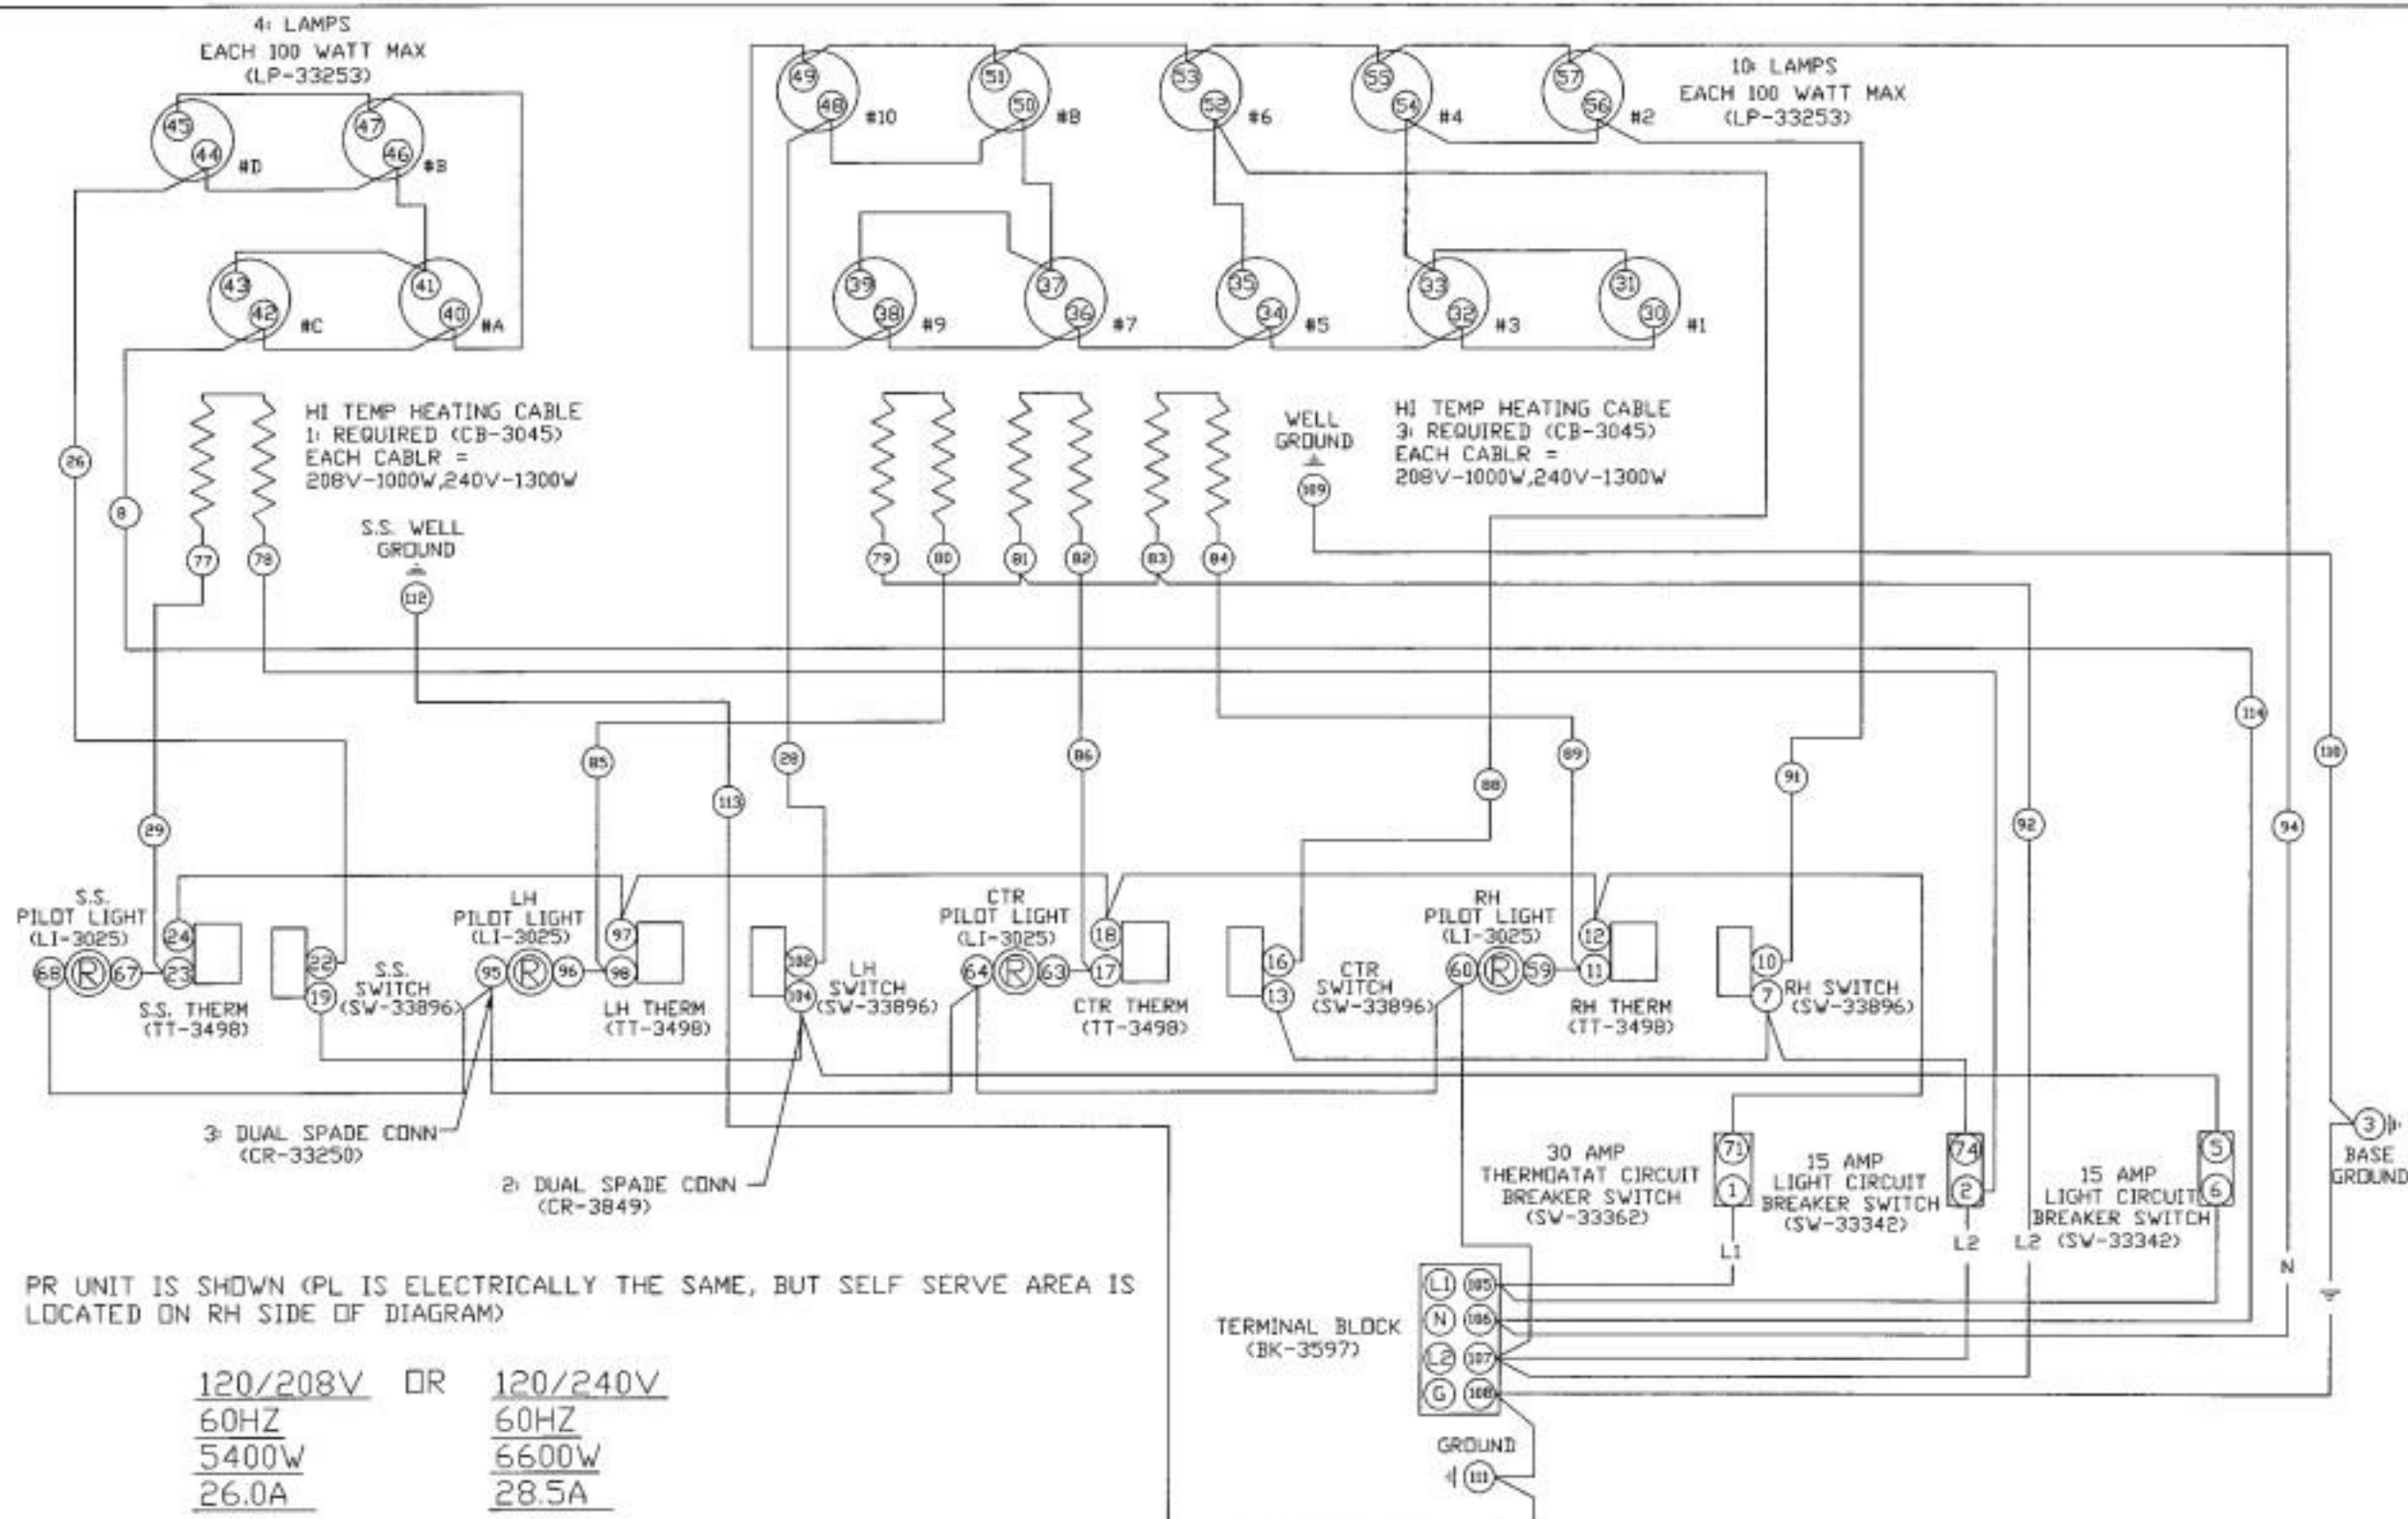

NOTE #1: ALL NUMBERS IN () = ALTO-SHAAM PART NO'S

NOTE #2: SEE DRW. #B-8826 FOR WIRE ASSEMBLIES

REVISIONS			PDSYS-96/PL,PR 120/208-240V	
NO.	DATE	BY	WIRING DIAGRAM	
1			ALTO-SHAAM INC. MENDOTA FALLS, WISCONSIN	
2				
3				
4			DRAWN BY AHL	SCALE 1/4"=1" DWG. NO.
5			APP'D DDF	DATE 10/13/03 A-7675