ELECTRICAL

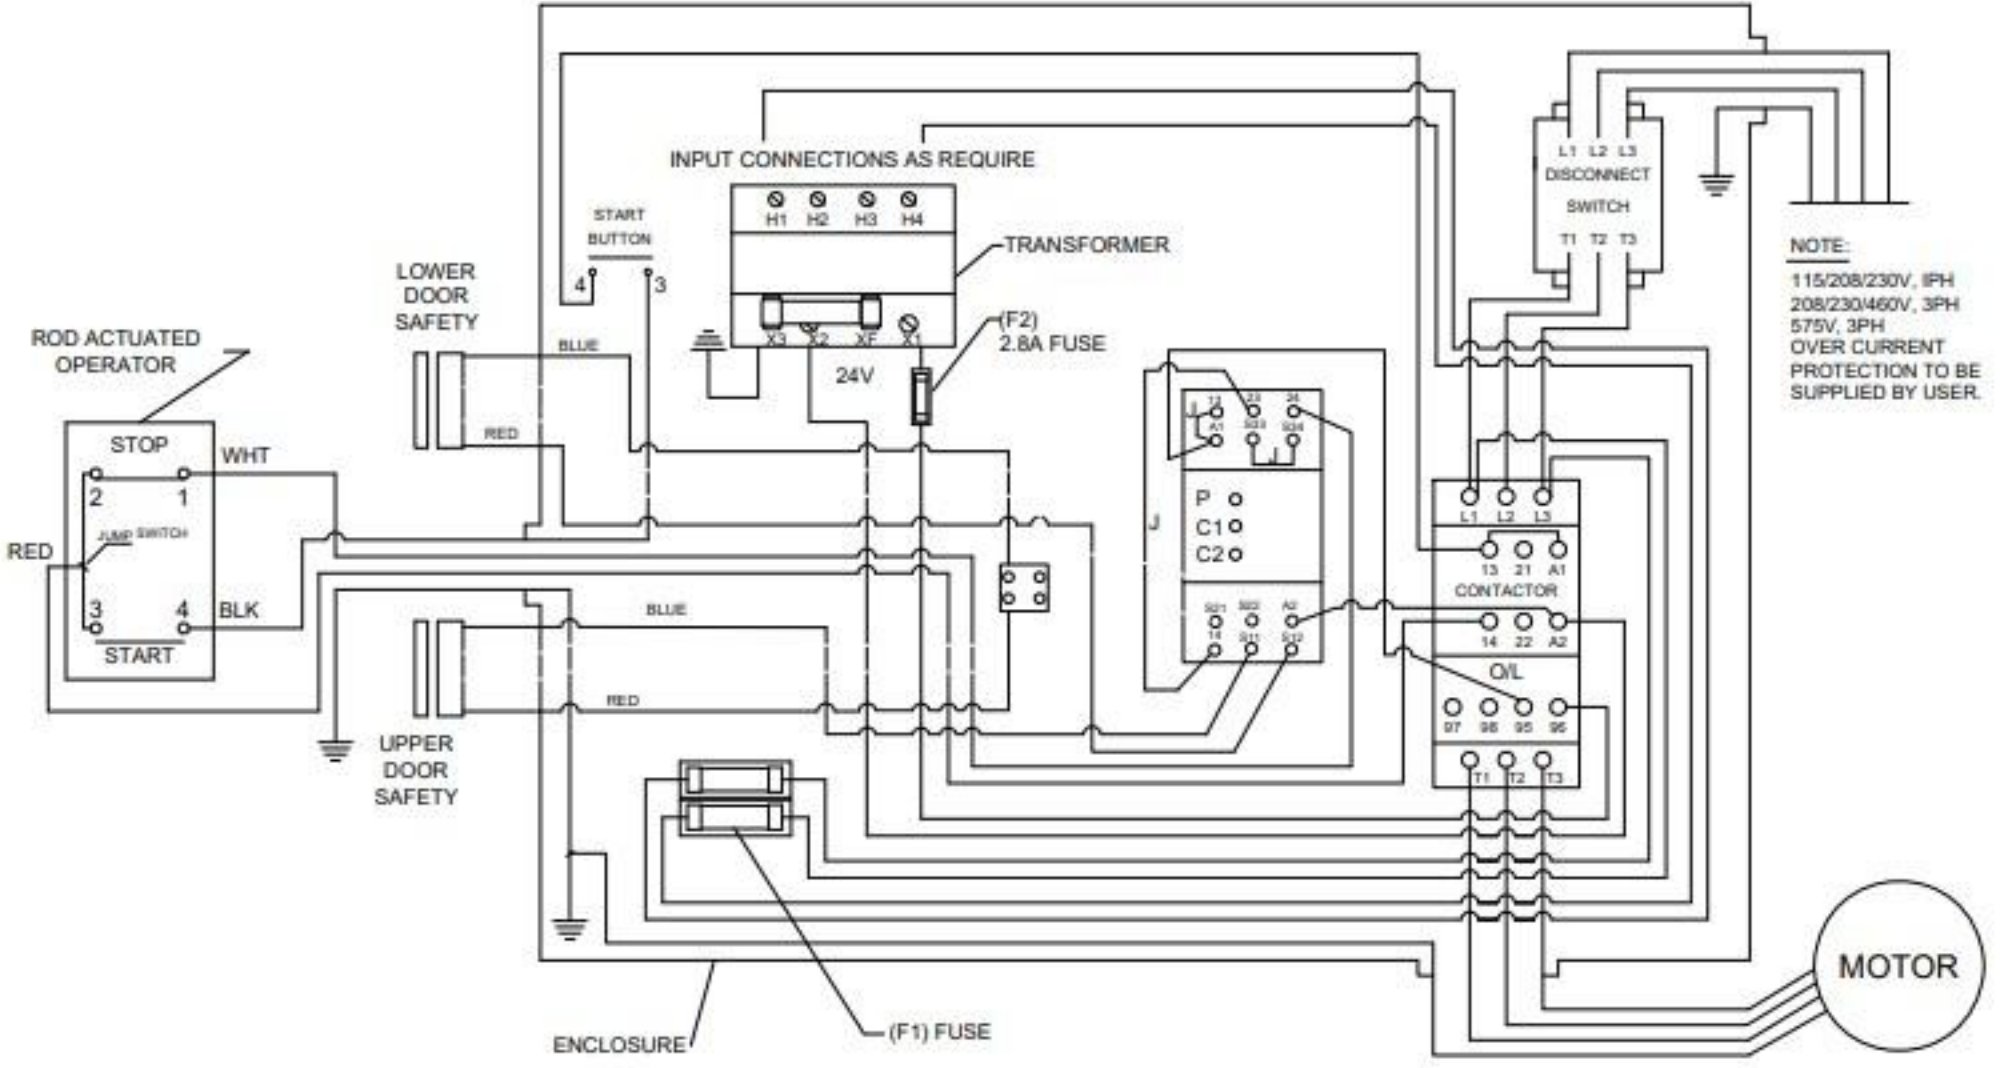
INPUT CONNECTIONS AS REQUIRE
H1 H2 H3 H4
TRANSFORMER
START BUTTON
4
3
LOWER DOOR SAFETY
ROD ACTUATED OPERATOR
STOP
WHT
2
1
JUMP SWITCH
RED
3
4
BLK
START
BLUE
RED
X3 X2 XF X1
24V
(F2) 2.8A FUSE
P
C1
C2
J
L1 L2 L3
DISCONNECT SWITCH
T1 T2 T3
NOTE:
115/208/230V, IPH
208/230/460V, 3PH
575V, 3PH
OVER CURRENT PROTECTION TO BE SUPPLIED BY USER.
L1 L2 L3
13 21 A1
CONTACTOR
14 22 A2
O/L
97 98 95 96
T1 T2 T3
BLUE
RED
UPPER DOOR SAFETY
ENCLOSURE
(F1) FUSE
MOTOR