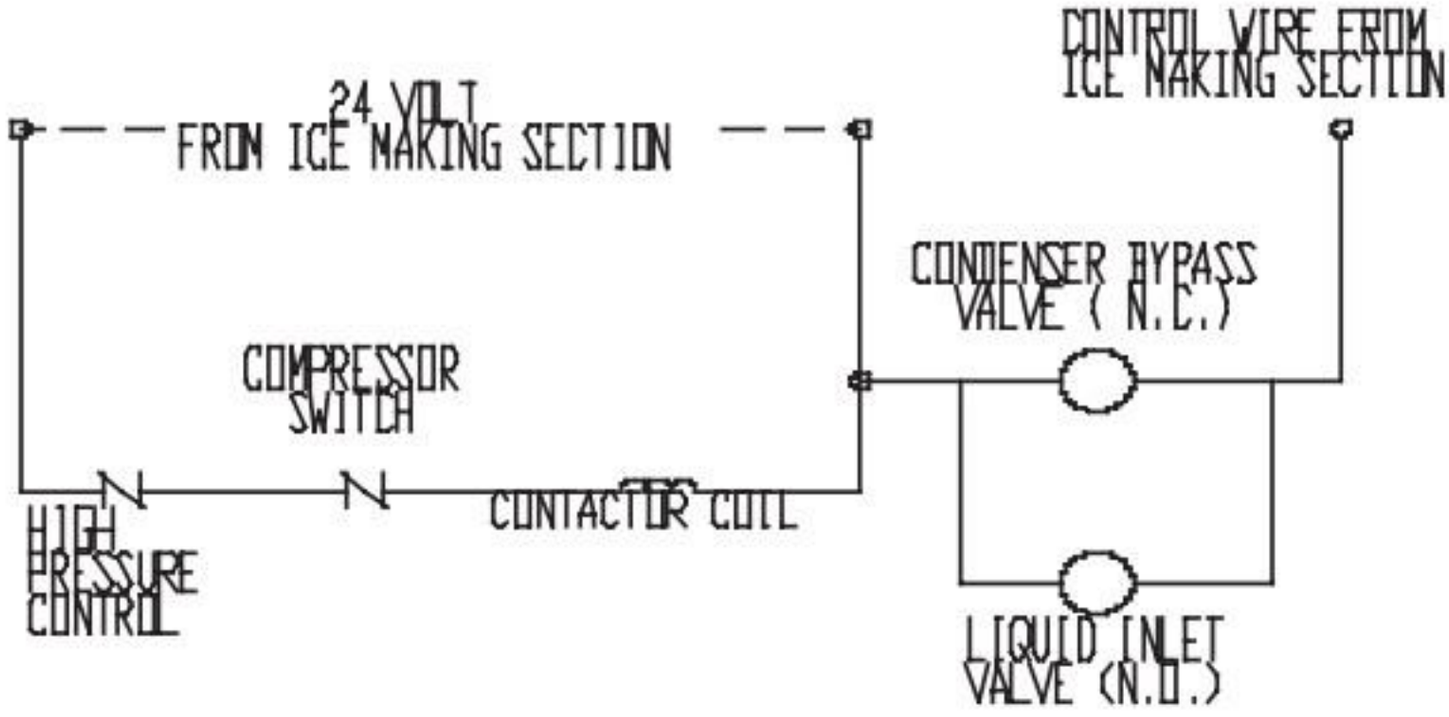
CONTROL WIRE FROM
ICE MAKING SECTION
24 VOLT
FROM ICE MAKING SECTION
CONDENSER BYPASS
VALVE (N.C.)
COMPRESSOR
SWITCH
HIGH
PRESSURE
CONTROL
CONTACTOR COIL
LIQUID INLET
VALVE (N.O.)

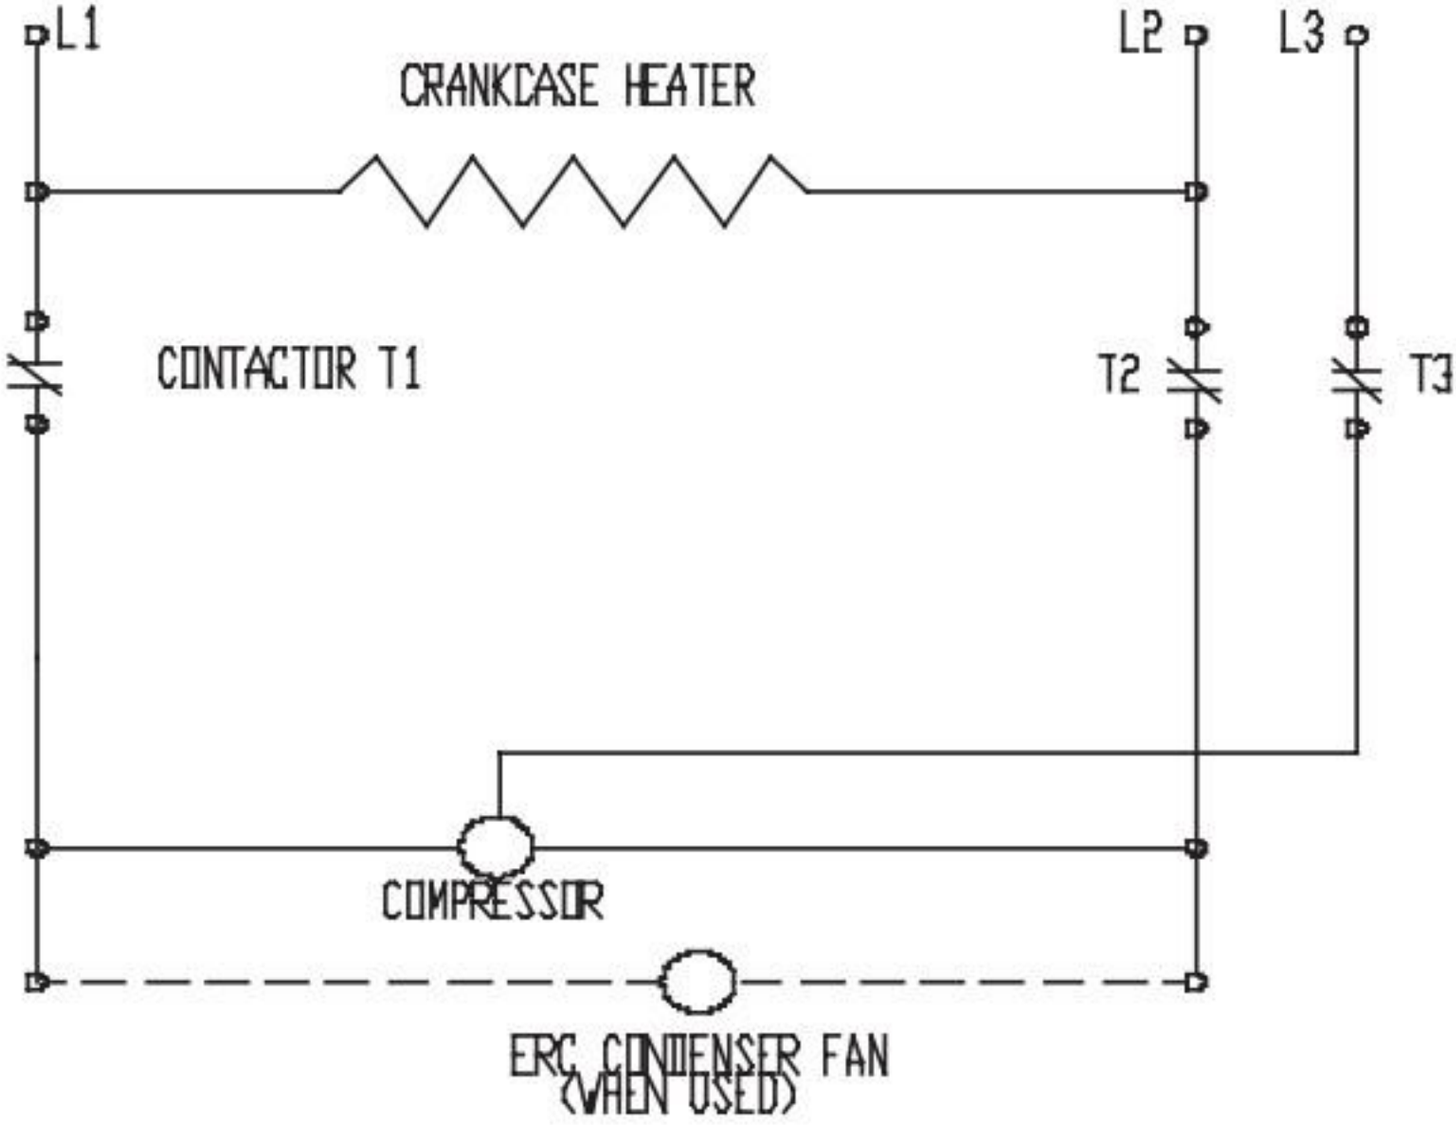
L1
L2
L3
CRANKCASE HEATER
CONTACTOR T1
T2
T3
COMPRESSOR
ERC CONDENSER FAN
(WHEN USED)

17-2878-01

USE COPPER CONDUCTORS ONLY

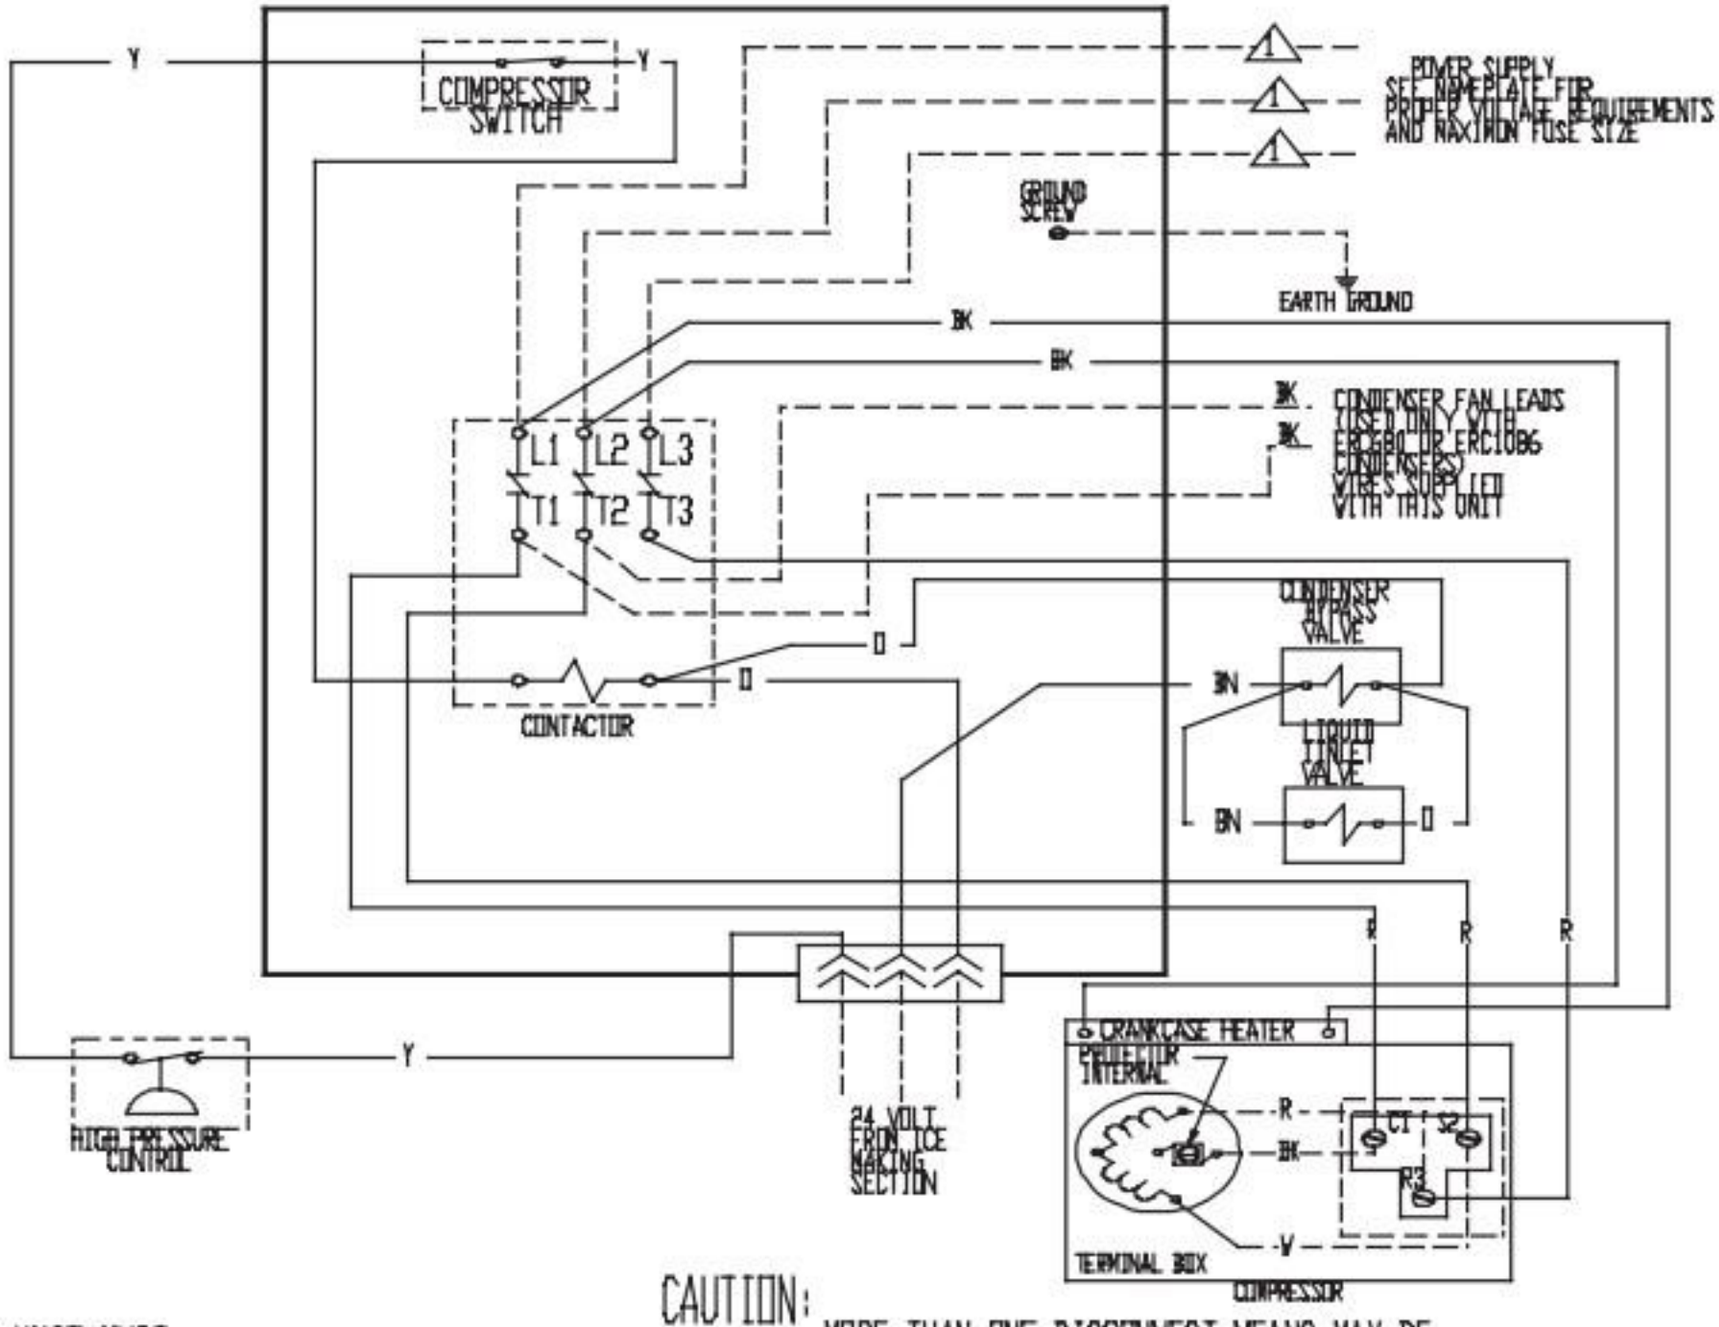

THIS UNIT MUST BE GROUNDED.

CAUTION:

MORE THAN ONE DISCONNECT MEANS MAY BE REQUIRED TO DISCONNECT ALL POWER TO THIS UNIT.

⚠1 DASHED LINES INDICATE FIELD WIRING WHICH MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL STATE AND LOCAL CODES.

17-2877-01

USE COPPER CONDUCTORS ONLY

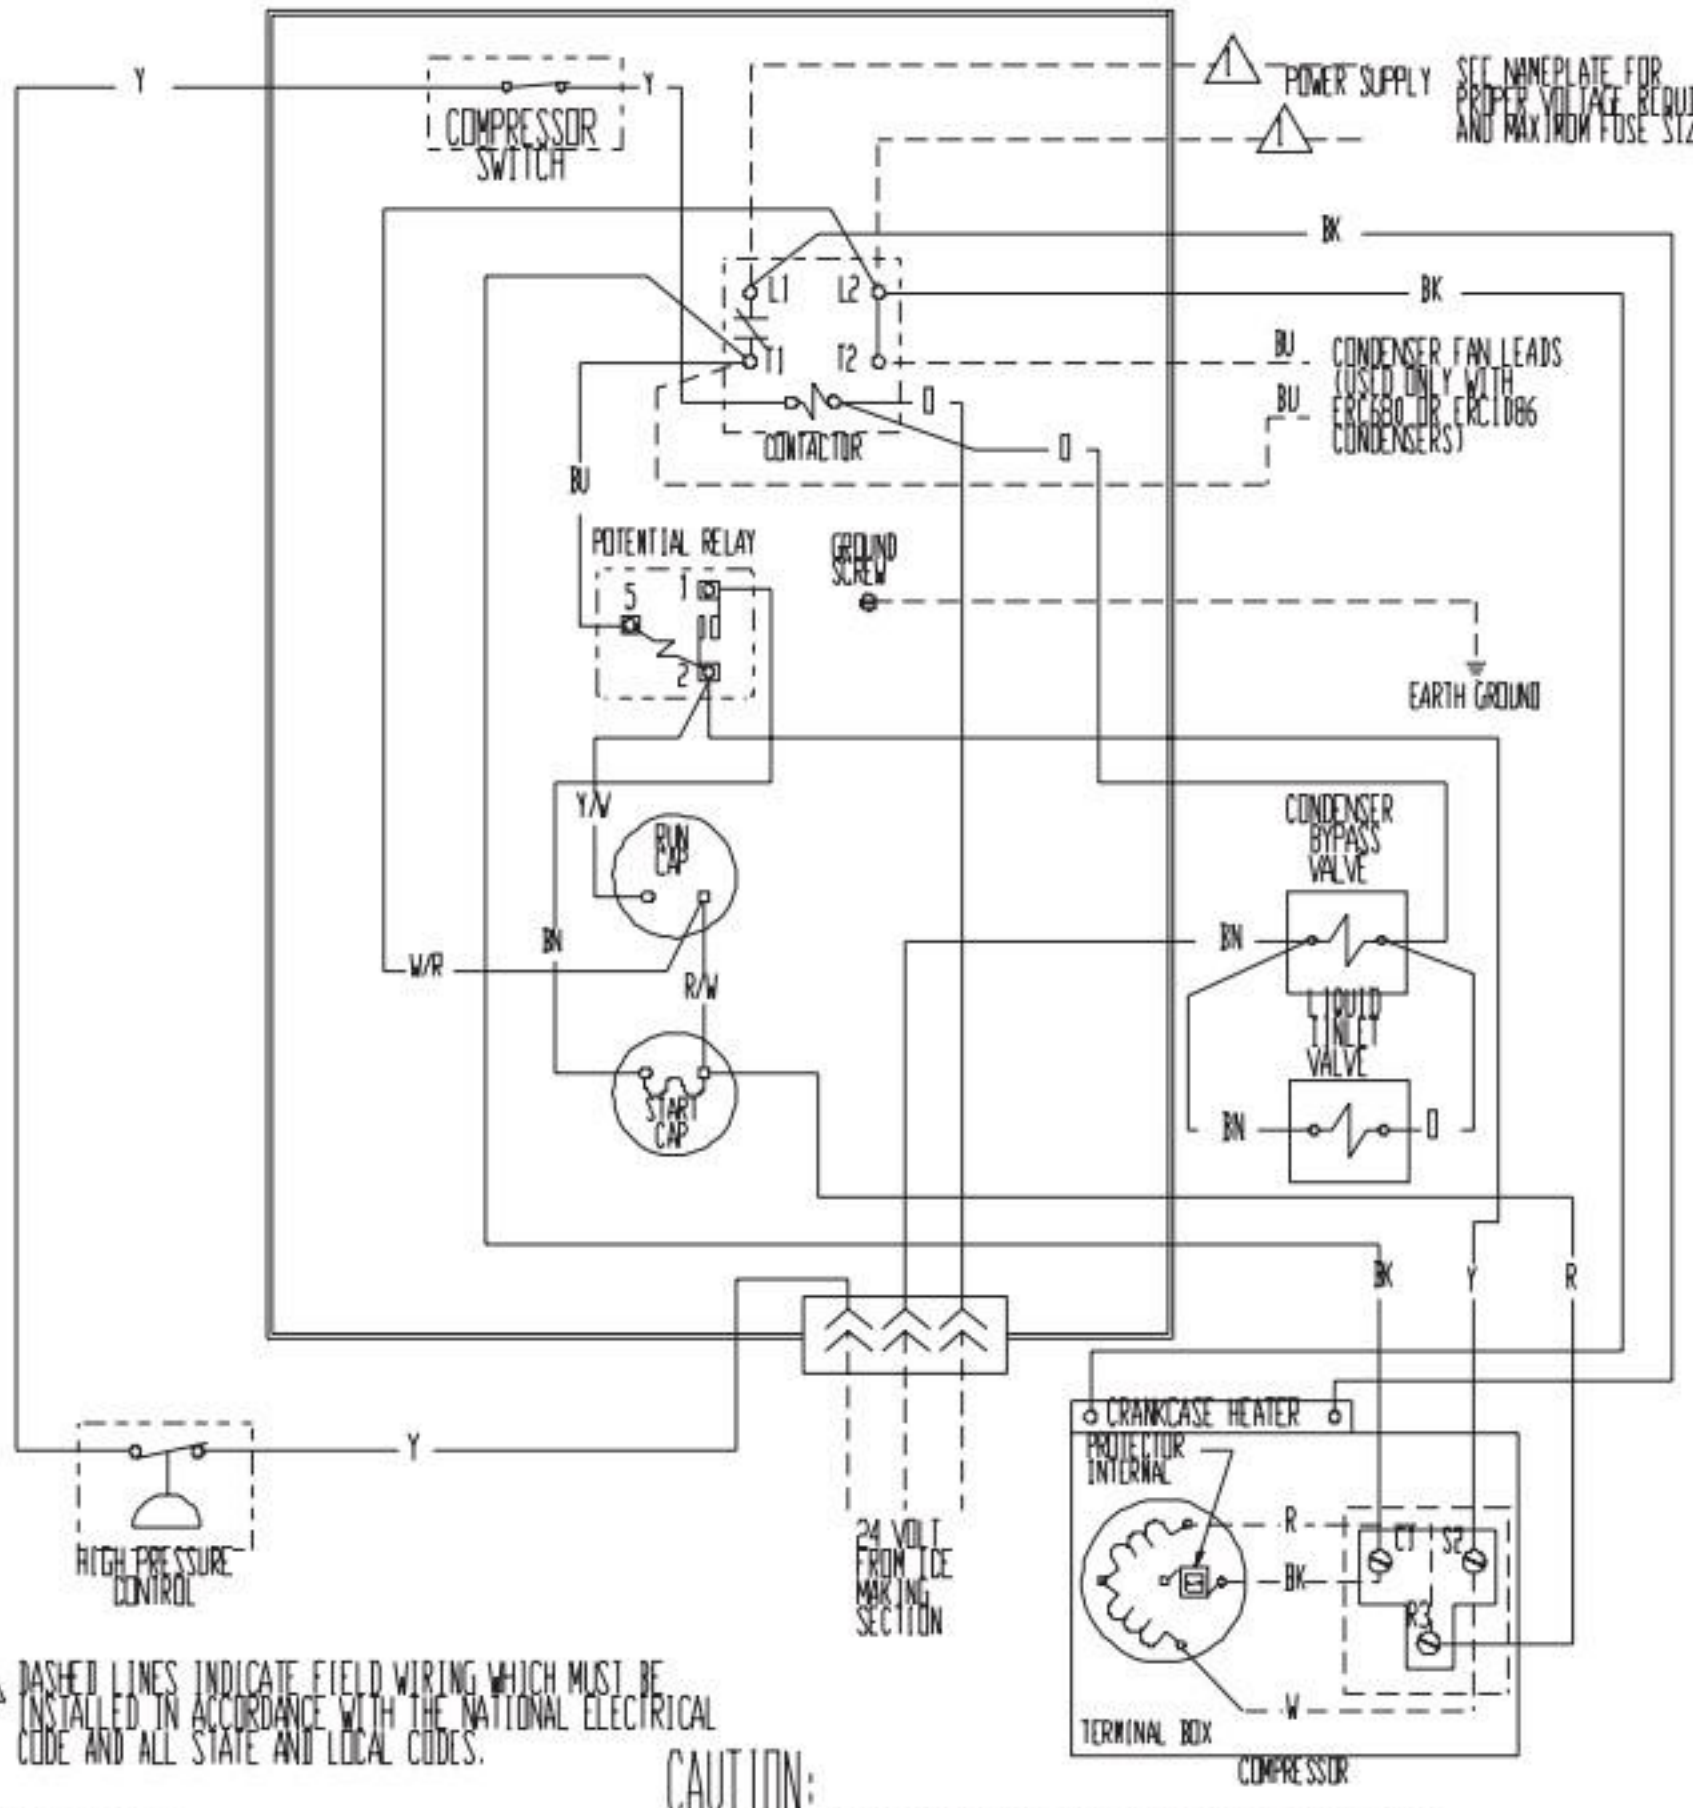

⚠ DASHED LINES INDICATE FIELD WIRING WHICH MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL STATE AND LOCAL CODES.

THIS UNIT MUST BE GROUNDED.

CAUTION:

MORE THAN ONE DISCONNECT MEANS MAY BE REQUIRED TO DISCONNECT ALL POWER TO THIS UNIT.

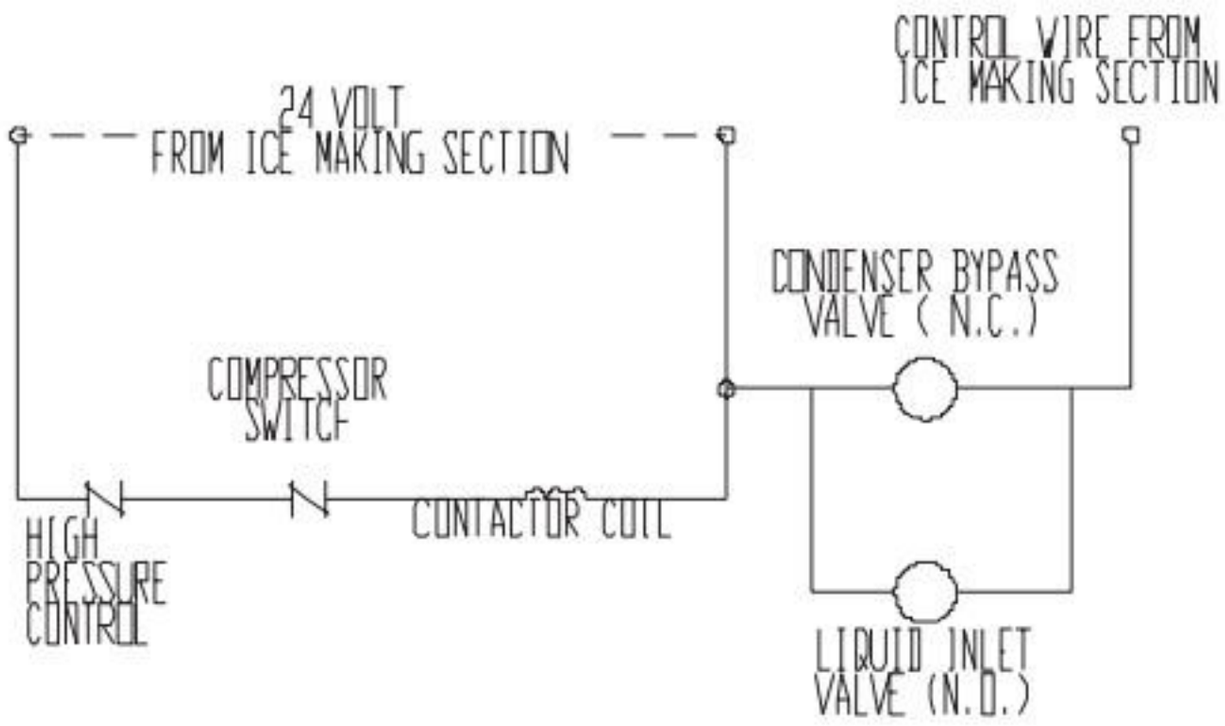
CONTROL WIRE FROM
ICE MAKING SECTION
24 VOLT
FROM ICE MAKING SECTION
CONDENSER BYPASS
VALVE (N.C.)
COMPRESSOR
SWITCH
CONTACTOR COIL
HIGH
PRESSURE
CONTROL
LIQUID INLET
VALVE (N.O.)

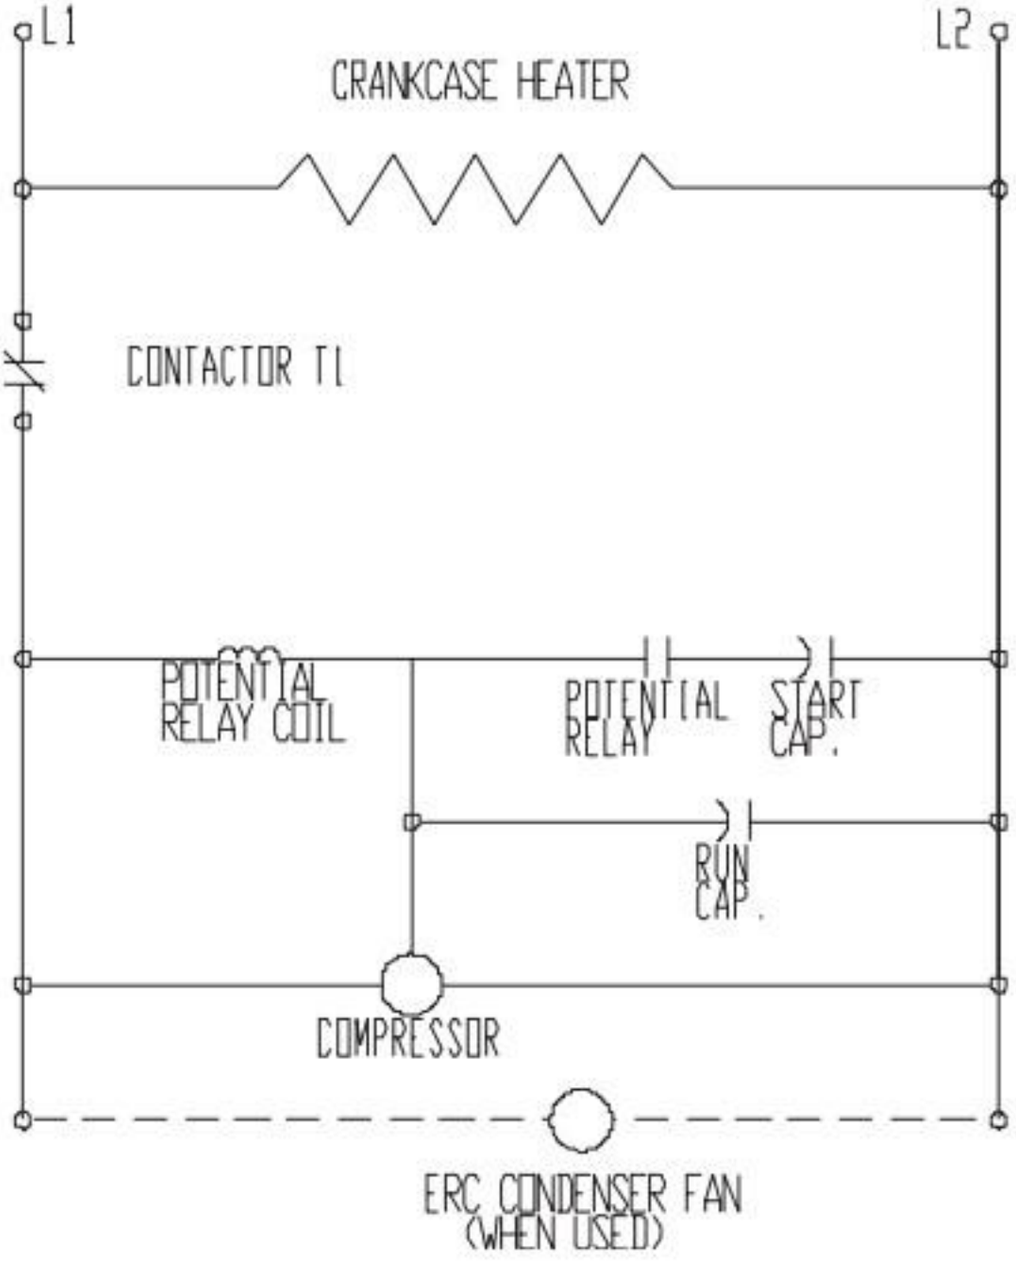
L1
L2
CRANKCASE HEATER
CONTACTOR T1
POTENTIAL
RELAY COIL
POTENTIAL
RELAY
START
CAP.
RUN
CAP.
COMPRESSOR
ERC CONDENSER FAN
(WHEN USED)

17-2890-01

USE COPPER CONDUCTORS ONLY

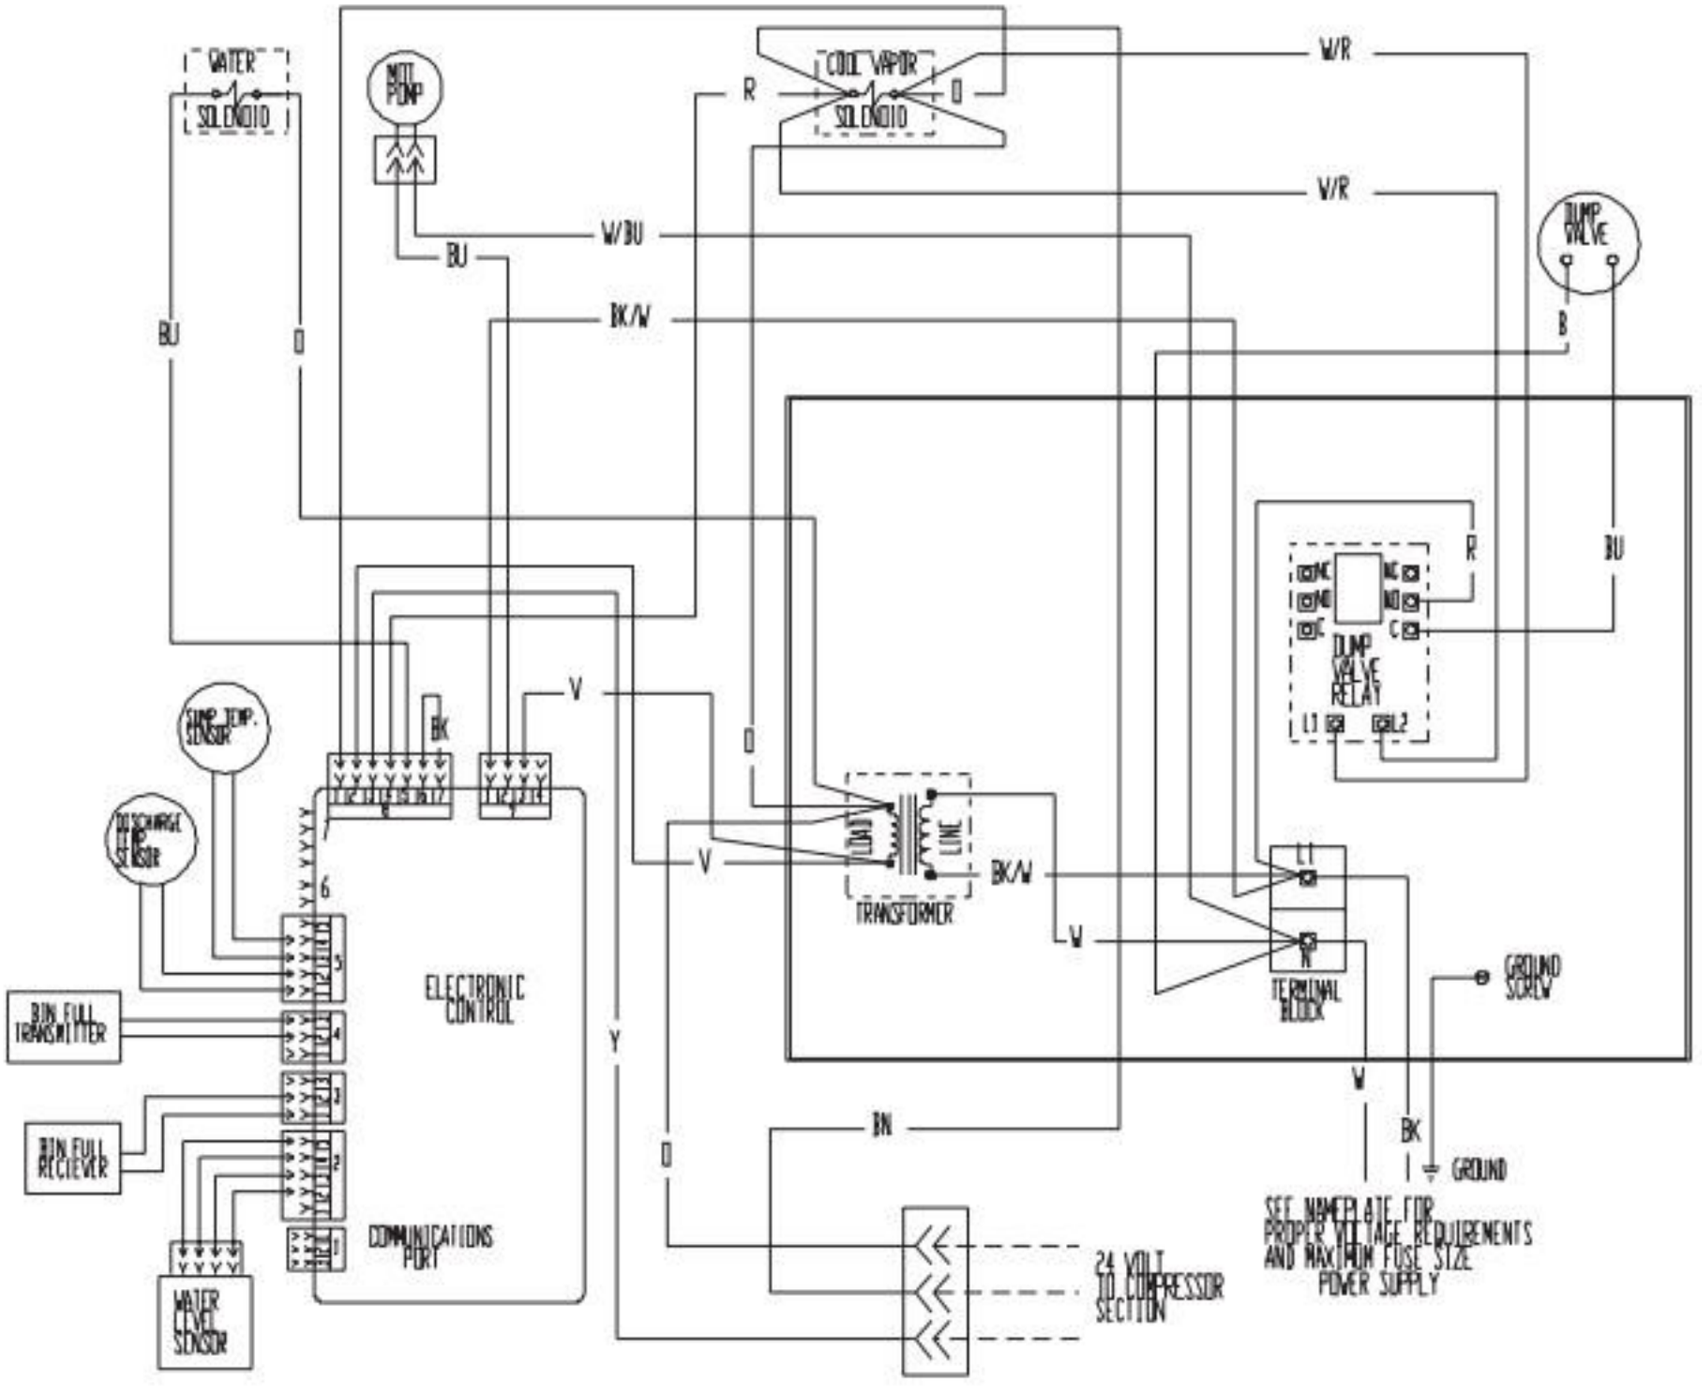

CAUTION:

MORE THAN ONE DISCONNECT MEANS MAY BE REQUIRED TO DISCONNECT ALL POWER TO THIS UNIT.

THIS UNIT MUST BE GROUNDED.

⚠ DASHED LINES INDICATE FIELD WIRING WHICH MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL STATE AND LOCAL CODES.

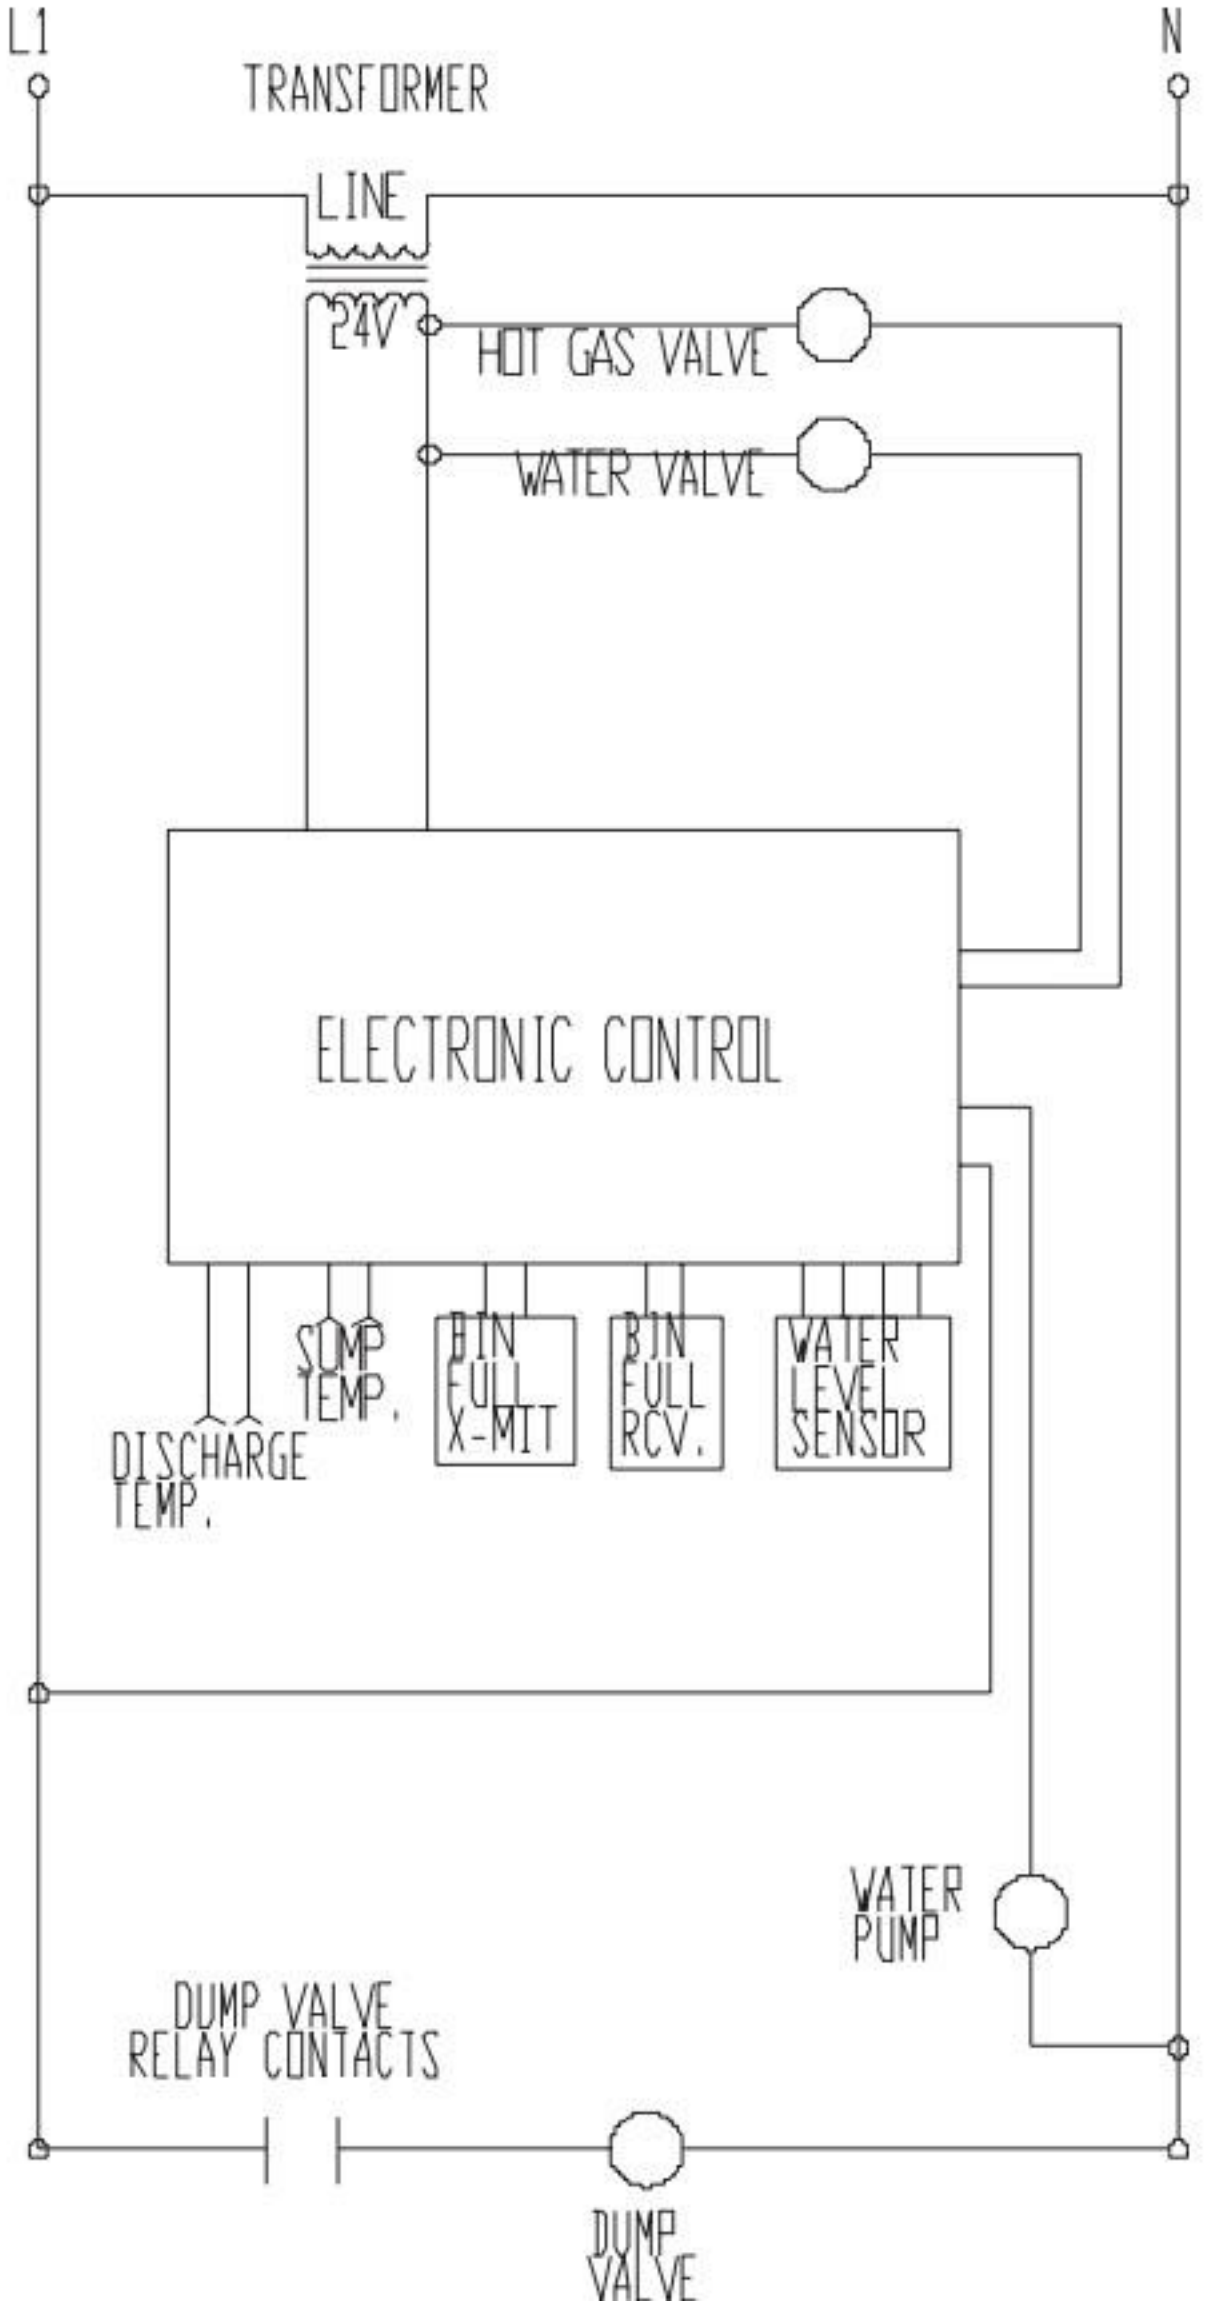
L1
N
TRANSFORMER
LINE
24V
HOT GAS VALVE
WATER VALVE
ELECTRONIC CONTROL
SUMP TEMP.
BIN FULL X-MIT
BIN FULL RCV.
WATER LEVEL SENSOR
DISCHARGE TEMP.
WATER PUMP
DUMP VALVE RELAY CONTACTS
DUMP VALVE