
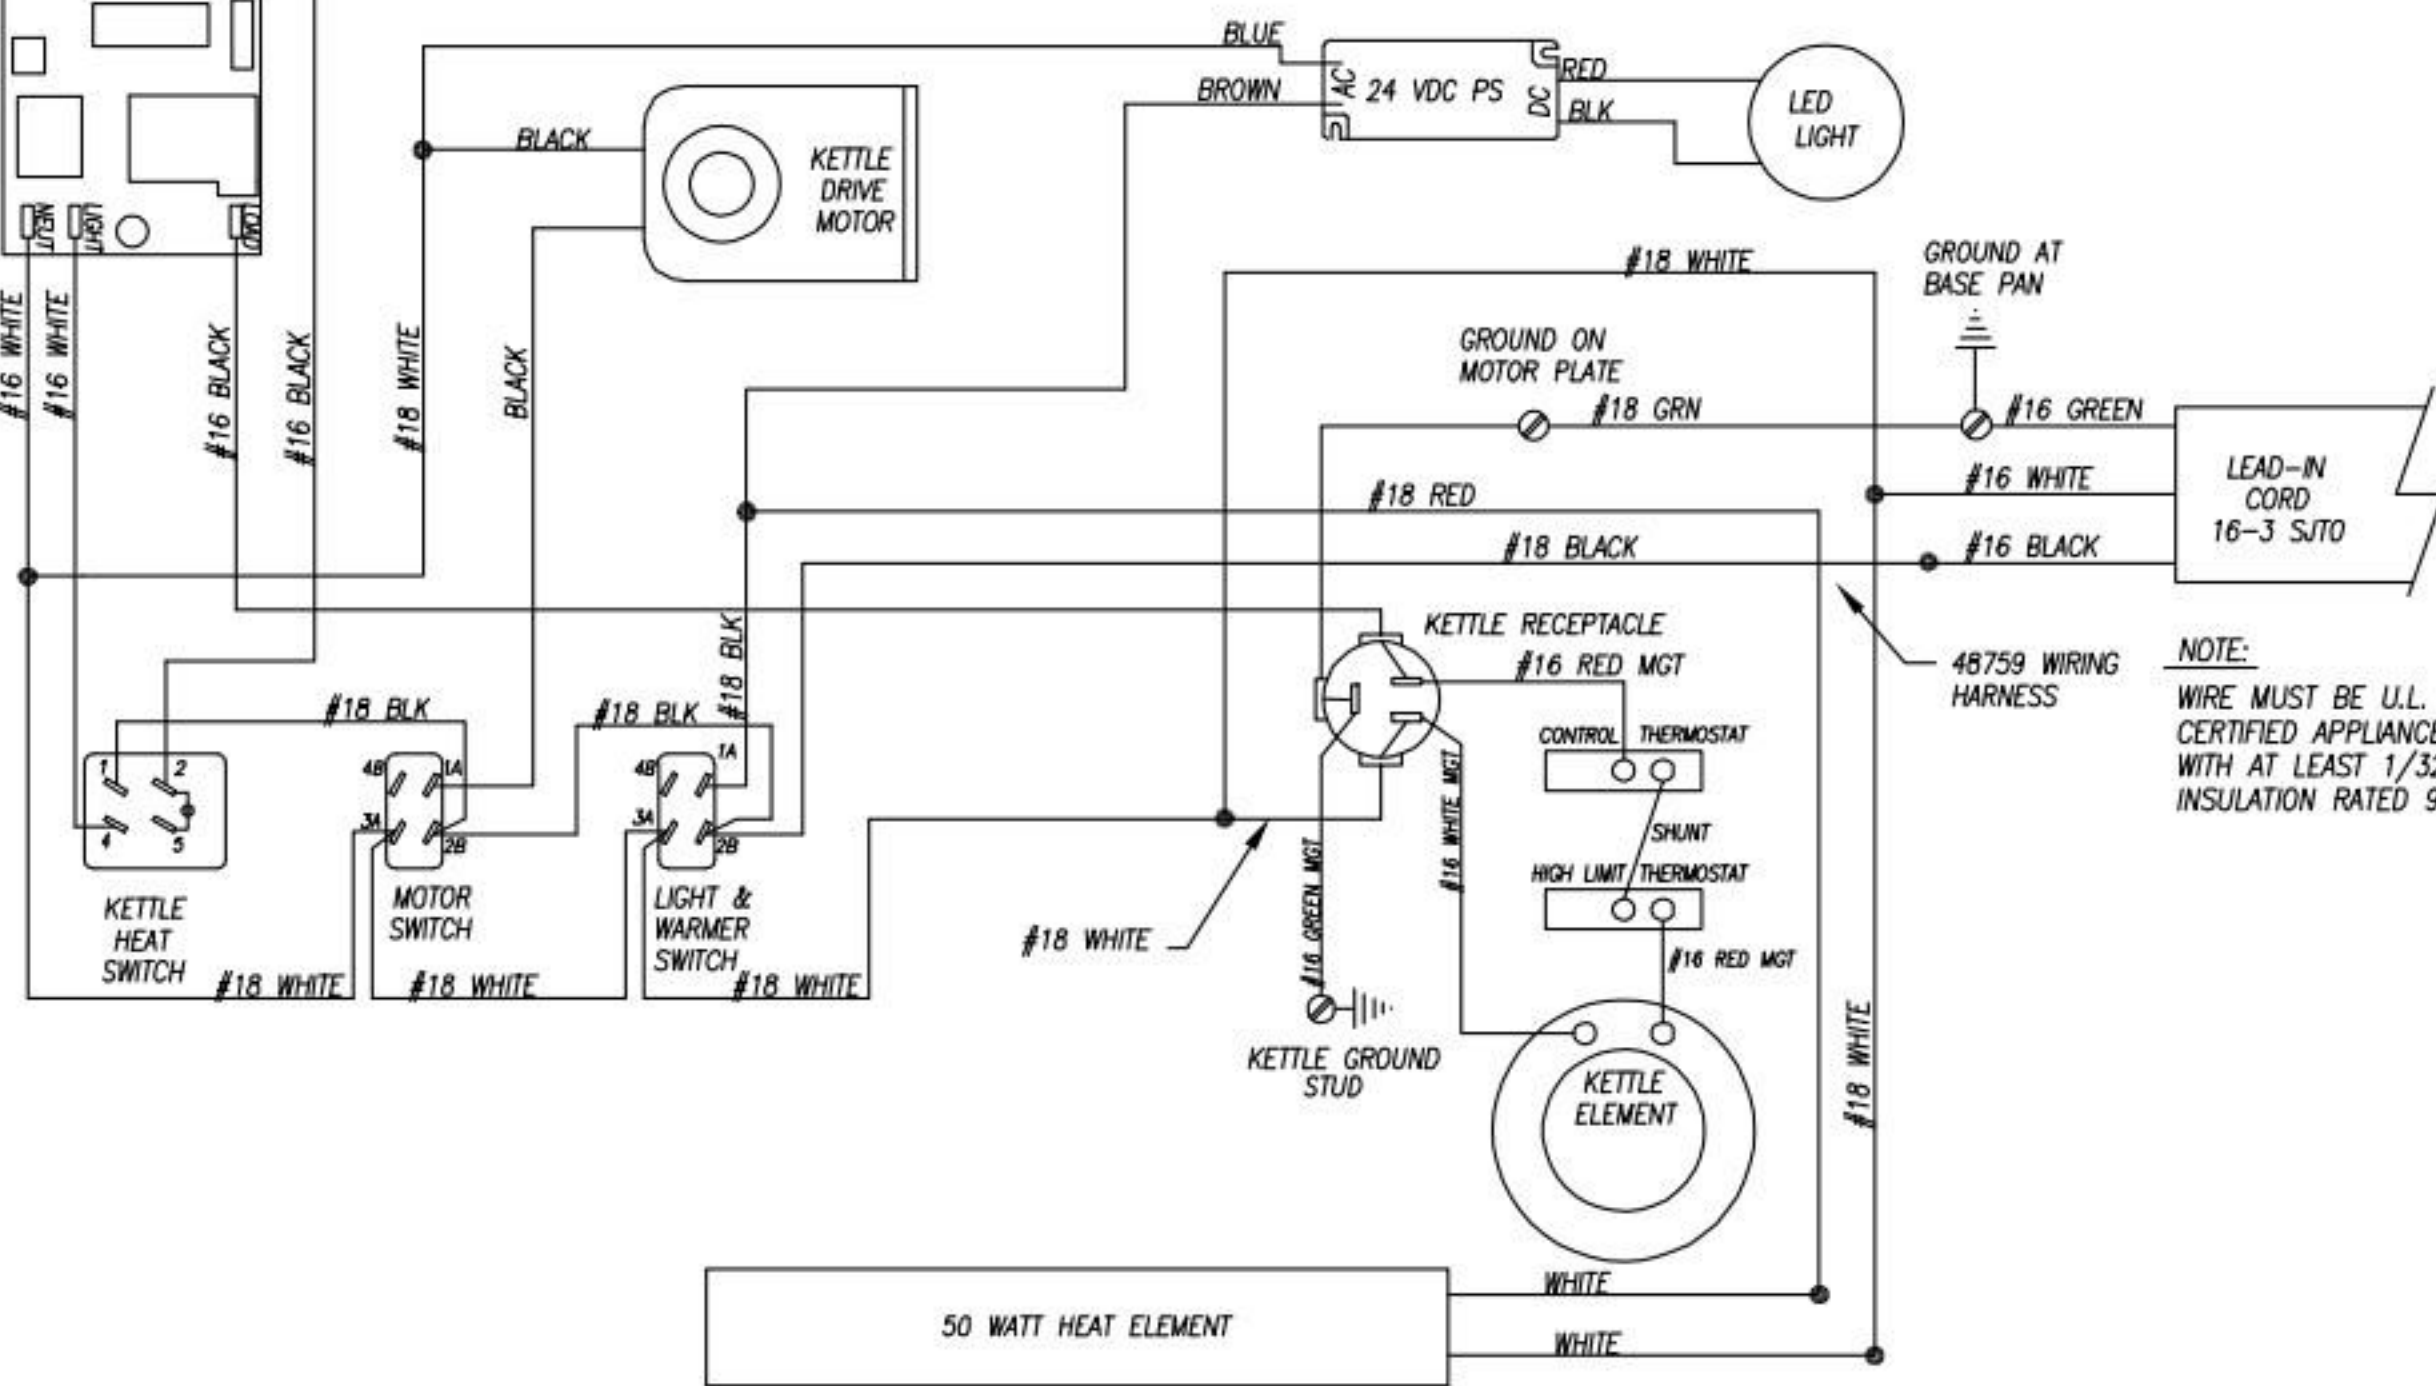


NOTE:
 WIRE MUST BE U.L. LABELED & C.S.A. CERTIFIED APPLIANCE WIRING MATERIAL WITH AT LEAST 1/32" THERMOPLASTIC INSULATION RATED 90°C OR 105°C OR LISTED APPLIANCE MATERIAL WITH AT LEAST 1/32" THICK SILICONE RUBBER WITH FIBERGLASS BRAID RATED 105°C. KETTLE LEAD WIRES ARE TO BE TYPE MAG OR MGT NICKEL CONDUCTOR 16GA. RATED 450°C.

AUTO SHUT-OFF MOUNTING BRACKET IS P/N 55427.

AUTO SHUT-OFF PCB

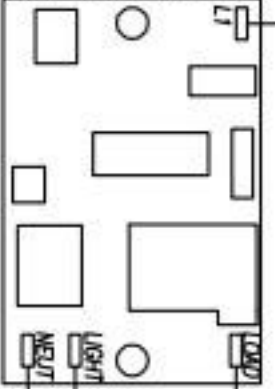

NOTE:
WIRE MUST BE U.L. LABELED & C.S.A. CERTIFIED APPLIANCE WIRING MATERIAL WITH AT LEAST 1/32" THERMOPLASTIC INSULATION RATED 90°C OR 105°C