CAUTION

ELECTRICAL SHOCK HAZARD
DISCONNECT POWER
BEFORE SERVICING

TO RESET TRANSFORMER:
(115 VOLT UNITS ONLY)

1. DISCONNECT POWER SUPPLY.
2. PRESS RESET BREAKER SWITCH ON TRANSFORMER.
3. REPLACE ELECTRICAL BOX COVER.
4. RECONNECT POWER SUPPLY.

115 VOLT

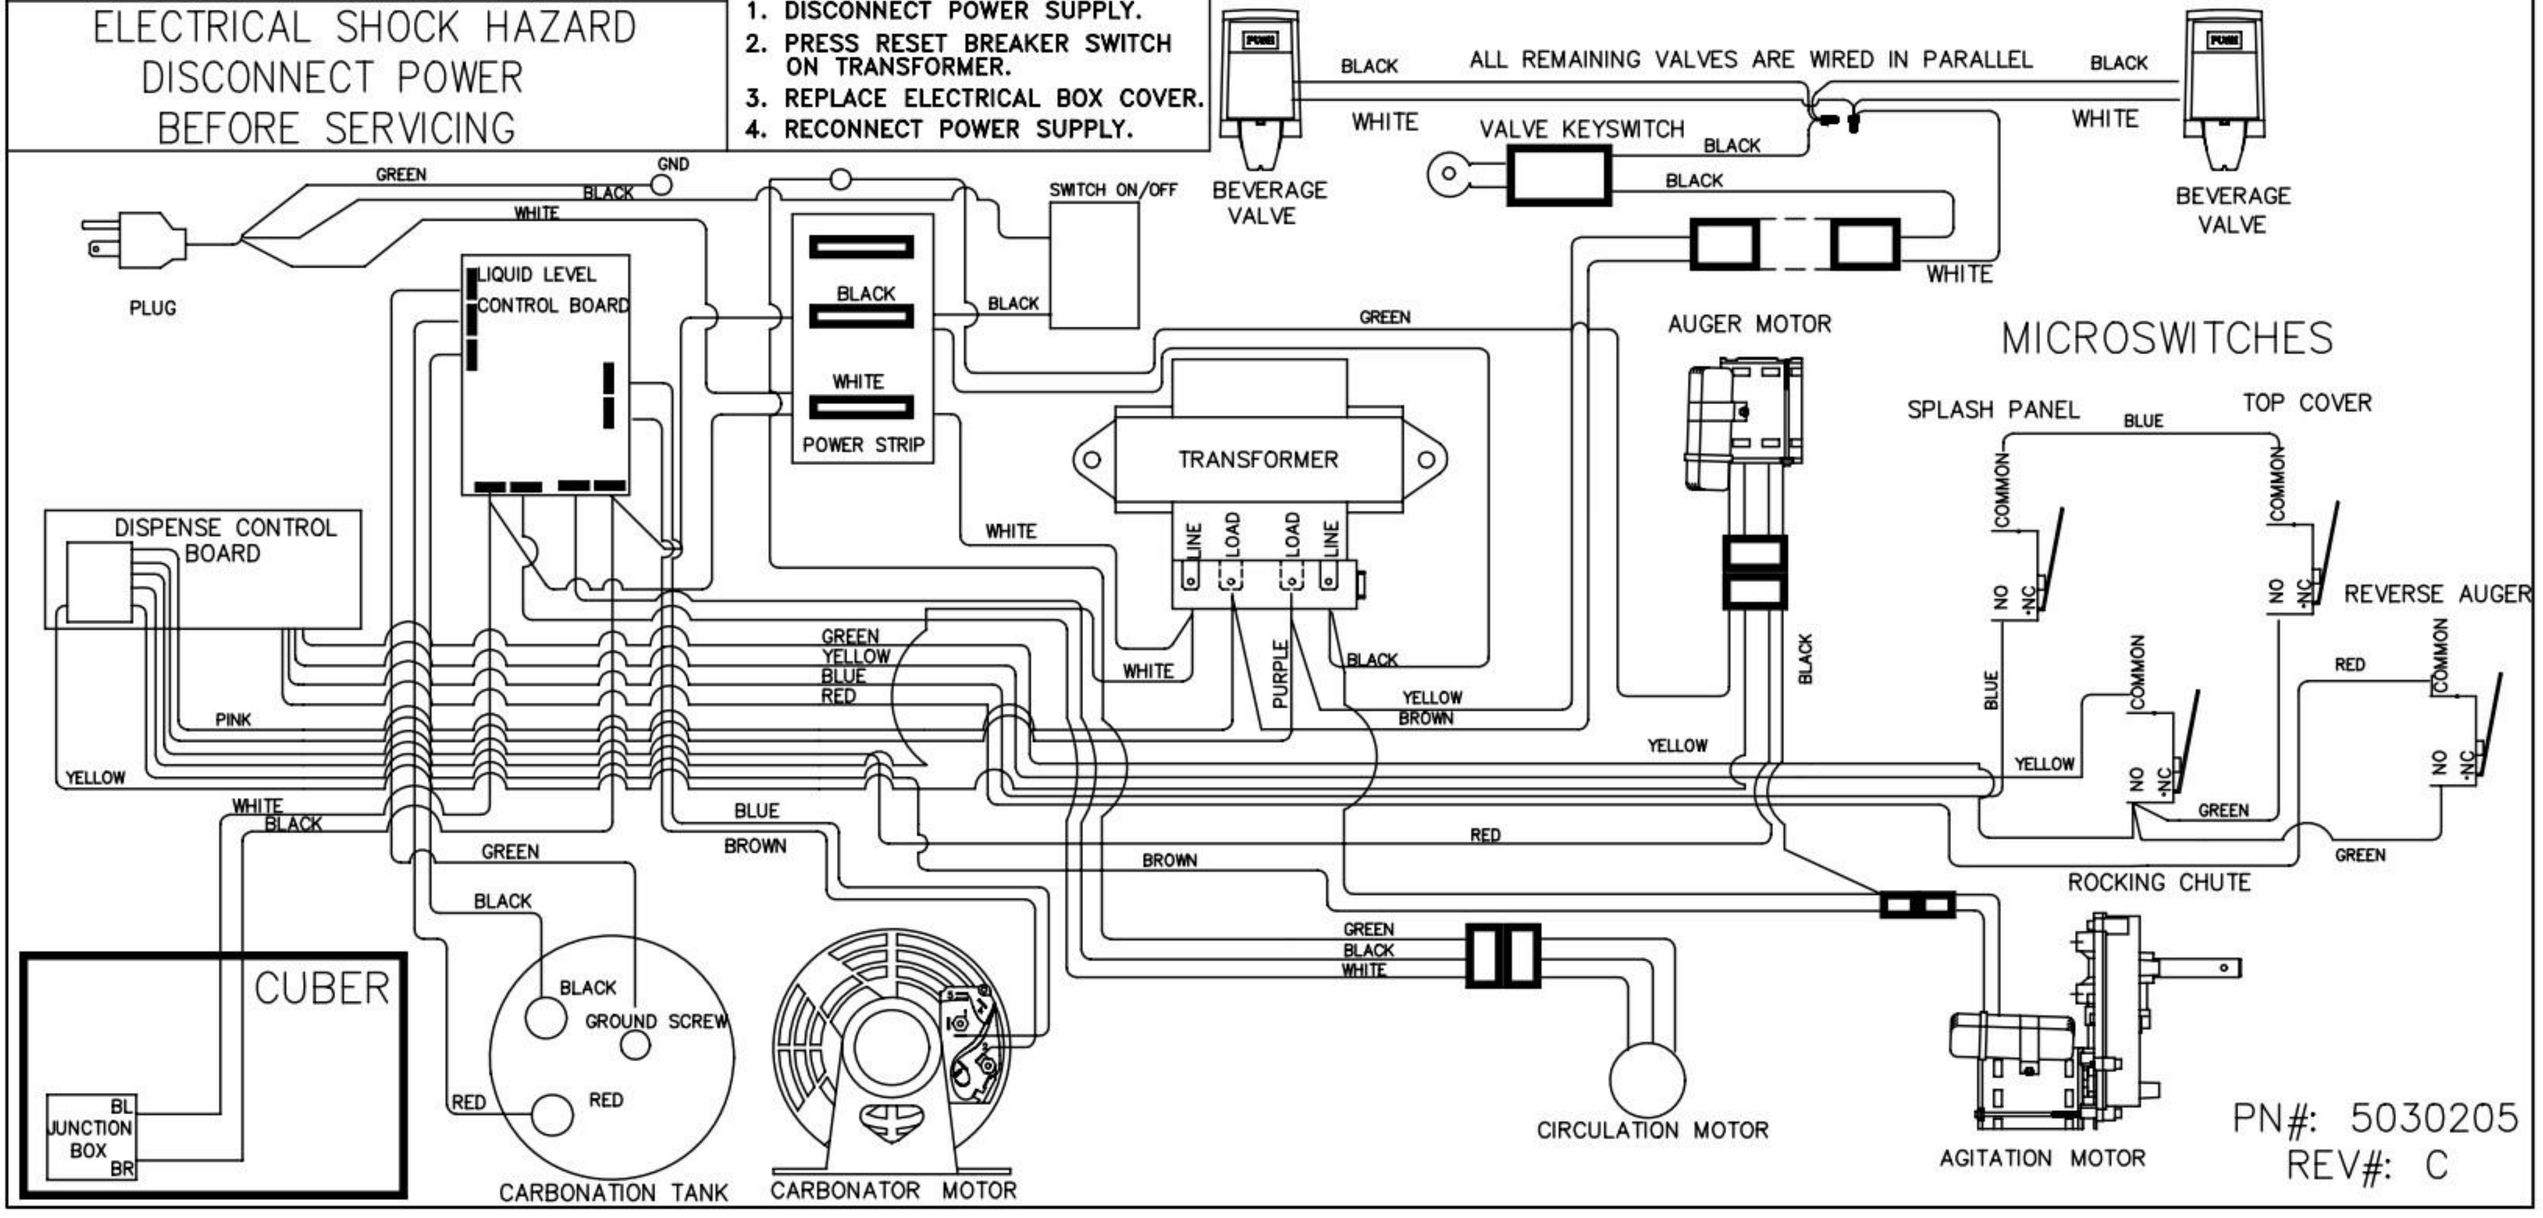

PN#: 5030205
REV#: C