CAUTION

ELECTRICAL SHOCK HAZARD
DISCONNECT POWER
BEFORE SERVICING

TO RESET TRANSFORMER:
(115 VOLT UNITS ONLY)

1. DISCONNECT POWER SUPPLY.
2. PRESS RESET BREAKER SWITCH ON TRANSFORMER.
3. REPLACE MERCHANDISER (FRONT ENCLOSURE).
4. RECONNECT POWER SUPPLY.

115 VOLT

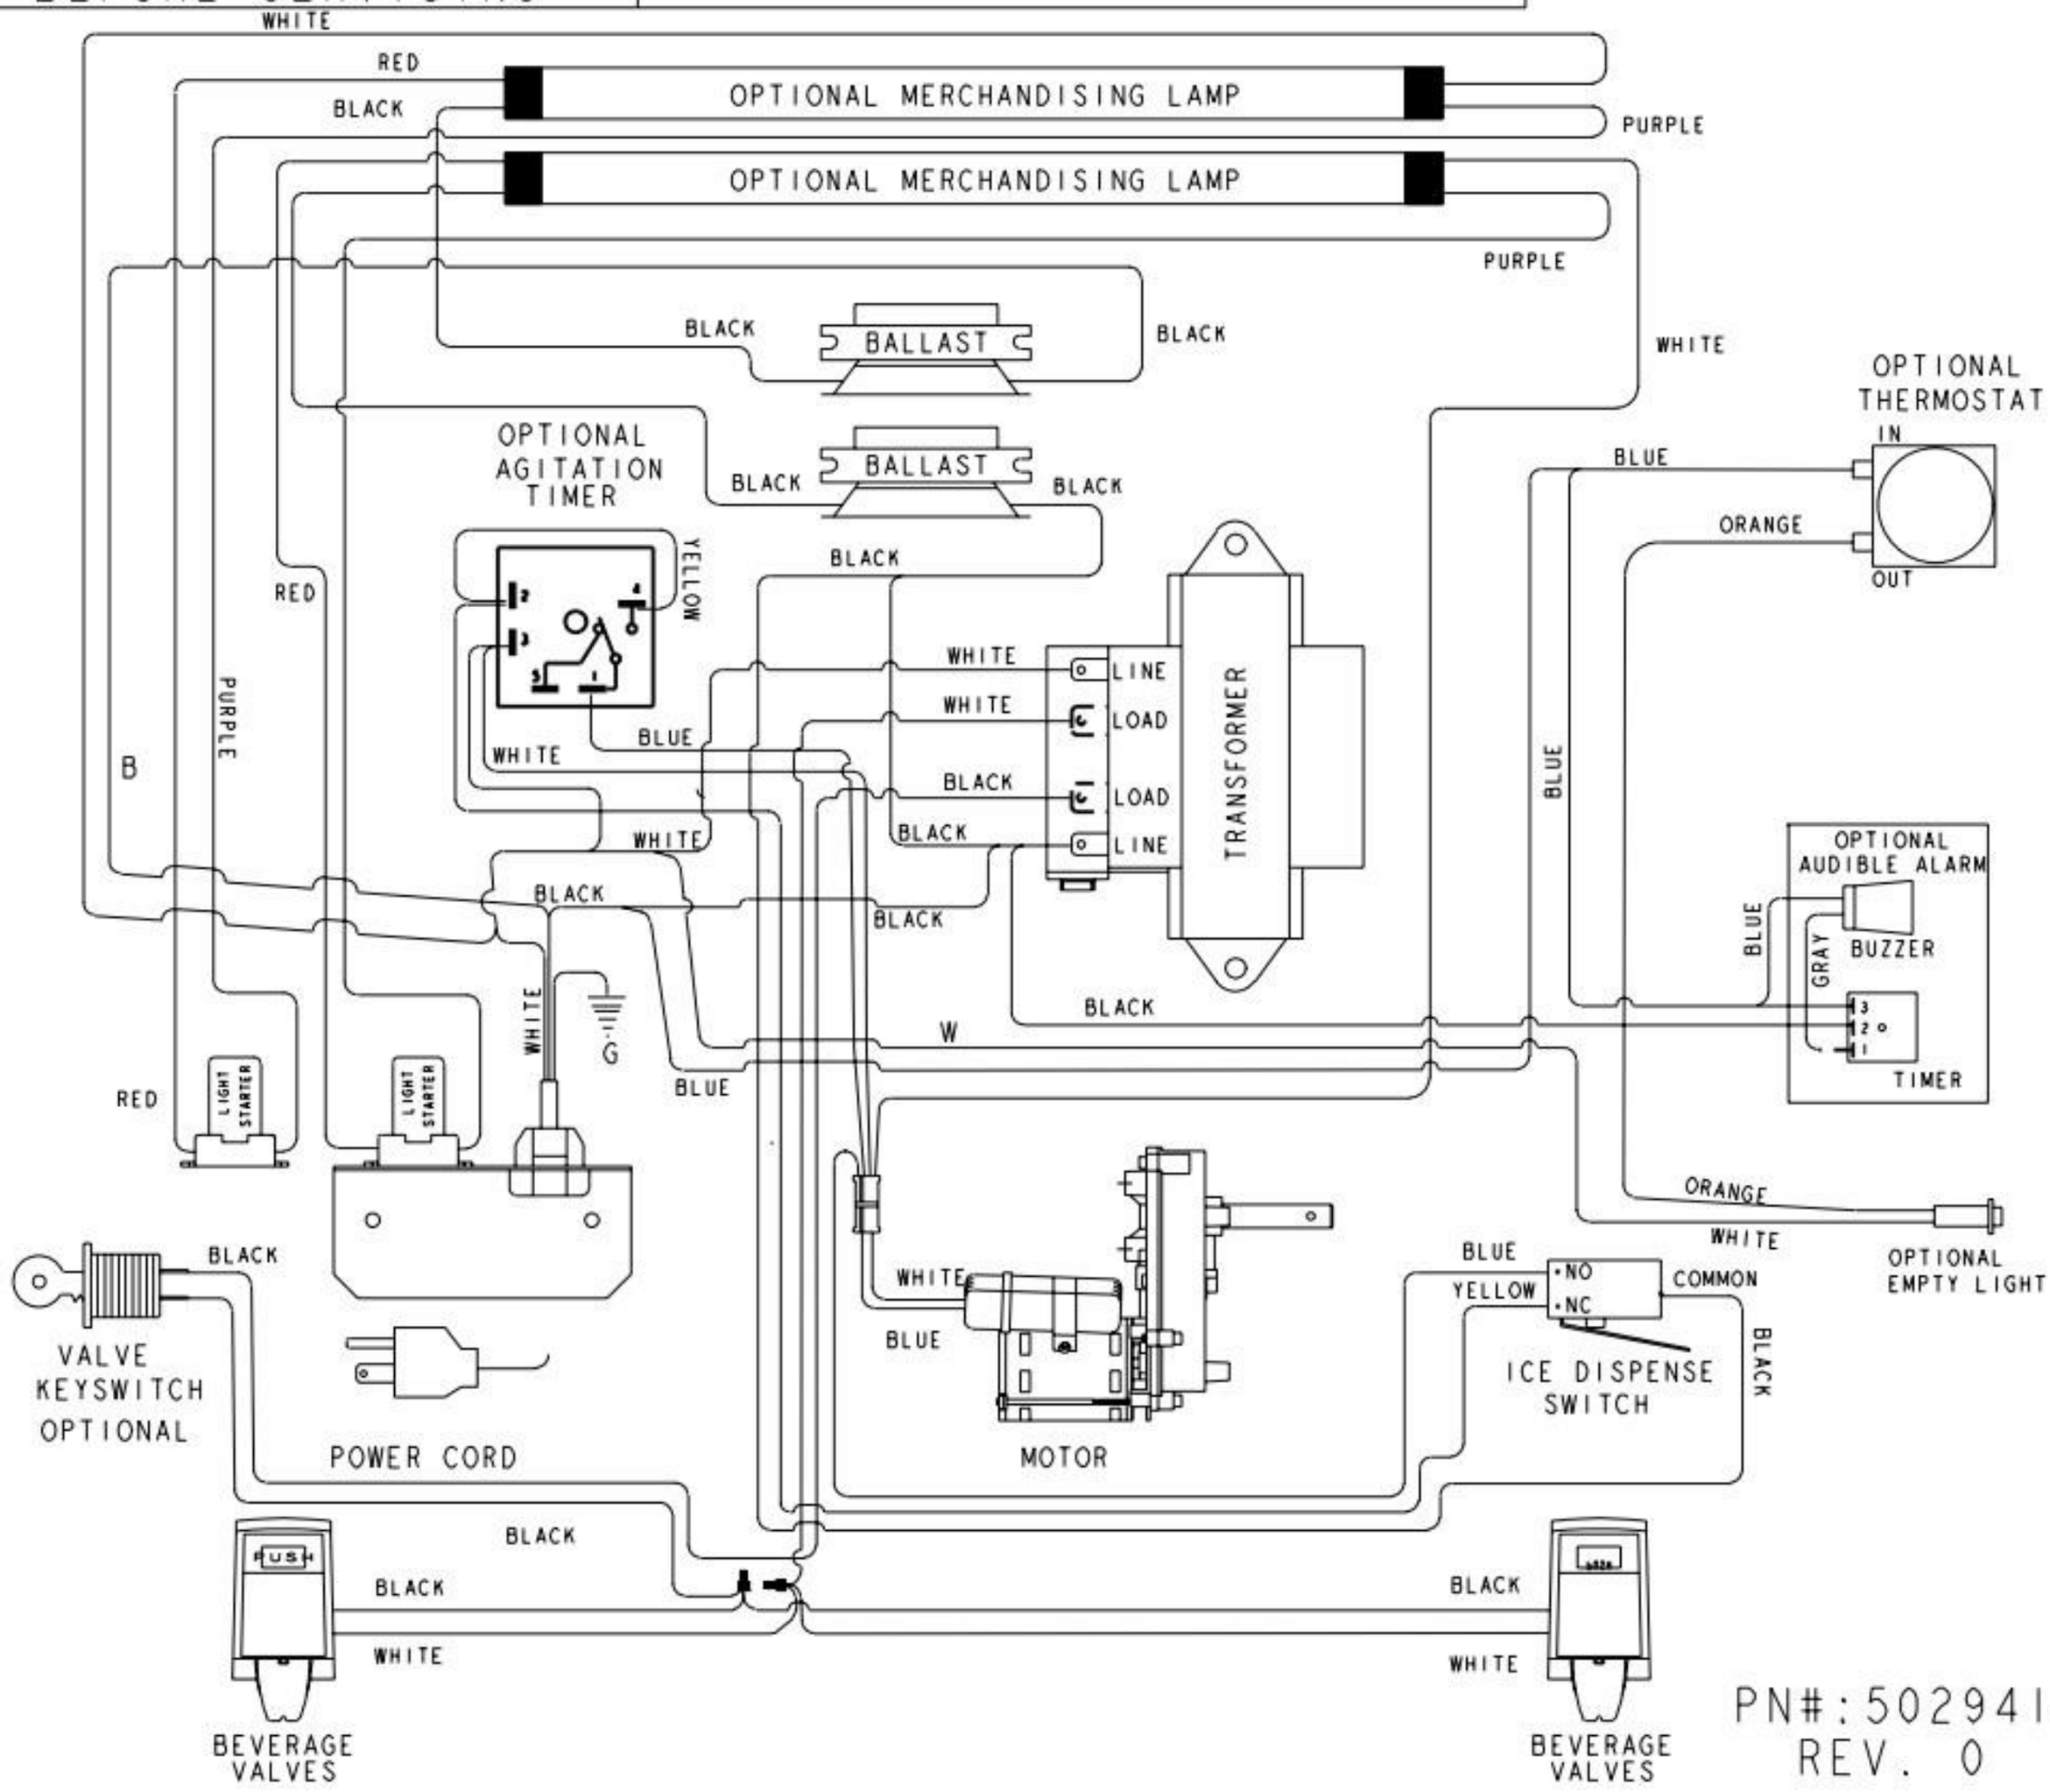

PN#: 5029414
REV. 0

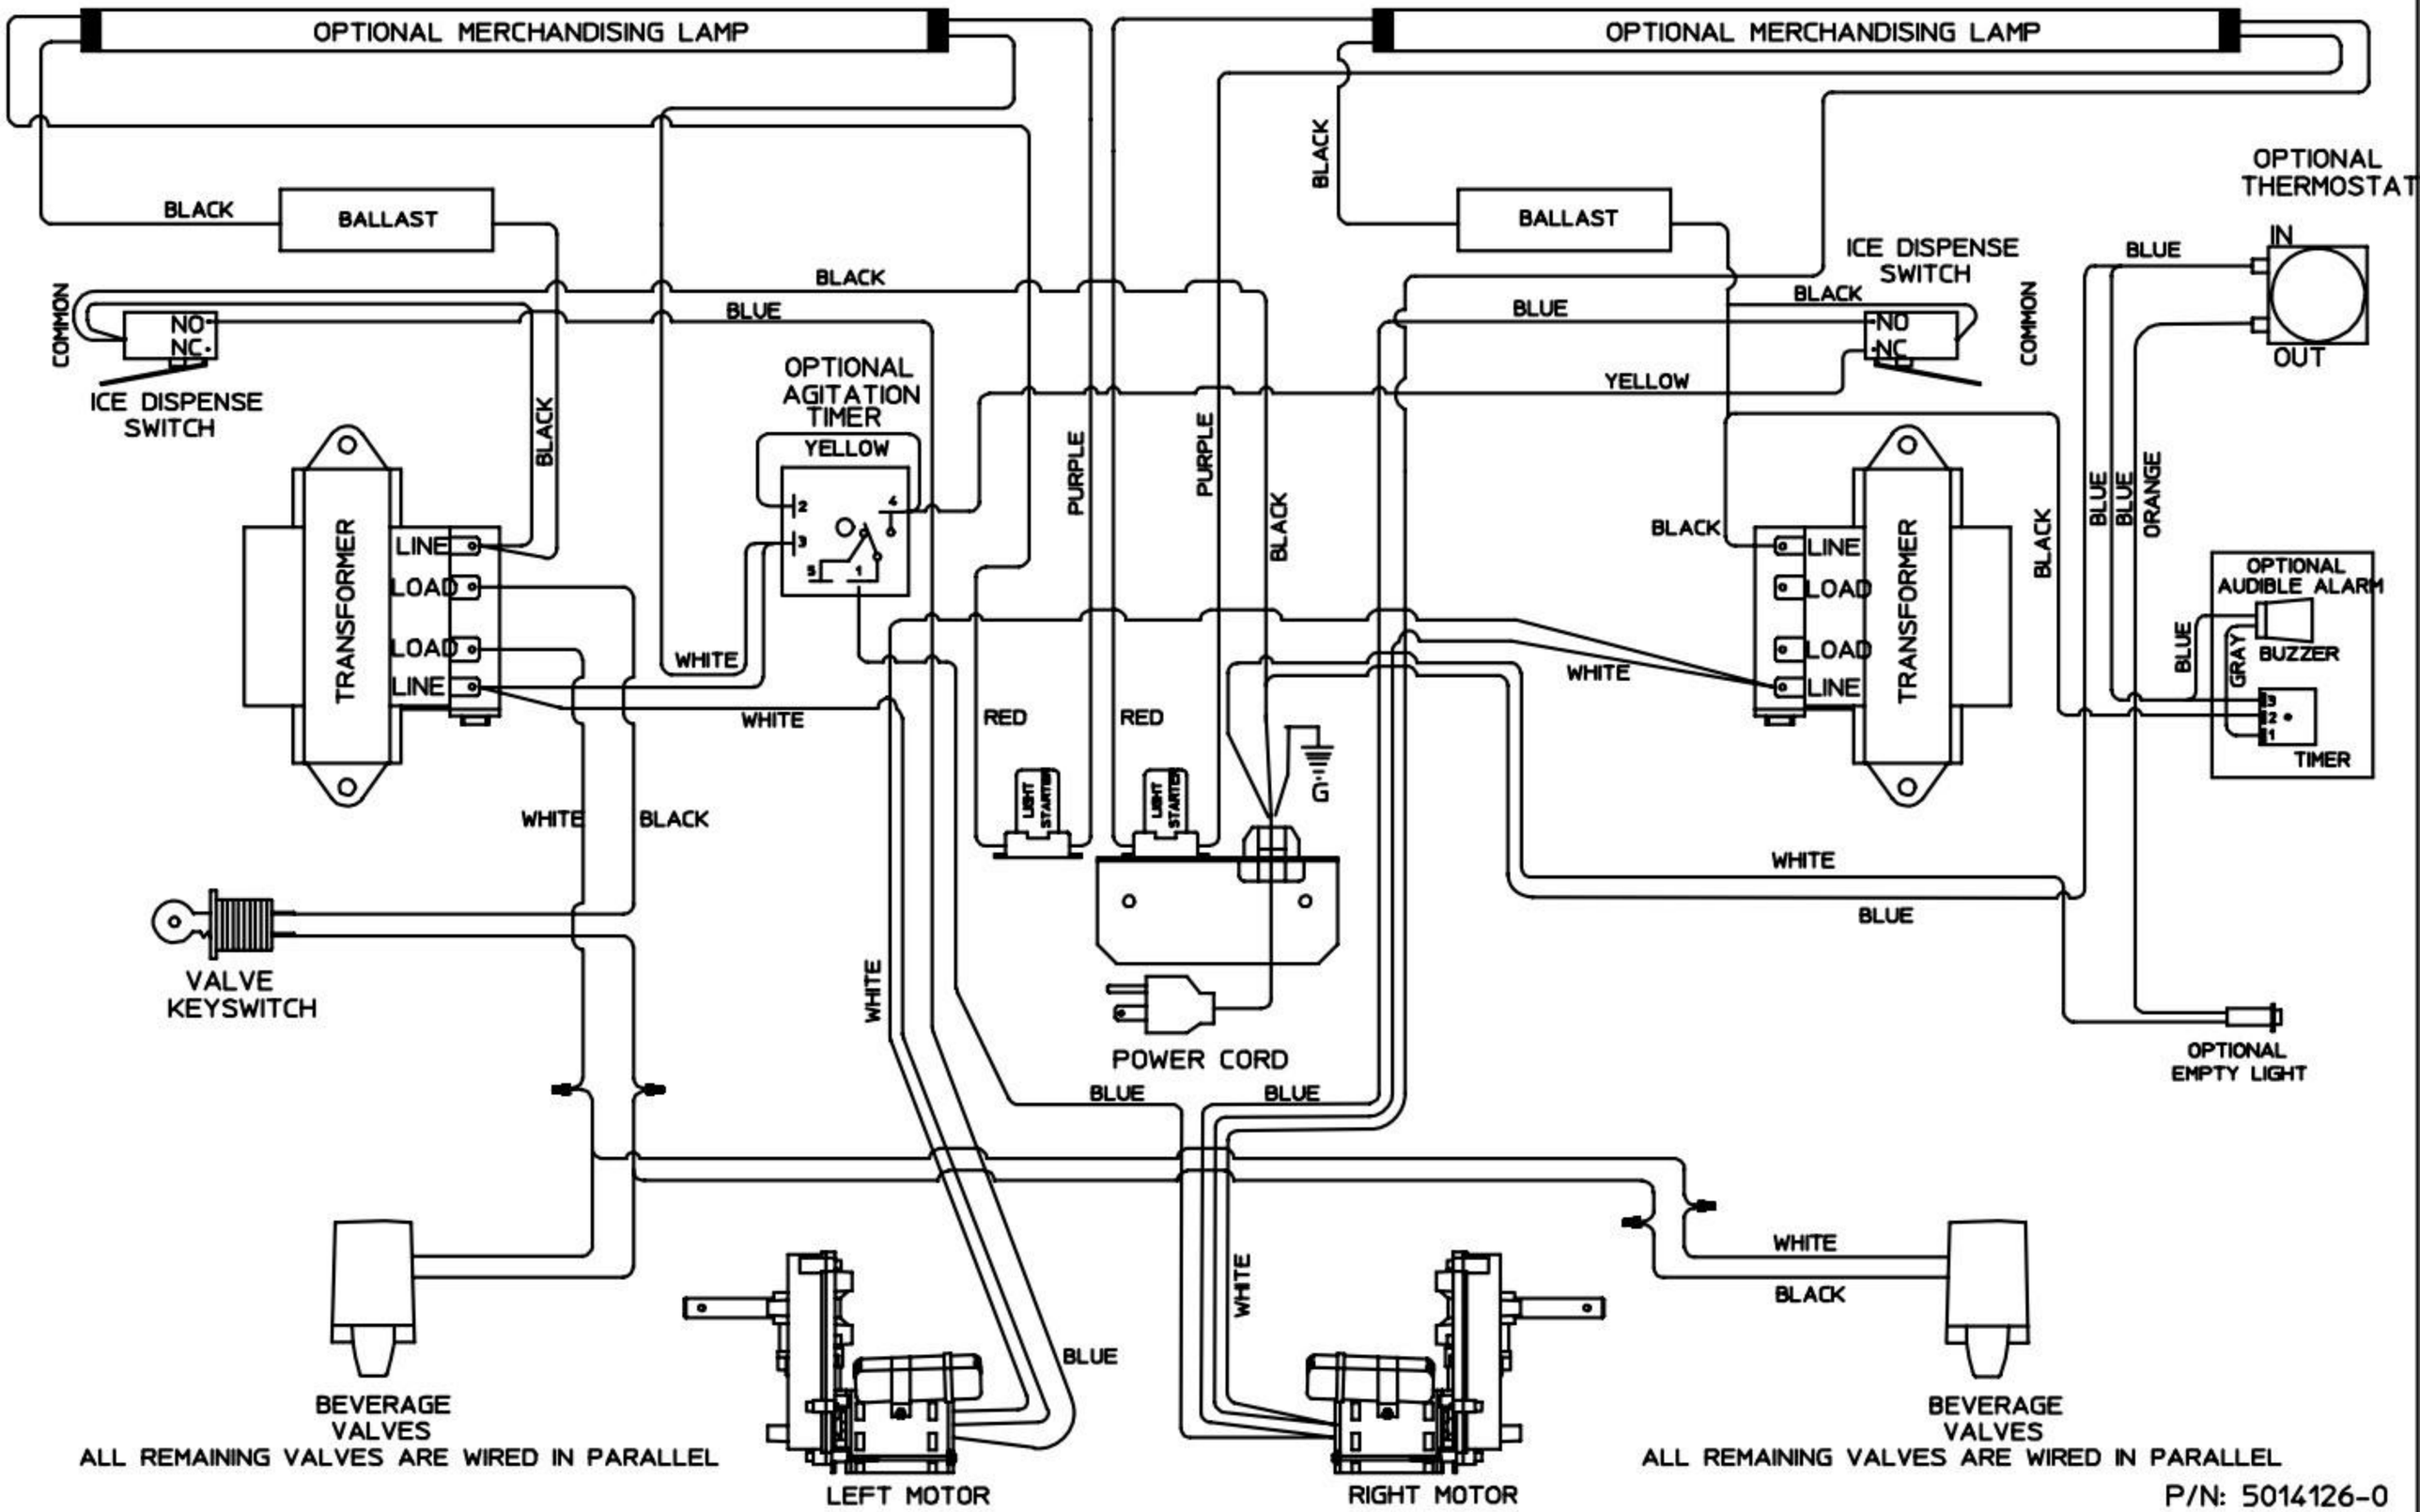
OPTIONAL MERCHANDISING LAMP
OPTIONAL MERCHANDISING LAMP
BLACK
BALLAST
BALLAST
BLACK
COMMON
NO
NC
ICE DISPENSE SWITCH
BLACK
BLUE
BLACK
BLUE
YELLOW
ICE DISPENSE SWITCH
COMMON
OPTIONAL THERMOSTAT
IN
OUT
BLUE
OPTIONAL AGITATION TIMER
YELLOW
TRANSFORMER
LINE
LOAD
LOAD
LINE
BLACK
PURPLE
PURPLE
BLACK
BLACK
LINE
LOAD
LOAD
LINE
TRANSFORMER
BLACK
BLUE
BLUE
ORANGE
OPTIONAL AUDIBLE ALARM
BLUE
GRAY
BUZZER
TIMER
WHITE
WHITE
RED
RED
WHITE
WHITE
BLACK
LIGHT STARTER
LIGHT STARTER
G
WHITE
BLUE
VALVE KEYSWITCH
WHITE
POWER CORD
BLUE
BLUE
OPTIONAL EMPTY LIGHT
WHITE
BLACK
WHITE
BLUE
BEVERAGE VALVES
ALL REMAINING VALVES ARE WIRED IN PARALLEL
LEFT MOTOR
RIGHT MOTOR
BEVERAGE VALVES
ALL REMAINING VALVES ARE WIRED IN PARALLEL

P/N: 5014126-0