




# CAUTION

ELECTRICAL SHOCK HAZARD  
DISCONNECT POWER  
BEFORE SERVICING

- TO RESET TRANSFORMER:**  
(115 VOLT UNITS ONLY)
1. DISCONNECT POWER SUPPLY.
  2. PRESS RESET BREAKER SWITCH ON TRANSFORMER.
  3. REPLACE MERCHANDISER (FRONT ENCLOSURE).
  4. RECONNECT POWER SUPPLY.

## 230 VOLT

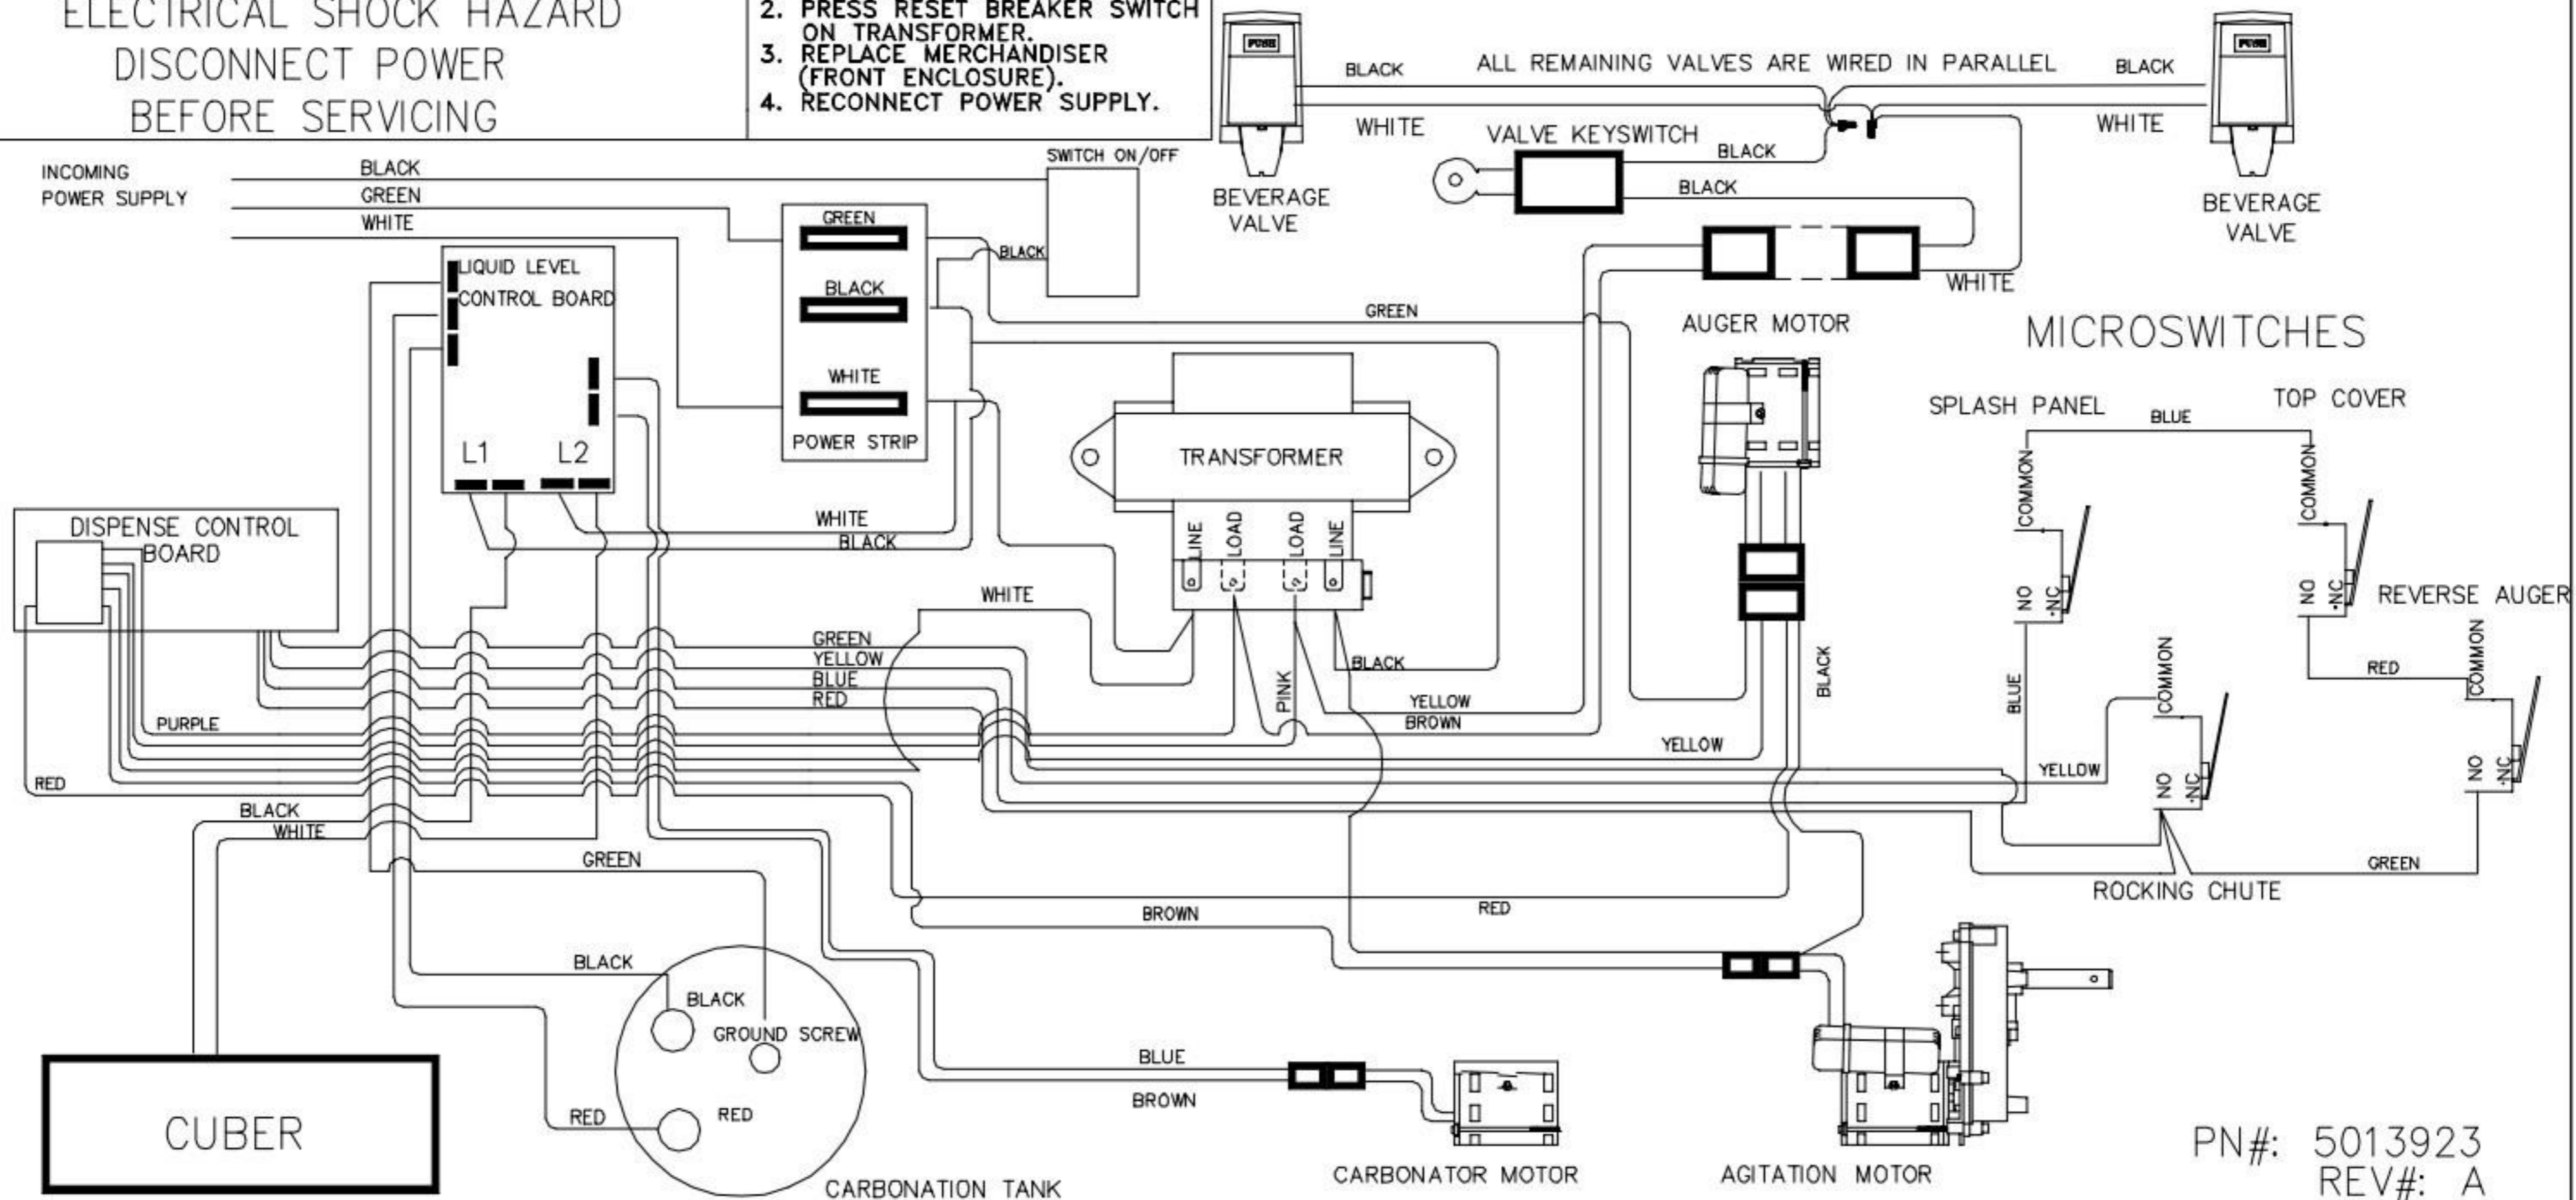

PN#: 5013923  
REV#: A