


VOLTAGE CHANGE
COM-230 TO POWER 230 VAC
COM-400 TO POWER 400 VAC

SUPPLY PHASE L1-L3

GROUND CLAMP

CAUTION:
DO NOT CONNECT THE SAME TIME INDICATOR
REVERSE OR FORWARD WITH LIGHT TENSION

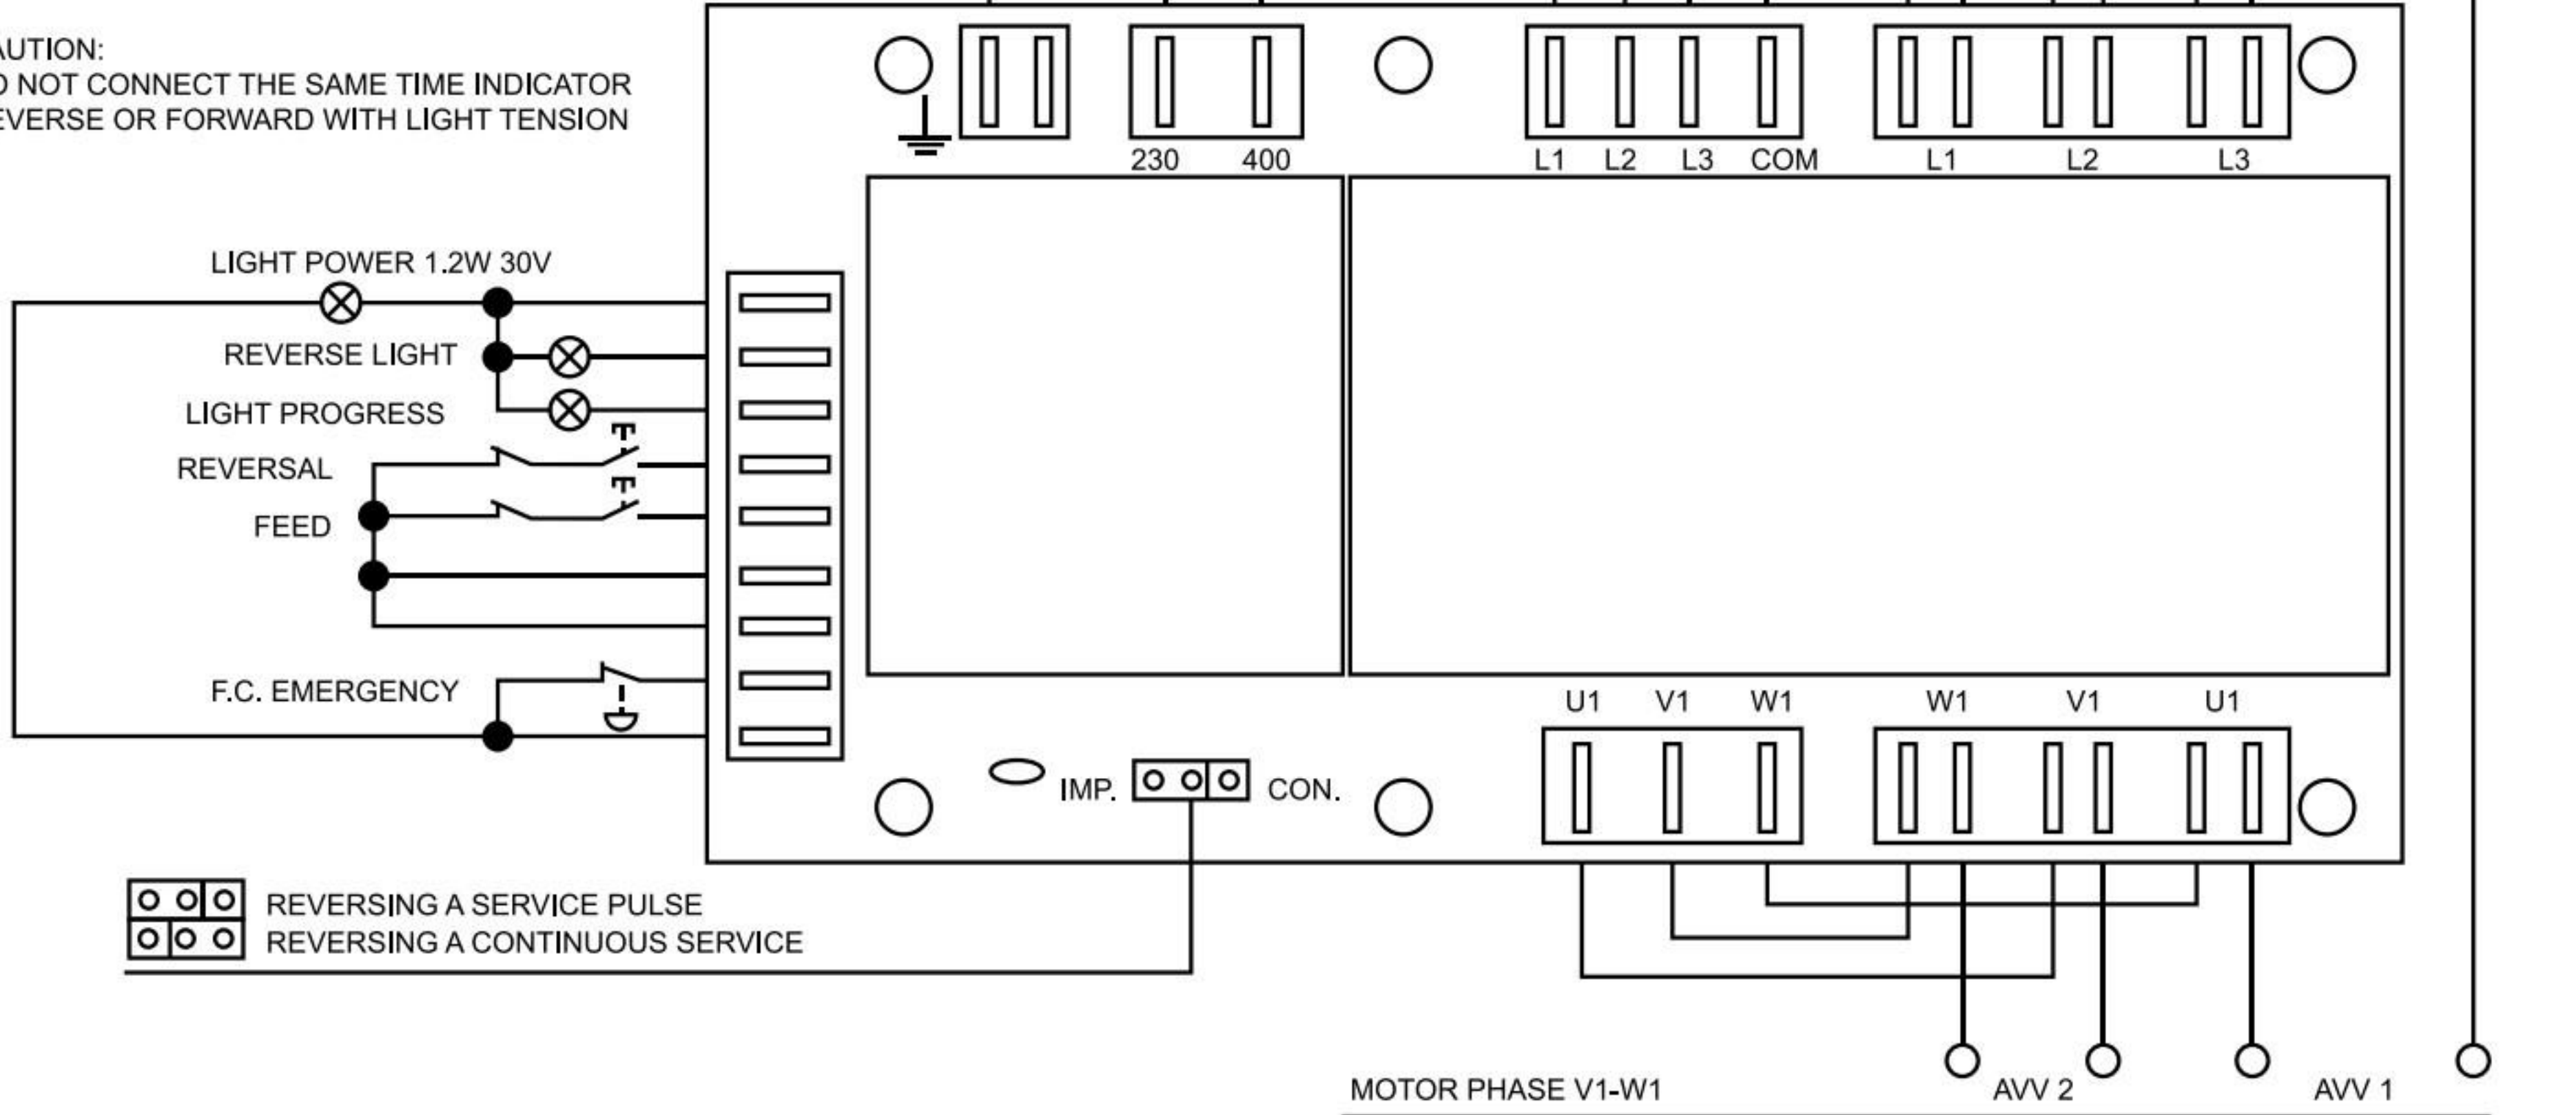

○ ○ ○ REVERSING A SERVICE PULSE
● ● ● REVERSING A CONTINUOUS SERVICE

MOTOR PHASE V1-W1

AVV 2

AVV 1